

# Historic Architectural Review Commission

## Staff Report Item 5

---

<b>Meeting Date:</b>	December 16, 2014
<b>Applicant:</b>	Meridian Engineering
<b>Application Number:</b>	H14-01-1744
<b>Address:</b>	#614 Frances Street
<b>Description of Work:</b>	Demolition of historic hip and shed roofs on a contributing house. Also includes the demolition of a wall on the north side of the house and demolition of a non-historic shed and inappropriate porch wall.
<b>Building Facts:</b>	This site has a one story frame vernacular house listed as a contributing resource in the survey and was constructed c. 1920. The 1926 Sanborn map shows a house with a similar footprint to what exists today, giving credence that the multitude of roof forms have existed in that sort of fashion for 88 years. Aerial photographs show that the roof forms have existed since at least 1964 and are therefore historic.
<b>Ordinance and Guidelines Cited in Review:</b>	<p>Demolition of historic and contributing structures, Sec. 102-217 (3) and Sec.102-218 Criteria for Demolitions of the Land Development Regulations.</p> <p>Demolition of non-historic or non-contributing structures, Sec. 102-217 (2) and Sec. 102-125 Historic architectural review commission findings precedent to issuance of the Land Development Regulations.</p> <p>Demolitions and Relocations (page 39), specifically guideline 1.</p>

### Staff Analysis

On November 25, 2014, the Commission approved the design of a new addition and the first reading for the demolition request. This report is for the review of

the second reading for the demolition request. The Certificate of Appropriateness proposes the demolition of four roofs and one wall on the rear section of a contributing house. As stated before the roofs are historic as evidenced by aerial photographs and the Sanborn maps, but the roofs are not a character defining feature or contributing. Also the wall that encroaches on Robert's Lane appears to have been originally a covered porch that was fully enclosed after 1965 according to a historic photograph. It is obvious that this area has been heavily altered and little historic material is left. There is also the removal of a concrete wall on the front porch of the building, which existed in 1965. That makes the concrete wall historic, but it is an inappropriate addition to the building. Also included is the demolition of a non-historic shed in the rear.

It is staff's opinion that the proposed demolition will cover historic, but non-contributing elements of the house and a non-historic shed structure. While the roofs and concrete wall are historic, they are not character-defining features and do not meet any of the criteria listed in Sec. 102-125 (1) through (9). It is staff's opinion that none of the elements will be deemed contributing in the near future. The Commission should consider the demolition request for the non-historic elements since it is consistent with preservation guidelines and with Sec. 102-217-218 of the Land Development Regulations.

Staff recommends to the Commission to consider the request for demolition.

# APPLICATION



# CITY OF KEY WEST BUILDING DEPARTMENT

CERTIFICATE OF APPROPRIATENESS-03-2014 011744

APPLICATION #

OWNER'S NAME:

Elizabeth Ross

DATE:

11-01-14

OWNER'S ADDRESS:

1015 Fleming St., Key West

PHONE #:

305-509-2670

APPLICANT'S NAME:

Meridian Engineering, LLC

PHONE #:

305-293-3263

APPLICANT'S ADDRESS:

201 Front St., Ste. 203, Key West, FL 33040

ADDRESS OF CONSTRUCTION:

614 Frances Street

# OF  
UNITS

1

THERE WILL BE A FINAL INSPECTION REQUIRED UNDER THIS PERMIT

## DETAILED DESCRIPTION OF WORK:

Remove the northern portion of the house back to the property line. Add a new roof to the rear portion of home. The "sawtooth" style gables of the first two roofs will be copied in a third gable removing the existing shed roofs and hip. The existing shed roof on the very back portion of the home will be extended to the north to cover a portion of the deck. Finally a 12'x8' pool will be added to the rear of the property.

*Chapter 837.06 F.S.-False Official Statements – Whoever knowingly makes a false statement in writing with the intent to mislead a public servant in the performance of his or her official duty shall be guilty of a misdemeanor of the second degree punishable as provided for in s. 775.082 or 775.083*

\*\*\*\*\*

This application for Certificate of Appropriateness must precede applications for building permits, right of way permits, variances, and development review approvals. Applications must meet or exceed the requirements outlined by the Secretary of the Interior's Standards for Rehabilitation and Key West's Historic Architectural Guidelines.

Once completed, the application shall be reviewed by staff for completeness and either approved or scheduled for presentation to the Historic Architectural Review Commission at the next available meeting. The applicant must be present at this meeting. The filing of this application does not ensure approval as submitted.

Applications that do not possess the required Submittals will be considered incomplete and will not be reviewed for approval.

Date:

11/3/14

Applicant's Signature:

*[Signature]*

## Required Submittals

<input type="checkbox"/>	TWO SETS OF SCALED DRAWINGS OF FLOOR PLAN, SITE PLAN AND EXTERIOR ELEVATIONS (for new buildings and additions)
<input type="checkbox"/>	TREE REMOVAL PERMIT (if applicable)
<input type="checkbox"/>	PHOTOGRAPHS OF EXISTING BUILDING (repairs, rehabs, or expansions)
<input type="checkbox"/>	PHOTOGRAPHS OF ADJACENT BUILDINGS (new buildings and additions)
<input type="checkbox"/>	ILLUSTRATIONS OF MANUFACTURED PRODUCTS TO BE USED SUCH AS SHUTTERS, DOORS, WINDOWS, PAINT COLOR CHIPS, AND AWNING FABRIC

Oper: KEYW08  
Date: 11/05/14 55  
Receipt no: 3666

PT

Trans number:  
VN VISA/MS

Trans date:

\* BUILDING PERMITS-NEW  
Staff Use Only  
3028511  
\$100.00

Date: 11/03/14 Time: 14:55:26

Fee Due:\$

HISTORIC ARCHITECTURAL REVIEW APPLICATION

# HISTORIC ARCHITECTURAL REVIEW COMMISSION USE ONLY

\*\*\*\*\*

Approved

Denied

Deferred

Reason for Deferral or Denial:

HARC Comments:


Limit of Work Approved, Conditions of Approval and/or Suggested  
Changes:

Date: \_\_\_\_\_


Signature: \_\_\_\_\_

Historic Architectural  
Review Commission

# SANBORN MAPS

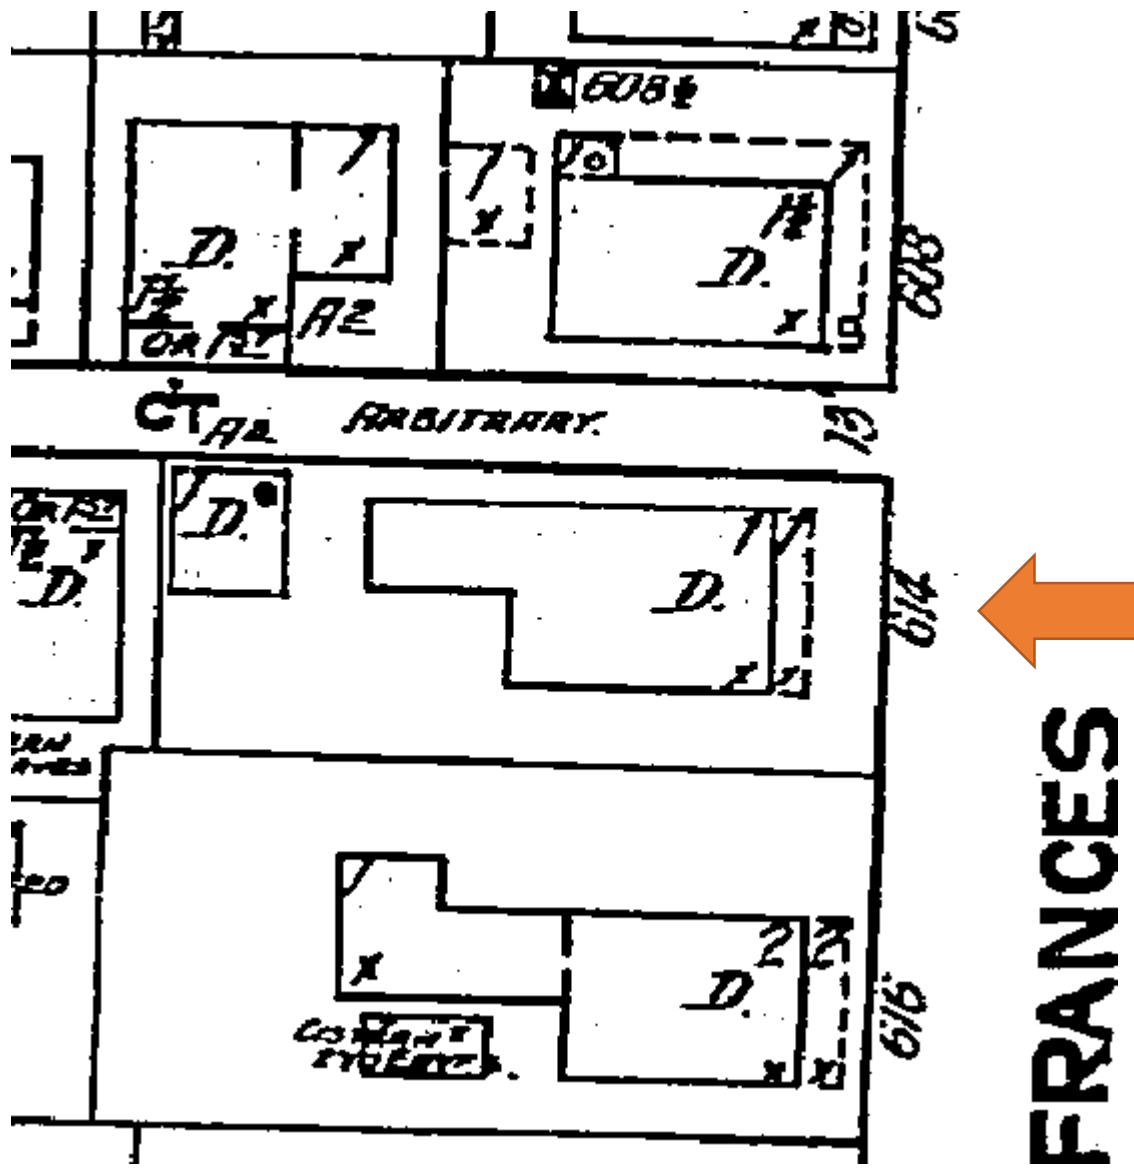


1912 Sanborn Map

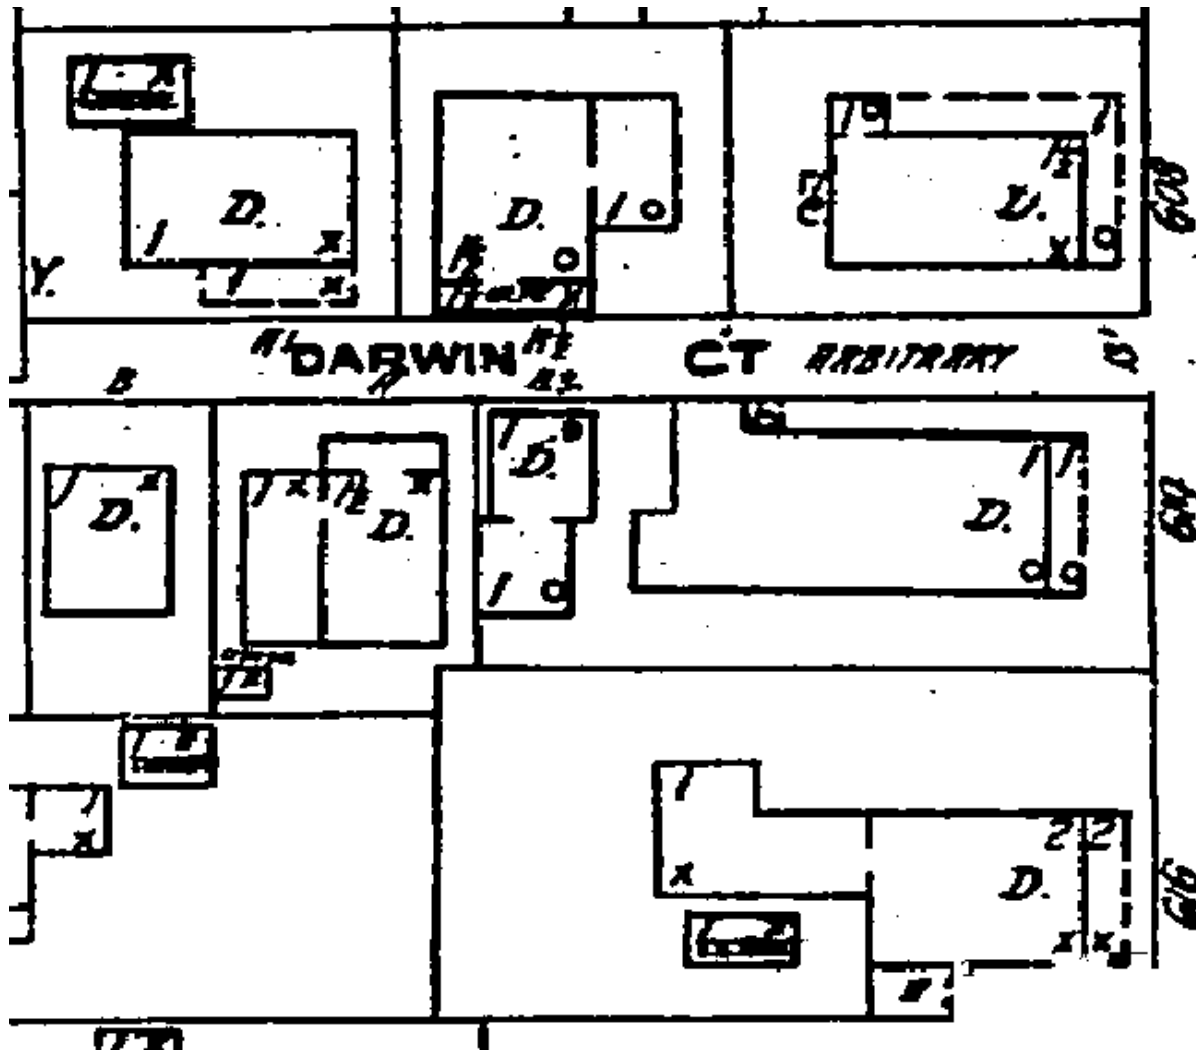


FRANCIS (FRANCE)

1926 Sanborn Map

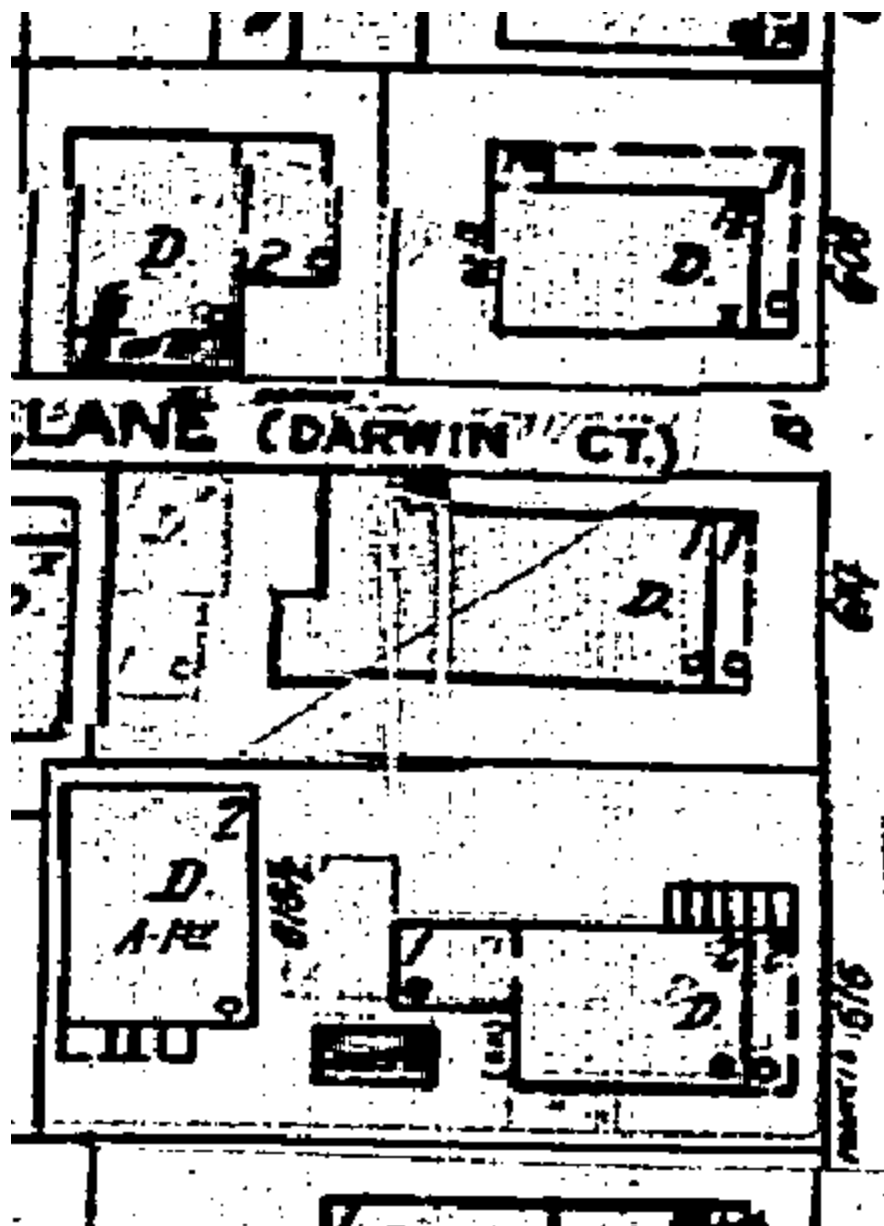


**FRANCIS**  **(FRANCES)**

1948 Sanborn Map

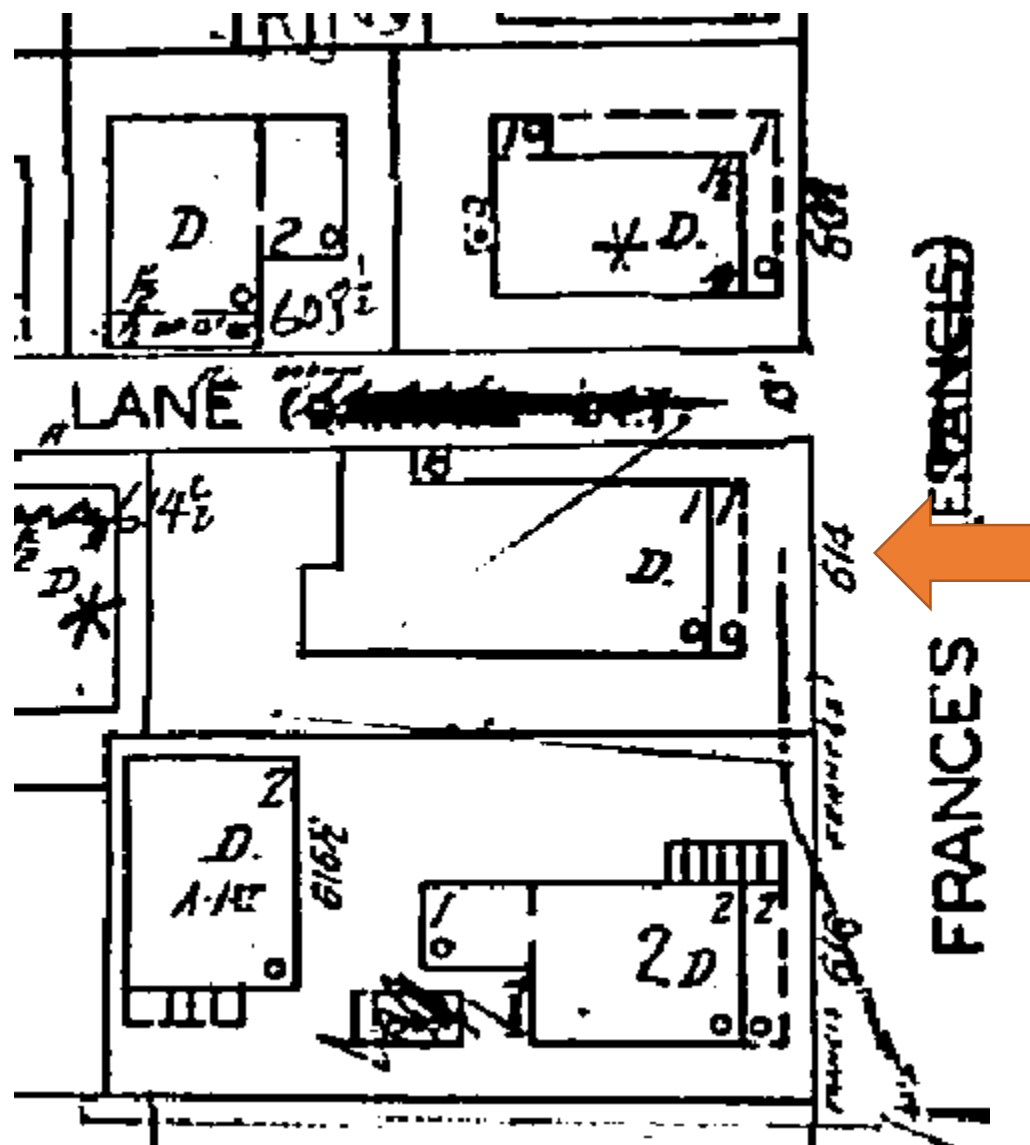

1962 Sanborn Map

# PROJECT PHOTOS

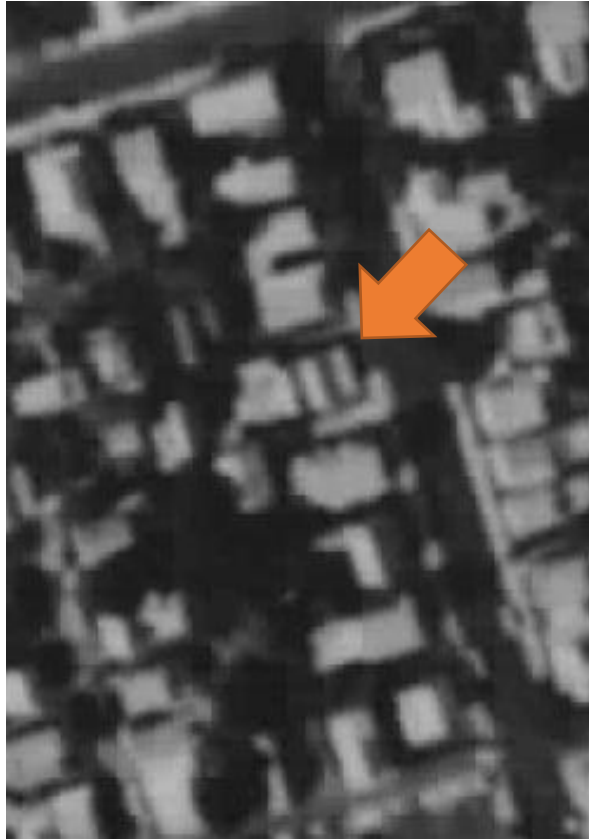

1964 Aerial Photo



1968 Aerial Photo



1972 Aerial Photo



2000 Bird's Eye Photo



Property Appraiser's Photograph, c. 1965.  
Monroe County Public Library.





Close up of concrete porch wall.



South side of house showing the two side gable roofs.  
These brick pavers will be removed.



Rear south side of house.  
The one door will be turned into two French doors, and the window will be removed.



Close up of the connection between the second sawtooth roof and rear gable roof on south side of house. Even though Sanborn maps do not show this as an addition, it looks like one.



Robert's Lane on the north side of the house.



Right/north side of the house and view of Robert's Lane.



Inappropriate clerestory windows to be removed.



Main entrance to house with a shed roof.  
The section of the building that is encroaching on Robert's Lane and will be removed.



2014/10/07 13:47



Another view of the south side of the house.  
Rear of the shed roof section that will be moved off city right-of-way.



Roof that is hip in the front and gable in the rear. The V-Crimp roof is more recent.



Rear gable roof that has the hip front.



Rear elevation of house.



Rear of house where the new pool will be located.



Shed on the right to be demolished.

# PLANNING BOARD RESOLUTION

**PLANNING BOARD  
RESOLUTION NO. 2014-64**

**A RESOLUTION OF THE CITY OF KEY WEST PLANNING BOARD GRANTING WITH CONDITIONS VARIANCES TO MAXIMUM BUILDING COVERAGE AND MINIMUM STREET SIDE AND REAR YARD SETBACKS ON PROPERTY LOCATED AT 614 FRANCES STREET (RE # 00010650-000000, AK # 1010944) IN THE HISTORIC HIGH DENSITY RESIDENTIAL (HHDR) ZONING DISTRICT PURSUANT TO SECTIONS 90-395, 122-630(4)A AND 122-630(6)C. & D. OF THE LAND DEVELOPMENT REGULATIONS OF THE CODE OF ORDINANCES OF THE CITY OF KEY WEST, FLORIDA.**

**WHEREAS**, the applicant proposes to renovate and convert a multi-family structure into a single family home on property located at 614 Frances Street (RE # 00010650-000000, AK # 1010944); and

**WHEREAS**, the existing structure is currently nonconforming to maximum building coverage and impervious surface ratio, minimum front, street side and rear yard setback requirements within the Historic High Density Residential (HHDR) Zoning District; and

**WHEREAS**, Section 122-630 of the Land Development Regulations (the "LDRs") of the Code of Ordinances (the "Code") of the City of Key West, Florida (the "City") provides that the maximum building coverage is 50%, minimum street side yard setback is five (5) feet and the rear yard setback is 20 feet; and

**WHEREAS**, the existing building coverage is 59%, street side setback is -2.3 feet (encroaching onto Cates Lane) and existing rear yard setback is 14'3"; and

**WHEREAS**, the proposed building coverage is 61%, street side setback is 0 feet and rear

yard setback is 14'3"; and

**WHEREAS**, the applicant requests variances to the maximum building coverage and minimum street side and rear yard setbacks; and

**WHEREAS**, this matter came before the Planning Board at a duly noticed public hearing on October 16, 2014; and

**WHEREAS**, the Planning Board finds that special conditions and circumstances exist which are peculiar to the land, structure, or building involved and which are not applicable to other land, structures or buildings in the same district; and

**WHEREAS**, the Planning Board finds that the special conditions do not result from the action or negligence of the applicant; and

**WHEREAS**, the Planning Board finds that granting the variances requested will not confer upon the applicant any special privileges denied by the land development regulations to other lands, buildings or structures in the same zoning district; and

**WHEREAS**, the Planning Board finds that literal interpretation of the provisions of the land development regulations would deprive the applicant of rights commonly enjoyed by other properties in this same zoning district under the terms of this ordinance and would work unnecessary and undue hardship on the applicant; and

**WHEREAS**, the Planning Board finds that the variances granted are the minimum variances that would make possible the reasonable use of the land, building or structure; and

**WHEREAS**, the Planning Board finds that the granting of the variances will be in harmony with the general intent and purpose of the land development regulations and that such variances

would not be injurious to the area involved or otherwise detrimental to the public interest or welfare;  
and

**WHEREAS**, the Planning Board finds that no nonconforming use of neighboring lands, structures, or buildings in the same district, and no permitted use of lands, structures or buildings in other districts are grounds for the issuance of the requested variance; and

**WHEREAS**, the Planning Board finds that the applicant has demonstrated a “good neighbor policy” by contacting or attempting to contact all noticed property owners who have objected to the variance application, and by addressing the objections expressed by these neighbors.

**NOW, THEREFORE, BE IT RESOLVED** by the Planning Board of the City of Key West, Florida:

**Section 1.** That the above recitals are incorporated by reference as if fully set forth herein.

**Section 2.** A variance approval by Resolution of the Key West Planning Board for maximum building coverage and minimum street side and rear yard setbacks in order to renovate and convert a multi-family structure into a single family home per the attached plans signed and sealed July 1, 2014 by Rick Milelli, Professional Engineer, on property located at 614 Frances Street (RE # 00010650-000000, AK # 1010944) in the HHDR Zoning District pursuant to Sections 90-395, 122-630(4)a. and 122-630(6)c. & d. of the City of Key West Land Development Regulations with the following conditions:

**General Conditions:**

1. The proposed development shall be consistent with the plans signed and sealed July 1, 2014 by Rick Milelli, Professional Engineer. No approval granted for any other work or improvements shown on the plans other than the addition of a side

gable roof on the rear of the existing structure, a new covered patio over existing pavers and removal of the 2.3 foot encroachment (209.07 square feet) from Roberts Lane (aka Cates Lane).

2. The applicant shall obtain a Certificate of Appropriateness for the proposed development.
3. Trees near and within the project area will be protected during construction/demolition. Trees located within the work area that may need to be removed or trimmed may require permits from the Tree Commission.

**Condition to be completed prior to the issuance of certificate of occupancy:**

4. Roof gutter downspouts shall be directed back onto property.
5. The applicant shall acknowledge in writing on forms provided by the Planning Department that the two non-transient units removed from active occupied status on this property will be held in "unassigned" status for this property, with the stipulation that they cannot be transferred until such time as the City adopts by Ordinance to allow the transfer of such units. In the interim, if the applicant wishes to re-establish the units as non-transient units on this property, they may, with appropriate building permits.

**Section 3.** It is a condition of this variance that full, complete and final application for all conditions of this approval for any use and occupancy for which this variance is wholly or partly necessary, shall be submitted in their entirety within two years after the date hereof; and further, that no application shall be made after expiration of the two-year period without the applicant obtaining an extension from the Planning Board and demonstrating that no change of circumstances to the property or its underlying zoning has occurred.

**Section 4.** The failure to fully and completely apply the conditions of approval for permits for use and occupancy pursuant to this variance in accordance with the terms of the approval as described in Section 3 hereof, shall immediately operate to terminate this variance, which variance shall be of no force or effect.

**Section 5.** This variance does not constitute a finding as to ownership or right to possession of the property, and assumes, without finding, the correctness of applicant's assertion of


legal authority respecting the property.

**Section 6.** This Resolution shall go into effect immediately upon its passage and adoption and authentication by the signatures of the presiding officer and the Clerk of the Commission.

**Section 7.** This Resolution is subject to appeal periods as provided by the City of Key West Code of Ordinances (including the Land Development Regulations). After the City appeal period has expired, this permit or development order will be rendered to the Florida Department of Economic Opportunity. Pursuant to Chapter 73C-44, F.A.C., this permit or development order is not effective for forty five (45) days after it has been properly rendered to the DEO with all exhibits and applications attached to or incorporated by reference in this approval; that within the forty five (45) day review period, the DEO can appeal the permit or development order to the Florida Land and Water Adjudicatory Commission; and that such an appeal stays the effectiveness of the permit until the appeal is resolved by agreement or order.

Read and passed on first reading at a regularly scheduled meeting held this 16th day of October 2014.

Authenticated by the Vice-Chairman of the Planning Board and the Planning Director;

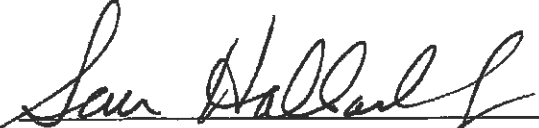  
\_\_\_\_\_  
Sam Holland, Jr., Planning Board Vice-Chairman


10.22.14  
\_\_\_\_\_  
Date



 Vice-Chairman  
 Planning Director

Attest:

 10/23/14  
Donald Leland Craig, AICP, Planning Director Date


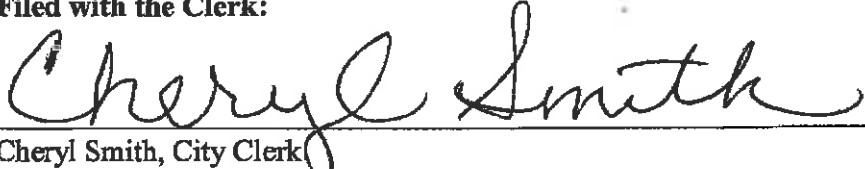
Filed with the Clerk:

 10-23-14  
Cheryl Smith, City Clerk Date

 Vice-Chairman  
 Planning Director

# SURVEY

# Boundary Survey Map of part of Lot 2, Square 56 Island of Key West, Florida

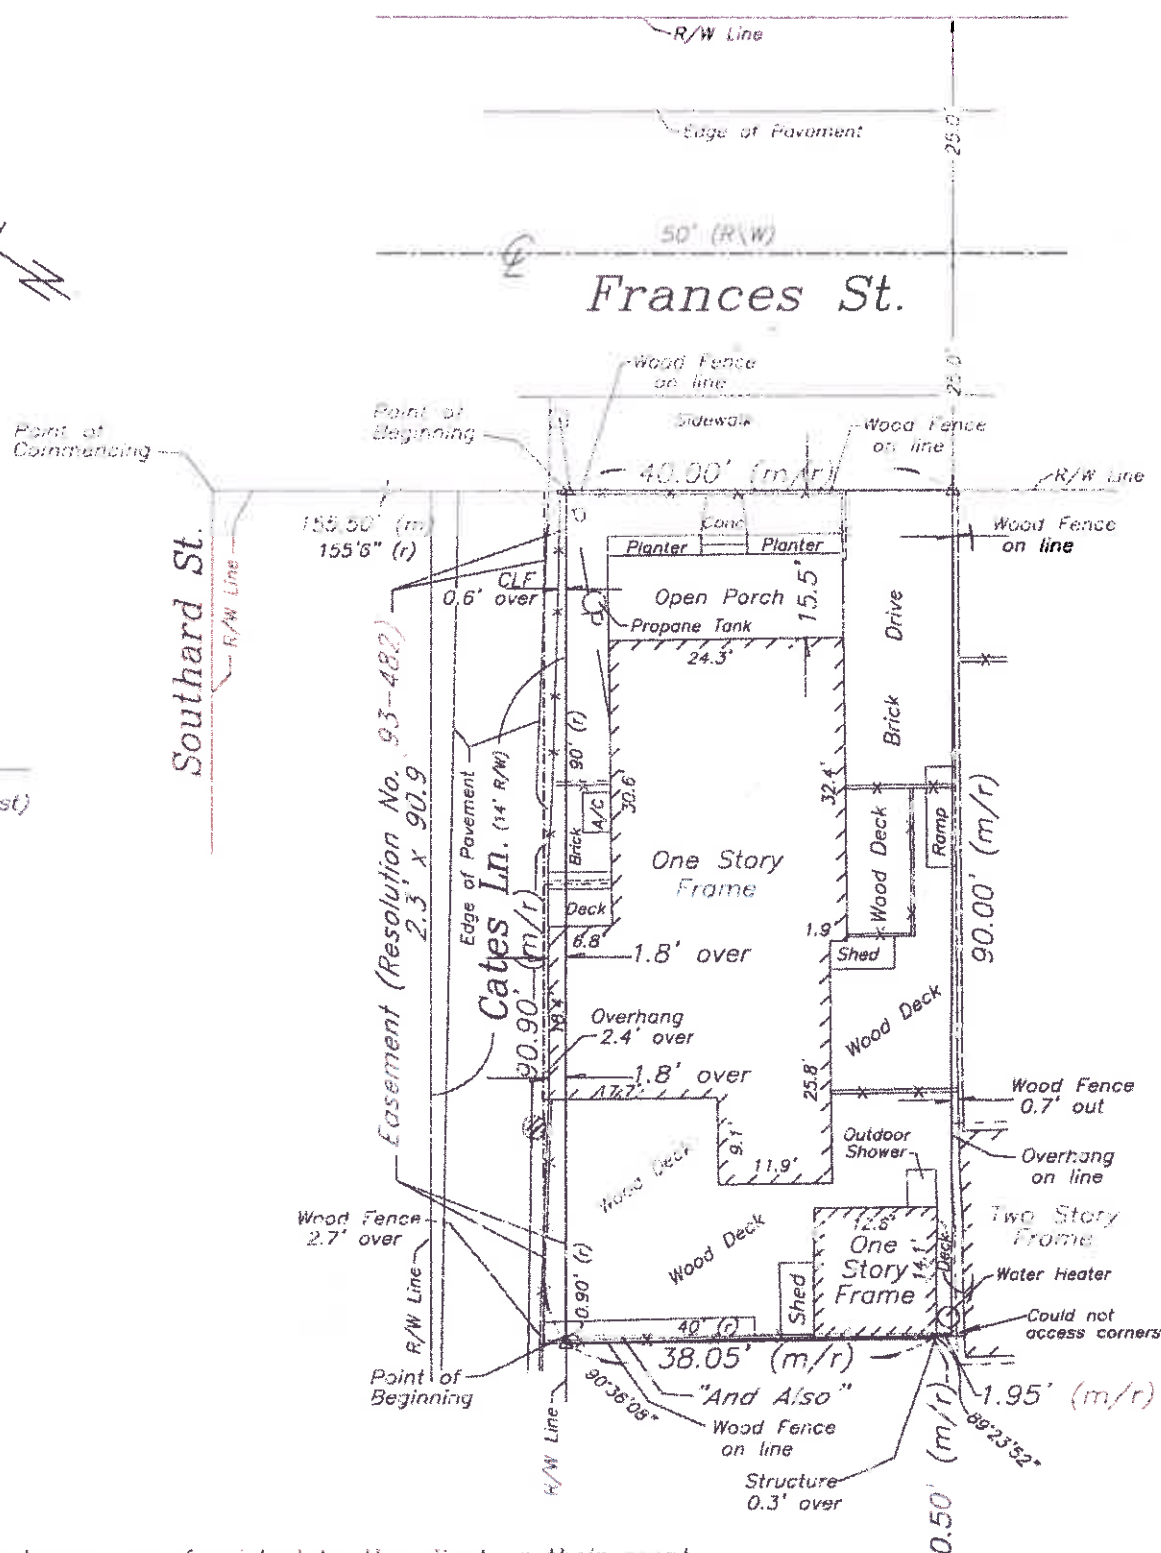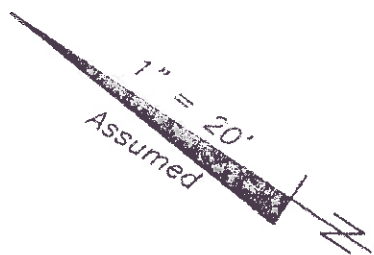

## LEGEND

- ⊙ Found 2" Iron Pipe (Fence Post)
- Set #5 rebar w/cap (6298)
- Found 1/2" Iron Rod (2863)
- ▲ Found Nail & Disc (PTS)
- △ Set Nail & Disc (6298)
- (M) Measured
- (R) Record
- (M/R) Measured & Record
- C.B.S. Concrete Block Structure
- R/W Right of Way
- CLF Chain Link Fence
- ⊕ Centerline
- ⊗ Wood Utility Pole
- ⊠ Concrete Utility Pole
- P- Overhead Power Lines

## NOTES:

1. The legal description shown hereon was furnished by the client or their agent.
2. Underground foundations and utilities were not located.
3. All angles are 90° (Measured & Record) unless otherwise noted.
4. Street address: 614 Frances Street, Key West, FL.
5. This survey is not valid without the signature and the original raised seal of a Florida licensed surveyor and mapper.
6. Lands shown hereon were not abstracted for rights-of-way, easements, ownership, or other instruments of record.
7. North Arrow is assumed and based on the legal description.
8. Adjoiners are not furnished.
9. Date of field work: August 21, 2013.
10. Ownership of fences is undeterminable, unless otherwise noted.

**BOUNDARY SURVEY OF:** On the Island of Key West, and known on the map or plan of said Island delineated by W.A. Whitehead in February, A.D. 1829, as a part of Lots Two (2) and Three (3) in Square Fifty-six (56). Commencing at a point distant from the corner of Southard and Frances Streets One Hundred and Fifty-five (155) feet and Six (6) inches, and running thence along Frances Street in a SE'y direction Forty (40) feet; thence at right angles in a SW'y direction Ninety (90) feet; thence at right angles in a NW'y direction Forty (40) feet; thence at right angles in a NE'y direction Ninety (90) feet to the place of beginning.

## AND ALSO

On the Island of Key West, Monroe County, Florida, and known on the map of said Island delineated by W.A. Whitehead in February, 1829 as part of Lots 2 and 3, Square 56, and being more particularly described by the following metes and bounds description: **COMMENCE** at the intersection of the SE'y right-of-way line (ROWL) of Southard Street and the SW'y ROWL of Frances Street; thence run SE'y along said SW'y ROWL 155.5 feet; thence run SW'y at right angles 90.0 feet to the Point of Beginning; thence continue SW'y along the previously described course 0.9 feet to an existing wood fence; thence run SE'y along a line deflected 90 degrees 36' 08" to the left, 38.05 feet; thence run NE'y along a line deflected 90 degrees 23' 52" to the left 0.5 feet; thence run NW'y and at right angles 38.05 feet to the Point of Beginning.

**BOUNDARY SURVEY FOR:** Elizabeth Ann Ross;  
Capital Bank, N.A.;  
Stones & Cardenas;  
Chicago Title Insurance Company;

J. LYNN O'FLYNN, INC.

J. Lynn O'Flynn, PSM  
Florida Reg. #6298

August 22, 2013

THIS SURVEY  
IS NOT  
ASSIGNABLE

J. LYNN O'FLYNN, Inc.



Professional Surveyor & Mapper  
PSM #6298

3430 Duck Ave., Key West, FL 33040  
(305) 296-7422 FAX (305) 296-2244

# PROPOSED DESIGN

# RESIDENTIAL RENOVATION

614 FRANCES STREET  
KEY WEST, FLORIDA 33040

## SITE DATA

SITE ADDRESS: 614 FRANCES ST. KEY WEST, FL 33040  
RE: 00010650-000000  
ZONING: HHDR (HISTORIC HIGH DENSITY RESIDENTIAL)  
FLOOD ZONE: X  
F.I.R.M.- COMMUNITY#12087C; MAP & PANEL #1516 SUFFIX K; DATE:02-18-05  
SECTION/TOWNSHIP/RANGE: 6-68-25  
LEGAL DESCRIPTION: KW PT LOT 2 SQR 56 G22-335/38  
SETBACKS: FRONT 10 FT; SIDE 5 FT; REAR 20 FT; STREET SIDE 5 FT  
OCCUPANCY: R-3 RESIDENTIAL SINGLE FAMILY  
TYPE OF CONSTRUCTION: VB

## DESIGN DATA

THE WORK DEPICTED HEREIN WAS DESIGNED TO MEET THE REQUIREMENTS OF THE 2010 FLORIDA BUILDING CODE AND THE LATEST EDITIONS OF THE FLORIDA MODEL ENERGY CODE, FIRE CODE, LIFE SAFETY CODE AND THE NATIONAL ELECTRIC CODE.  
THE FOLLOWING LOADINGS WERE USED:  
DESIGN LOADS: ASCE 7-10  
WIND LOAD: 180 mph; 3 sec gust; EXPOSURE C; ROOF LIVE LOAD 20 PSF; DEAD LOAD 15 PSF; FLOOR LL 40 PSF  
SOIL BEARING CAPACITY ASSUMED 2000LBS PER SQ.FT.

## INDEX OF DRAWINGS


SHEET CS-1 - COVER, SITE PLAN, PROJECT DATA AND LOCATION MAP  
SHEET A-1 - EXISTING ELEVATIONS AND DEMO PLAN  
SHEET A-2 - PROPOSED ELEVATIONS AND DOOR AND WINDOW SCHEDULE  
SHEET A-3 - FLOOR PLAN, ROOF FRAMING PLAN, FOUNDATION PLAN, SECTIONS AND NOTES  
SHEET MEP-1 - ELECTRICAL/ MECHANICAL AND PLUMBING PLAN

## GENERAL NOTES


- THESE PLANS ARE FOR THE CONSTRUCTION AT THE LOCATION SO DESIGNATED HEREIN.
- THE CONTRACTOR SHALL PROVIDE ALL MATERIAL, LABOR, EQUIPMENT AND SUPERVISION NECESSARY TO PROVIDE THE WORK COMPLETE AND READY FOR USE.
- THERE SHALL BE NO DEVIATION FROM THESE PLANS WITHOUT PRIOR APPROVAL FROM THE ENGINEER OF RECORD.
- THE CONTRACTOR SHALL VISIT THE SITE AND BECOME FAMILIAR WITH EXISTING CONDITIONS BEFORE BID. CHECK AND VERIFY ALL DIMENSIONS AND CONDITIONS OF THE WORK SITE AND REPORT ANY DISCREPANCIES, DIFFERENCES OR CONDITIONS THAT ARE UNSATISFACTORY OR UNSAFE.
- NOTIFY THE ENGINEER OF RECORD IMMEDIATELY OF ANY DISCREPANCIES, DIFFERENCES, UNSATISFACTORY OR UNSAFE CONDITIONS. ANY MODIFICATIONS OR CHANGES MADE WITHOUT PRIOR WRITTEN APPROVAL FROM THE OWNER AND ENGINEER OF RECORD SHALL NOT BE ALLOWED. ANY REWORK, RESTORATION OR OTHER IMPACT AS A RESULT OF NOT OBTAINING SUCH PRIOR APPROVAL WILL BE MADE BY THE CONTRACTOR WITHOUT ADDITIONAL COST OR COMPENSATION FROM THE OWNER.
- THE CONTRACTOR SHALL PROVIDE FOR THE SAFETY, PREVENTION OF INJURY OR OTHER LOSS AT THE JOB TO ALL PERSONS EMPLOYED IN THE WORK, PERSONS VISITING THE WORK AND THE GENERAL PUBLIC. THE CONTRACTOR SHALL ALSO BE RESPONSIBLE FOR THE PREVENTION OF DAMAGE, DUE TO THE WORK, TO MATERIALS OR EQUIPMENT AND OTHER PROPERTY AT THE SITE OR ADJACENT THERETO.
- NO RESEARCH AS TO THE PRESENCE OF UNDERGROUND UTILITIES HAS BEEN INCLUDED ON OR PERFORMED FOR THIS PROJECT. CONTRACTOR SHALL BE RESPONSIBLE FOR CALLING SUNSHINE UTILITY LOCATE SERVICE PRIOR TO ANY CONSTRUCTION WITHIN ANY PUBLIC RIGHT-OF-WAY OR OTHER AREAS WHERE UNDERGROUND UTILITIES MAY BE PRESENT (I.E. IN AND AROUND UTILITY EASEMENTS, ETC.)
- THE GENERAL CONTRACTOR SHALL PROVIDE AN ON-SITE DUMPSTER IN A LOCATION COORDINATED WITH THE OWNER FOR THE DISPOSAL OF REMOVED MATERIAL AND CONSTRUCTION DEBRIS. THE DUMPSTER SHALL BE EMPTIED AT APPROPRIATE INTERVALS TO PREVENT OVERFLOW AND UNSIGHTLY CONDITIONS.
- THE CONTRACTOR SHALL PERFORM ALL WORK IN STRICT CONFORMANCE WITH THE PLANS, 2010 FLORIDA BUILDING CODE, LOCAL CODES AND ORDINANCES, MANUFACTURER RECOMMENDATIONS AND ACCEPTABLE TRADE PRACTICES. ANY CONFLICT BETWEEN THESE REQUIREMENTS AND THE MOST STRINGENT REQUIREMENTS SHALL GOVERN THE WORK.
- SHOP DRAWINGS OF ALL PREFABRICATED STRUCTURAL FLOOR AND ROOF SYSTEMS AND MECHANICAL SYSTEMS SHALL BEAR THE SEAL OF A FLORIDA PROFESSIONAL ENGINEER AS REQUIRED BY THE 2010 FLORIDA BUILDING CODE AND SHALL BE SUBMITTED TO THE ENGINEER OF RECORD BY THE CONTRACTOR FOR APPROVAL PRIOR TO FABRICATION AND INSTALLATION.
- THE CONTRACTOR SHALL NOT SCALE DRAWINGS. ANY INFORMATION THAT THE CONTRACTOR CANNOT OBTAIN FROM DIMENSIONS, DETAIL OR SCHEDULE SHALL BE OBTAINED FROM THE ENGINEER OF RECORD.
- THE CONTRACTOR SHALL COORDINATE THE WORK OF ALL TRADES TO PREVENT ANY CONFLICTS.
- THE CONTRACTOR SHALL FURNISH ALL SUBCONTRACTORS WITH A COMPLETE SET OF PLANS. ALL CHANGES SHALL BE NOTED ON THE DRAWINGS AND (2) COMPLETE AS-BUILT SETS SHALL BE DELIVERED TO THE OWNER AFTER COMPLETION OF WORK.
- THESE PLANS, AS DRAWN AND NOTED, COMPLY WITH THE BUILDING ENVELOPE ENERGY REQUIREMENTS OF THE FLORIDA MODEL ENERGY CODE. THE CONTRACTOR SHALL FAMILIARIZE HIMSELF WITH THE GOVERNING CODE IN ITS ENTIRETY AND BUILD IN ACCORDANCE WITH ALL PROVISIONS OF THIS CODE.
- PORTABLE RESTROOM FACILITIES TO BE PROVIDED AT THE SITE BY THE CONTRACTOR.
- ALL STORM WATER SHALL BE RETAINED ON THE PROPERTY.

## LEGEND

### SYMBOLS



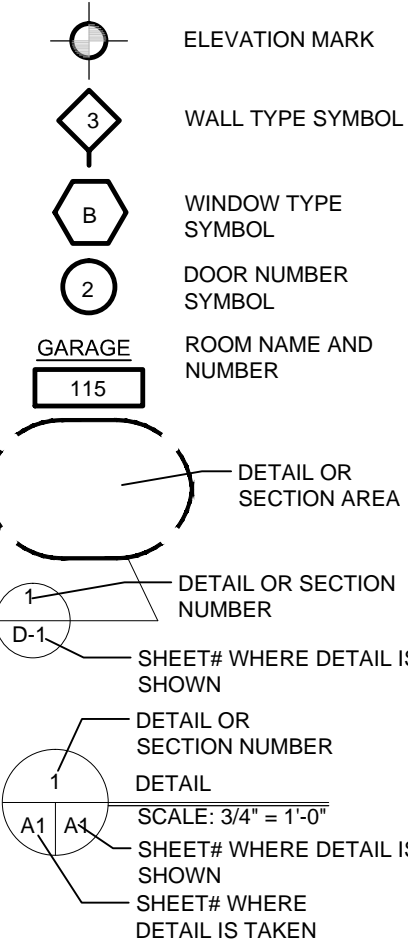


### MATERIAL INDICATIONS

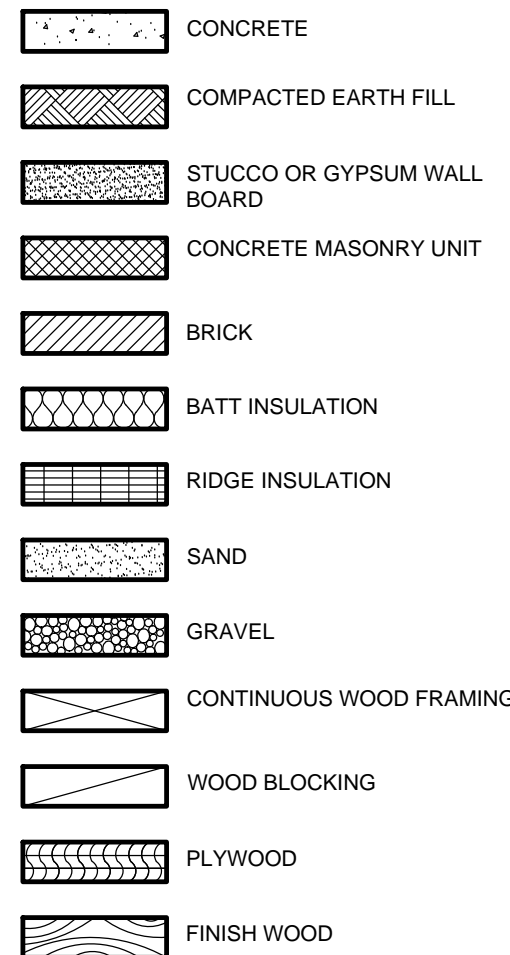

### LIST OF ABBREVIATIONS

& AND  
# AT  
APPROX. APPROXIMATE(LY)  
FT. FOOT/FEET  
FFL FINISH FLOOR LEVEL  
IN. INCH  
MAX. MAXIMUM  
MIN. MINIMUM  
# NUMBER  
O.C. ON CENTER  
LB. POUND  
PSI POUND PER SQUARE INCH  
PT PRESSURE TREATED  
SF SQUARE FOOT/FEET  
T & G TONGUE AND GROOVE  
WWM WELDED WIRE MESH

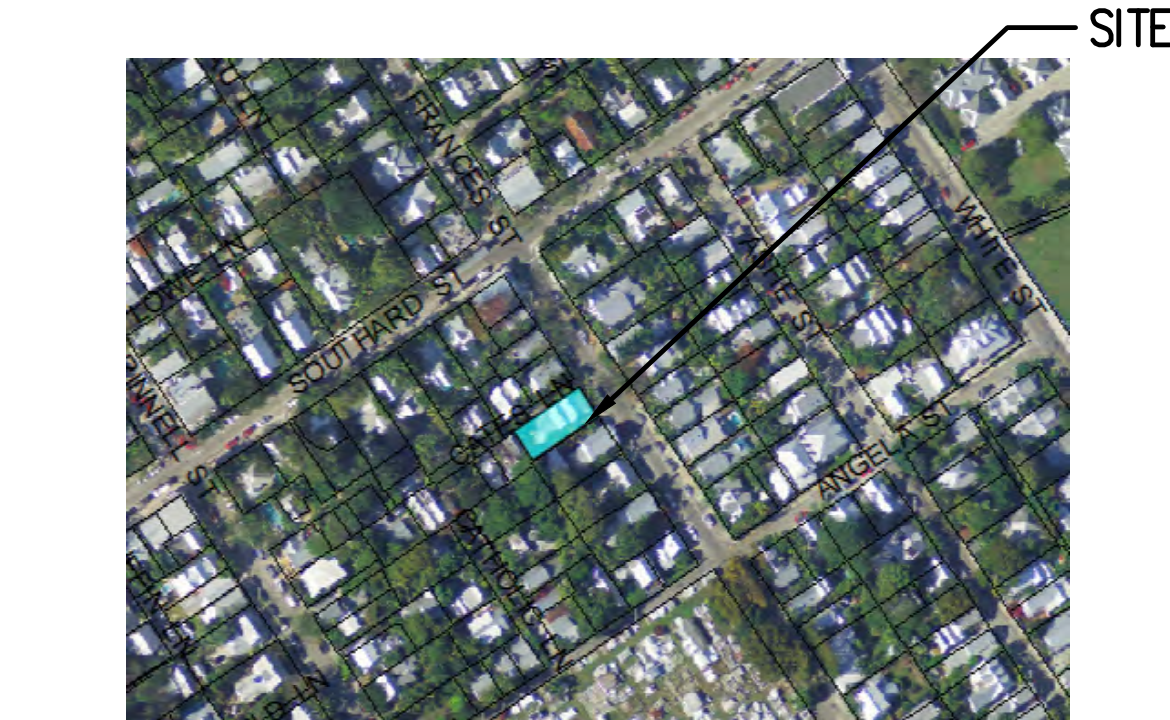

LOCATION MAP

SCALE: NOT TO SCALE

## PROJECT DATA


	PROPOSED	EXISTING	REQUIRED	VARIANCE REQUESTED
RE NO.	00010650-000000			
SETBACKS:				
FRONT	NO CHANGE	6'-7"	10'-0"	NONE
STREET SIDE	0'-0"	1'-11"	5'-0"	YES
SIDE	NO CHANGE	6'-0"	5'-0"	NONE
REAR	SAME	14'-3"	20'-0"	YES
LOT SIZE	NO CHANGE	3,561 SQ. FT.	4000 SQ.FT.	NONE
BUILDING COVERAGE	2,199 SQ. FT. 61%	2,100 SQ. FT. 59%	50% MAX	YES
FLOOR AREA	NO CHANGE	N/A	1,740 SQ. FT. 0.48	NONE
BUILDING HEIGHT	NO CHANGE	16.8'	30' MAX	NONE
IMPERVIOUS AREA	NO CHANGE	N/A	2,360 SQ. FT. 66%	NONE

NOTE: IMPERVIOUS AREA WILL HAVE A SLIGHT REDUCTION FROM THE REMOVAL OF EXISTING PAVERS TO OFFSET THE INCREASE FROM THE PROPOSED POOL. THE AREA WHERE PAVERS ARE BEING REMOVED IS NOTED ON THE SITE PLAN.


## SITE NOTES

- REMOVE EXISTING TOPSOIL AND ORGANIC MATERIAL WITHIN THE BUILDING AREA. STRUCTURAL FILL SHALL BE SELECT STRUCTURAL FILL AND SHALL BE COMPACTED TO 98% STANDARD PROCTOR DENSITY. SITE FILL SHALL BE CLEAN SAND OR CRUSHED LIMESTONE (LESS THAN 3"). GRADE AS SHOWN AND/OR TO DRAIN AWAY FROM THE PROPOSED BUILDING.
- TREES REQUIRED TO BE REMOVED SHALL BE CUT AND THE STUMP AND ROOT SYSTEM SHALL BE REMOVED COMPLETELY. THE HOLES SHALL BE FILLED COMPACTED AND LEVELED. CARE SHALL BE TAKEN TO AVOID DAMAGE TO ADJACENT TREES AND OTHER FEATURES. PROVIDE CONSTRUCTION BARRIERS FOR TREES TO REMAIN.
- THE CONTRACTOR SHALL REMOVE ALL DEBRIS FROM THE SITE DAILY.
- THE CONTRACTOR SHALL REMOVE ALL ITEMS INDICATED AND ALL OTHER ITEMS REQUIRED FOR THE INSTALLATION OF NEW WORK. FINISH SURFACES SHALL BE REPAIRED TO MATCH ADJACENT SURFACES. ALL WORK SHALL BE DONE IN A WORKMANLIKE MANNER.

FRANCES ST.

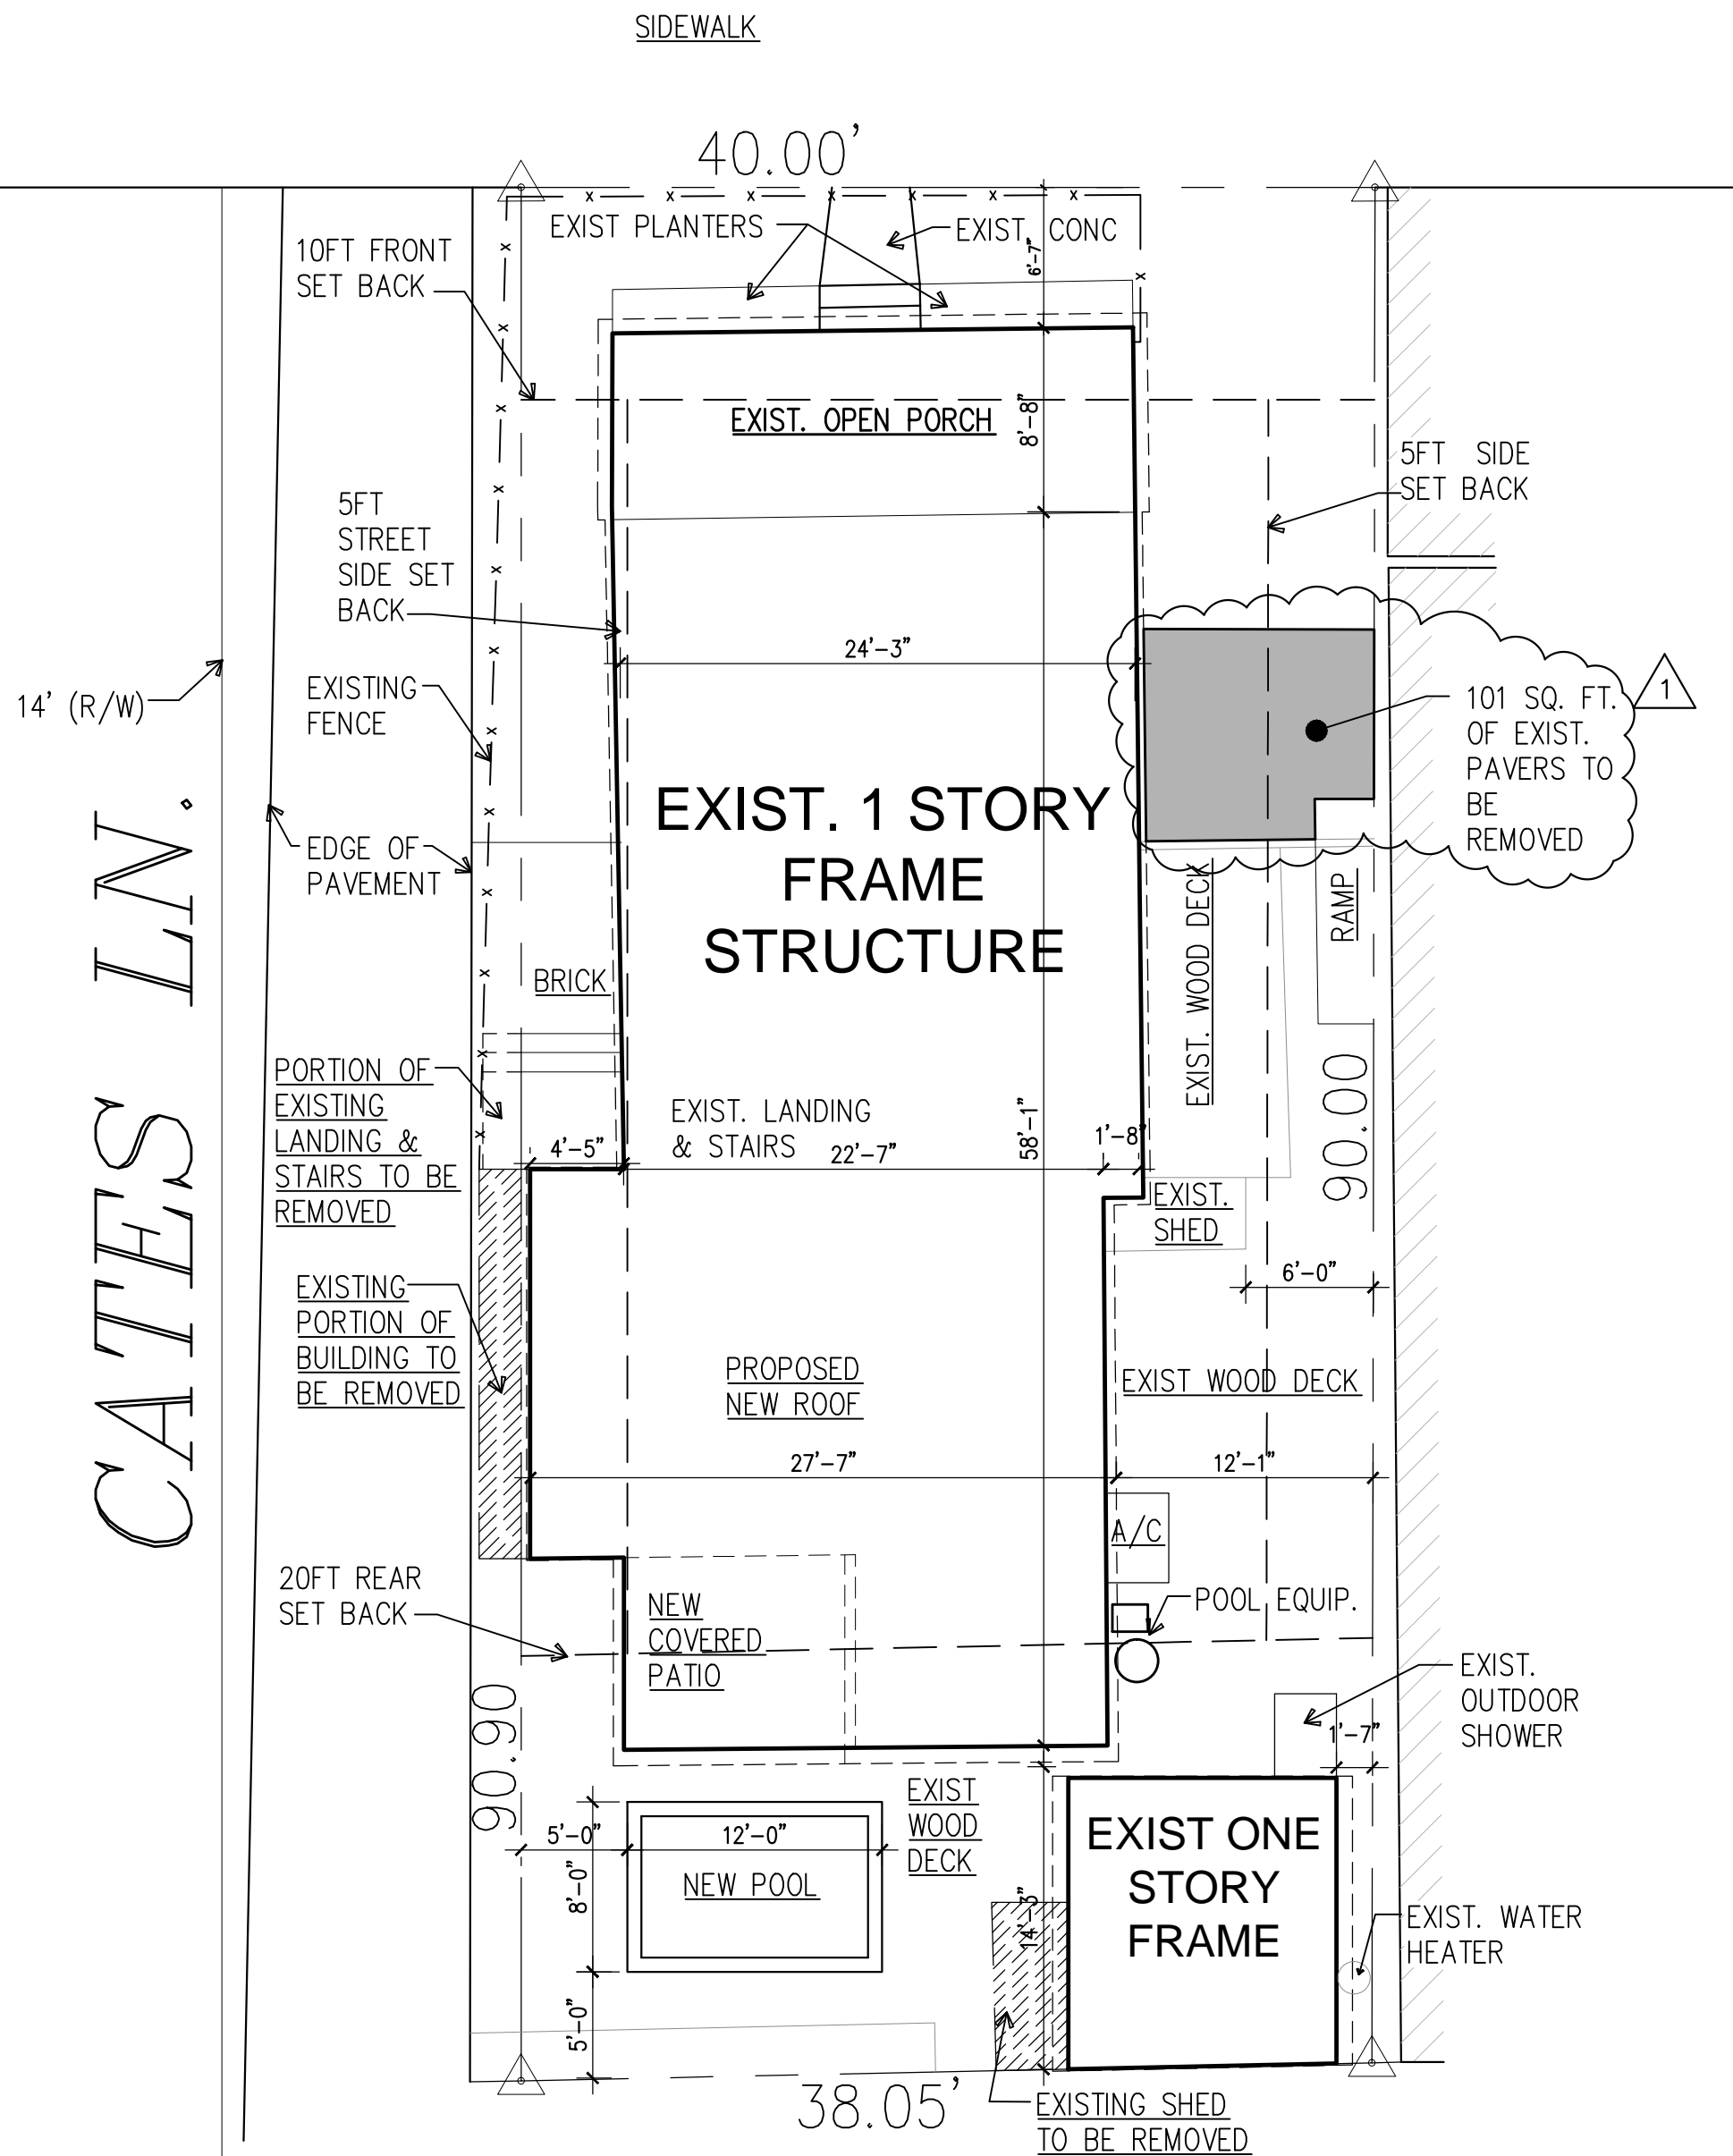


LOT SIZE: 3561 SQ. FT.  
IMPERVIOUS COVERAGE 2360 SQ. FT. EXISTING (66%) MAX (60%)  
BUILDING COVERAGE 2100 SQ. FT. EXISTING (59%) MAX (50%)  
FLOOR AREA 1473 SQ. FT.



PROPOSED SITE PLAN

SCALE: 1" = 10'-0"



Meridian Engineering LLC  
201 Front Street, Suite 210  
Key West, Florida 33040  
AUTHORIZATION #29401  
PH: 305-293-5283 FAX: 305-4899

Seal:

NOT VALID FOR CONSTRUCTION UNLESS  
SIGNED AND SEALED IN THIS BLOCK  
RICHARD J. MILELLI  
PE #58315

General Notes:

RESIDENTIAL RENOVATION  
HARC SUBMITTAL

Drawn By: JMT  
Checked By: RJM  
Project No.:  
Scale:

AutoCad File No.

Revisions:  
1. REVISIONS FOR RE-SUBMITTAL TO PHASE 11-12-14

Title:

COVER SHEET  
SITE PLAN AND  
PROJECT DATA

Sheet Number:


CS-1

Date: NOVEMBER 3, 2014







4 PROPOSED FRONT ELEVATION  
A-2 SCALE: 1/4"= 1'-0"

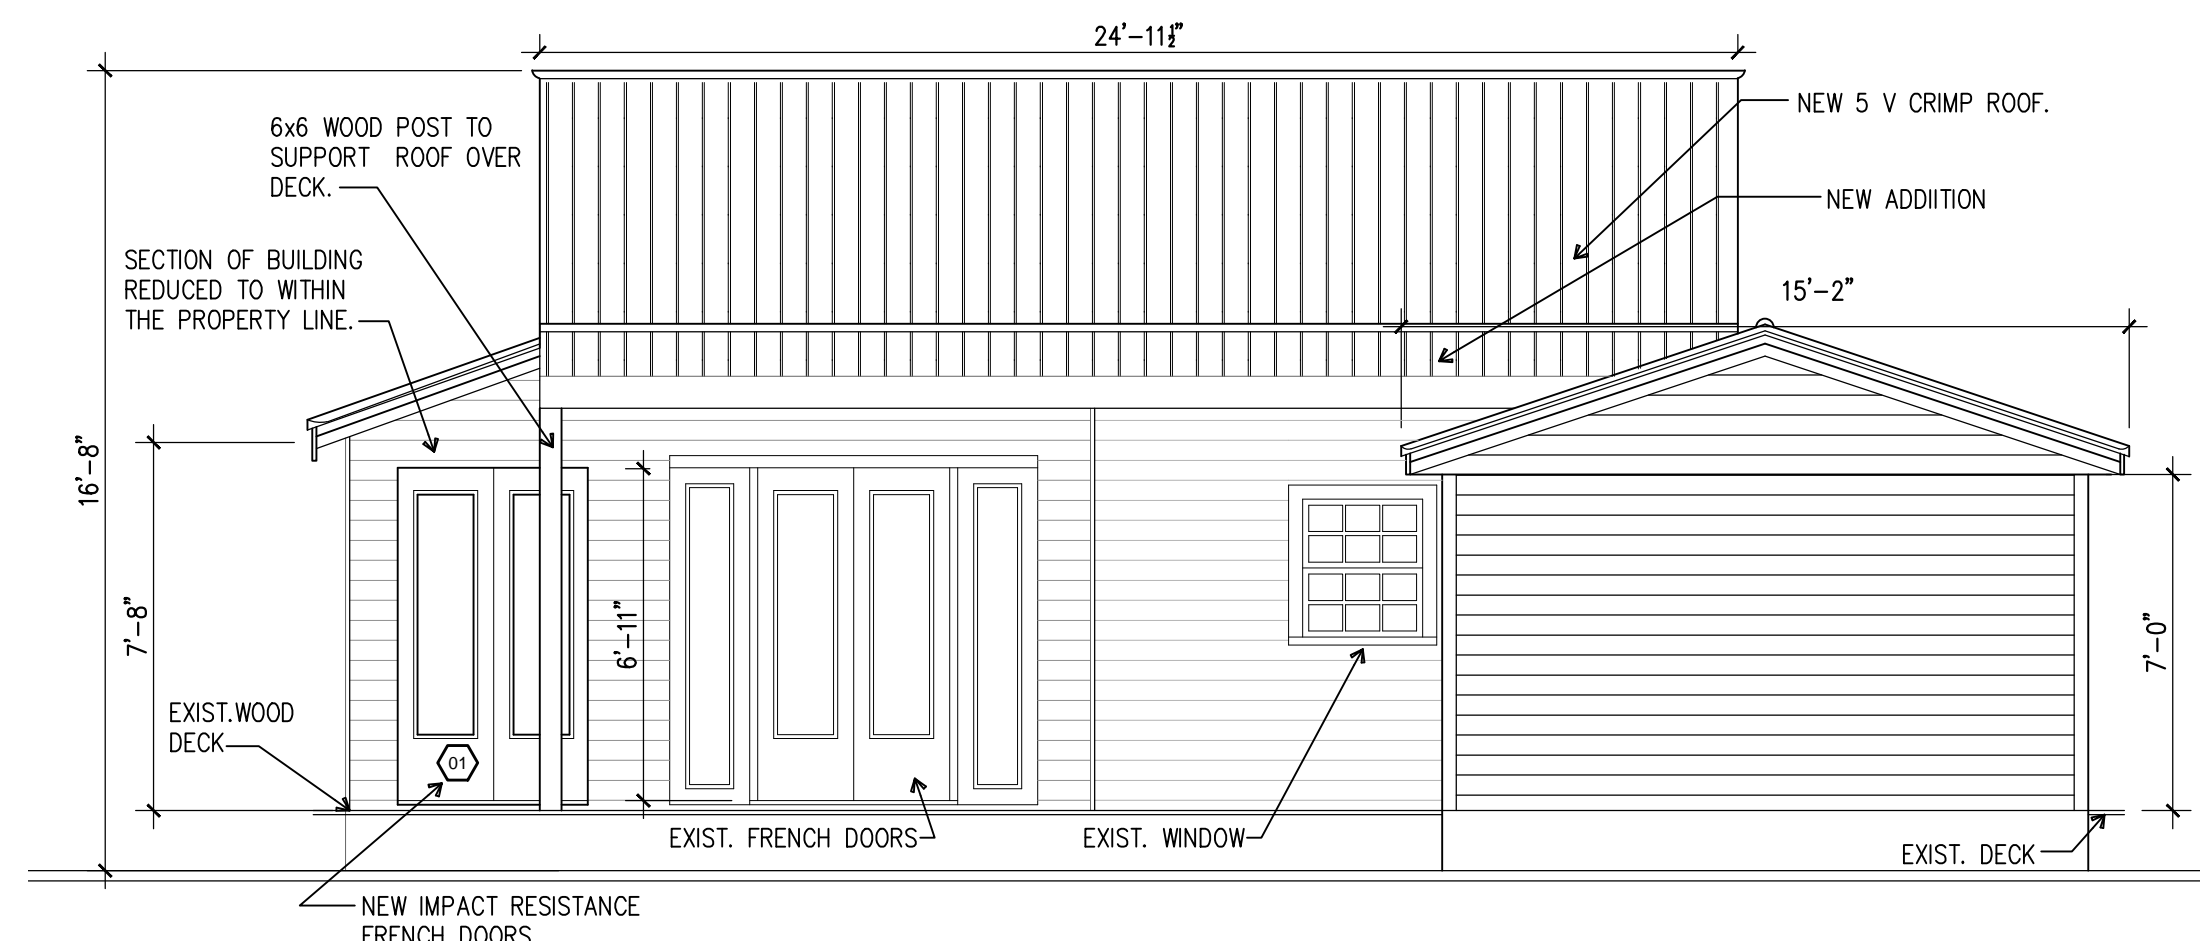

3 PROPOSED REAR ELEVATION  
A-2 SCALE: 1/4"= 1'-0"

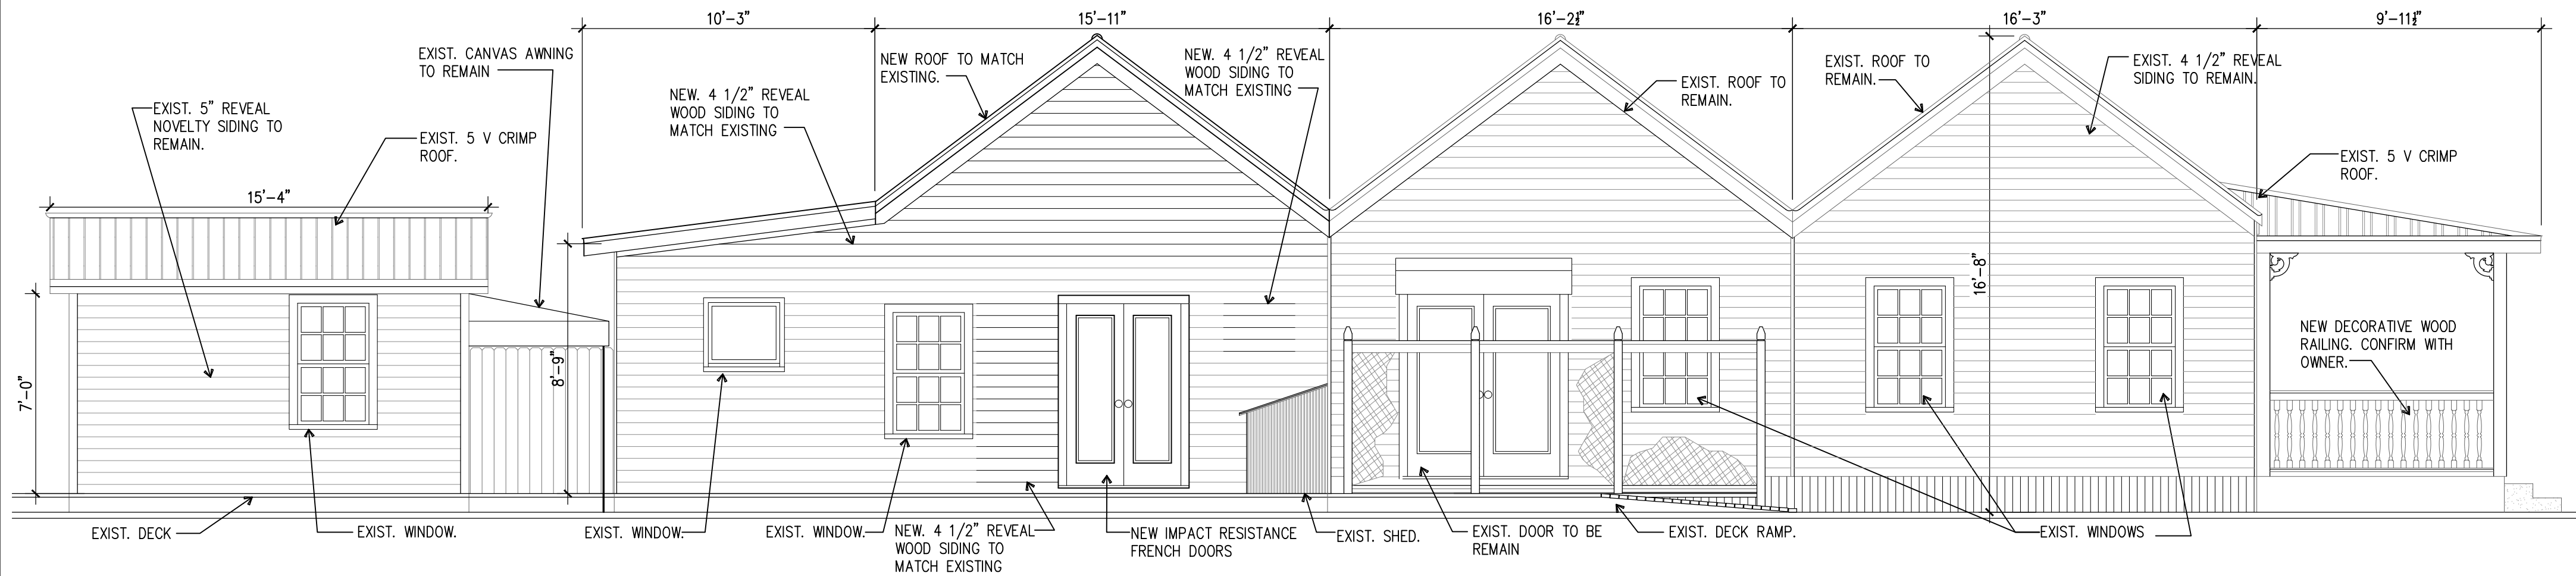


2 PROPOSED (SOUTH) SIDE ELEVATION  
A-2 SCALE: 1/4"= 1'-0"

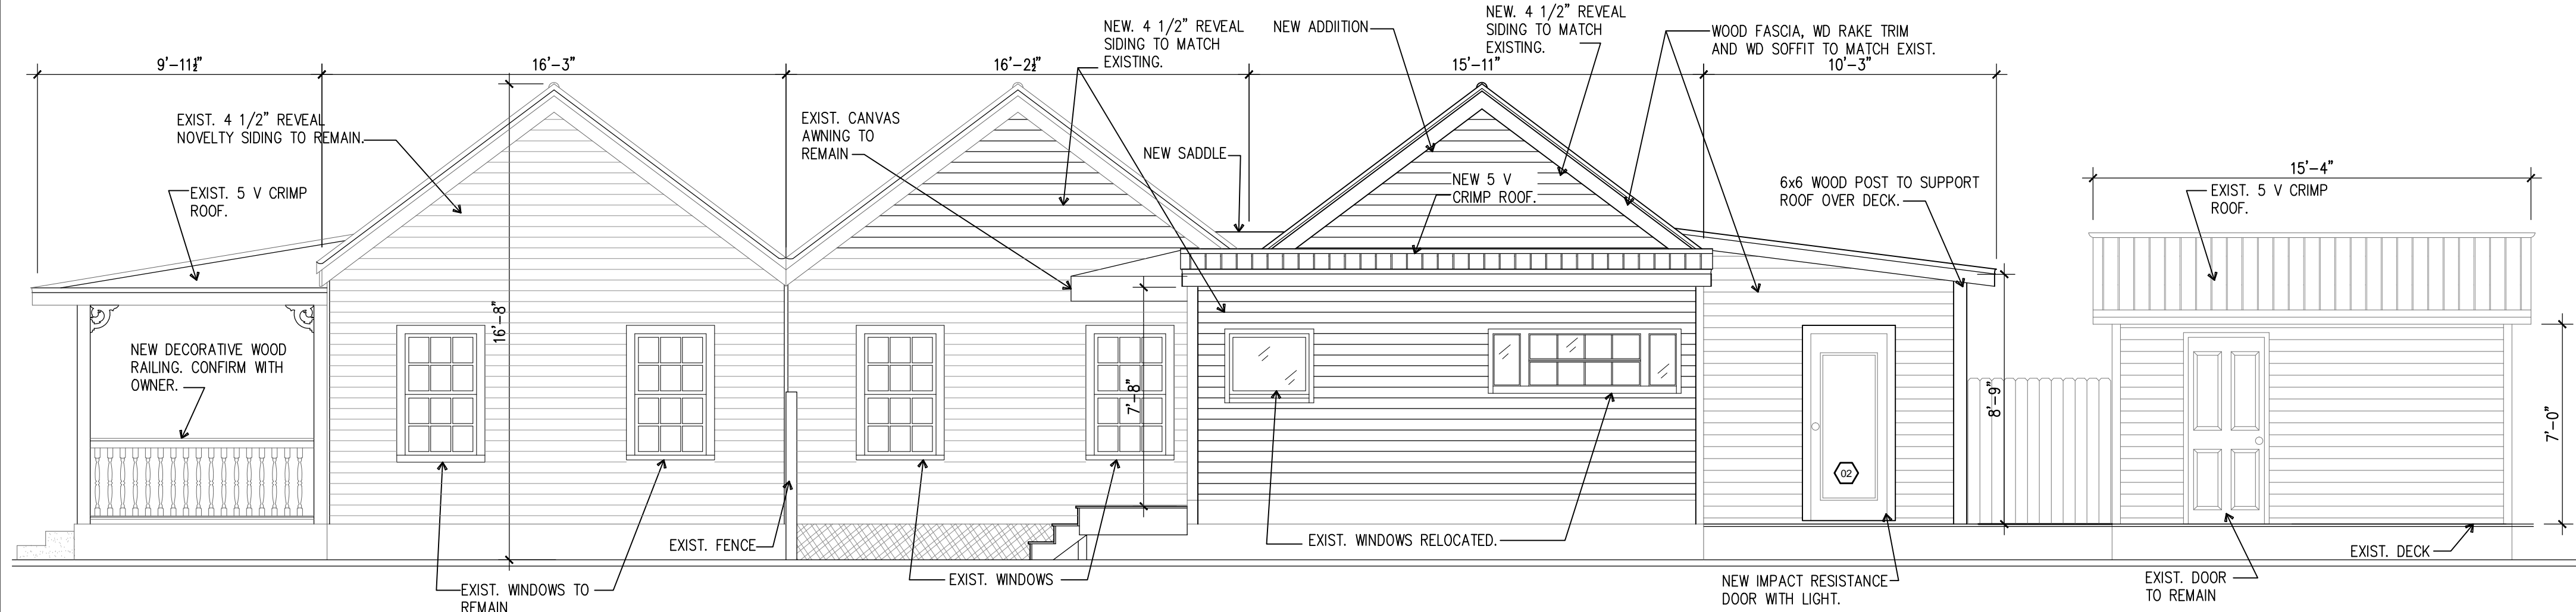


1 PROPOSED (NORTH) SIDE ELEVATION  
A-2 SCALE: 1/4"= 1'-0"

- ELEVATION NOTES
1. TYPICAL SIDING ON ADDITION SHALL BE CEMENT FIBER SIDING w/ 5" EXPOSURE. MATCH EXISTING.
  2. ALL OUTSIDE CORNERS TO MATCH EXISTING.
  3. ALL WINDOW TRIM BOARDS TO MATCH EXISTING.
  4. CARPENTER CONTRACTOR TO PROVIDE ACCESSORIES, TRIM, WINDOW HEAD FLASHING, AND WINDOW TRIM AS REQUIRED.
  5. ALL GUTTERS AND DOWNSPOUTS SHALL BE PREFINISHED ALUMINUM, TO BE LOCATED IN FIELD. MATCH EXISTING
  6. THE TYPE OF ROOF VENTS AND INSTALLATION SHALL BE DONE PER LOCAL MONROE COUNTY BUILDING CODE AND THE 2010 FLORIDA BUILDING CODE.
  7. FLASH ALL ROOF TO WALL CONDITIONS. HORIZONTAL FLASHING SUPPLIED BY CARPENTER CONTRACTOR.
  8. ROOFER TO SUPPLY ALL REQUIRED ROOF FLASHING.
  9. ALL 2" FLASHING BY CARPENTER CONTRACTOR.
  10. ALL TRIM PROVIDED BY CARPENTER AND INSTALLED BY CARPENTER.
  11. ALL EXTERIOR TRIM BOARDS SHALL MATCH EXISTING.
  12. TYPICAL ROOF OVERHANGS FOR EAVE AND RAKE SHALL MATCH EXISTING UNLESS NOTED ON ELEVATIONS.
  13. CAULK ALL OPENINGS AND ALL DISSIMILAR MATERIALS. SEE SPECIFICATIONS.
  14. FLASH AND CAULK ALL DOOR AND WINDOW HEADS BY CARPENTER.
  15. ALL SOFFITS TO MATCH EXISTING.
  16. RAKES SHALL MATCH EXISTING.
  17. FASCIAS SHALL MATCH EXISTING.
  18. ALL WINDOWS SILLS SHALL MATCH EXISTING.
  19. SILLS AT EXTERIOR DOORS TO MATCH EXISTING.

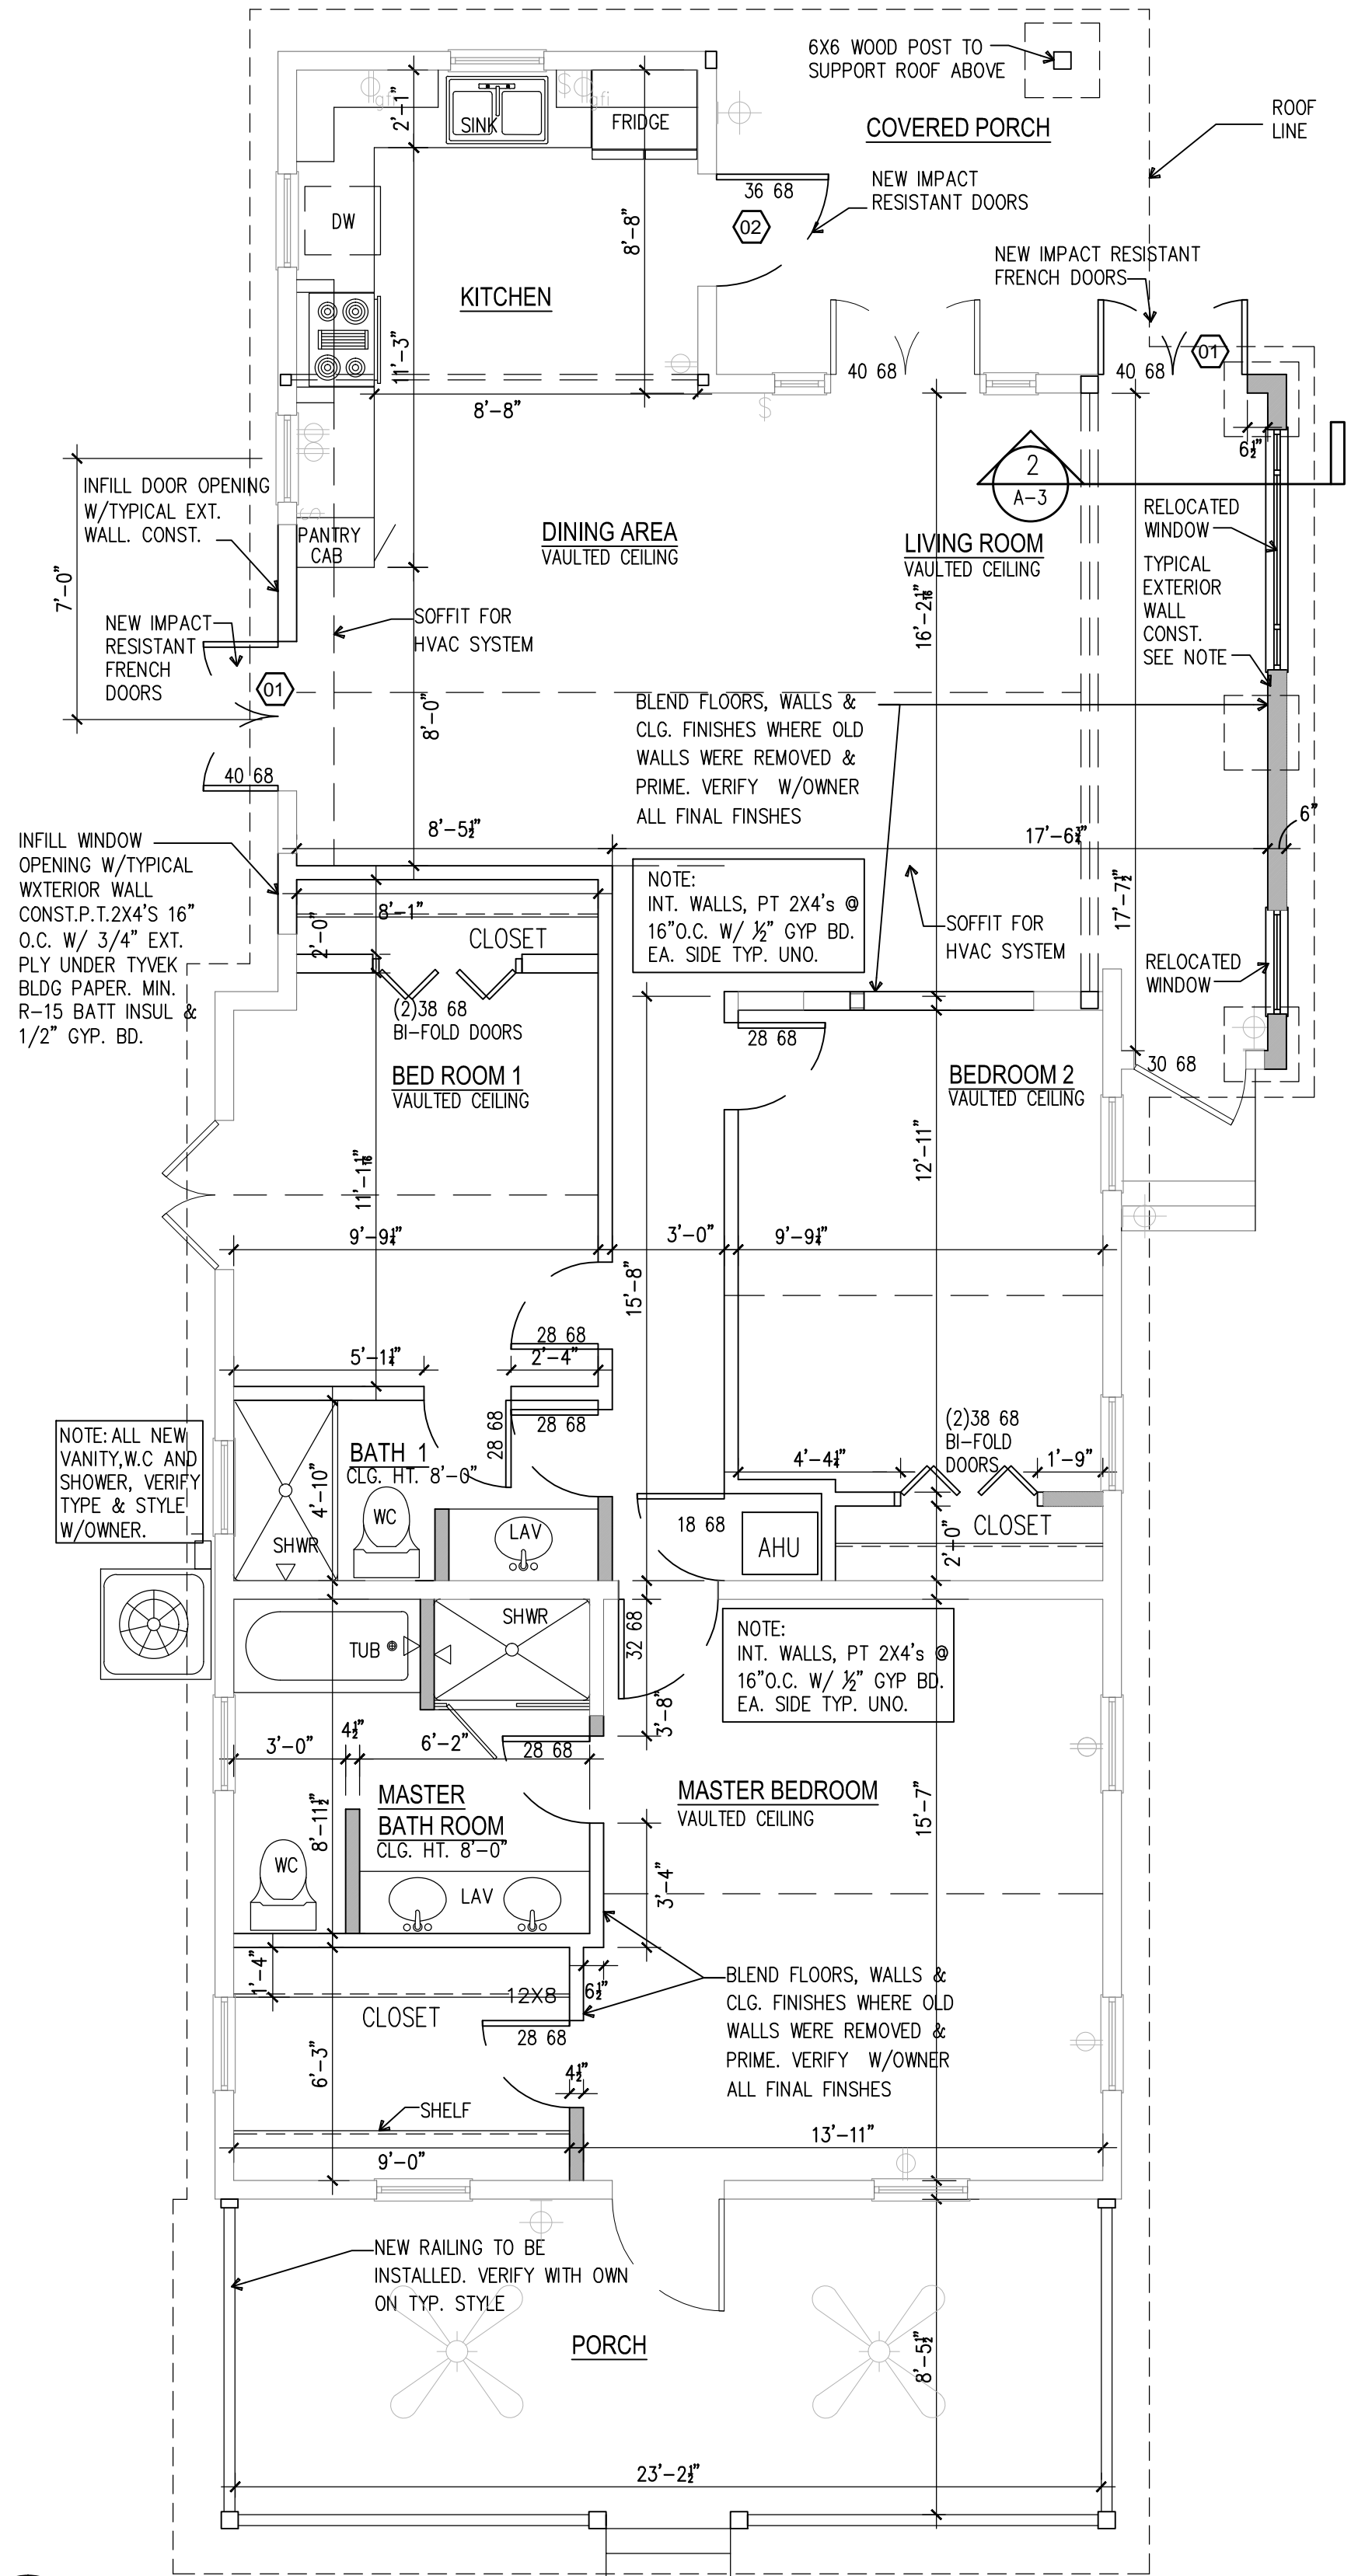

3 PROPOSED FLOOR PLAN  
A-2 SCALE: 1/4"= 1'-0"

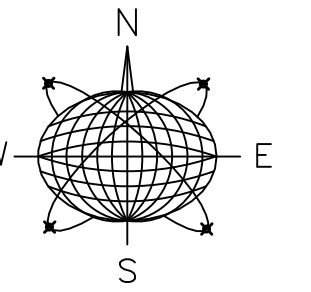

Meridian Engineering LLC  
201 Front Street, Suite 210  
Key West, Florida 33040  
AUTHORIZATION #29401  
ph:305-293-3263 fax:293-4899

Seal:

NOT VALID FOR CONSTRUCTION UNLESS  
SIGNED AND SEALED BY THIS BLOCK  
RICHARD J. MILELLI  
PE #58315

General Notes:






# RESIDENTIAL RENOVATION HARC SUBMITTAL

Drawn By: JMT  
Checked By: RJM  
Project No.:  
Scale:  
AutoCad File No.

Revisions:

Title: PROPOSED  
ELEVATIONS AND  
FLOOR PLAN

Sheet Number:  
A-2  
Date: NOVEMBER 3, 2014

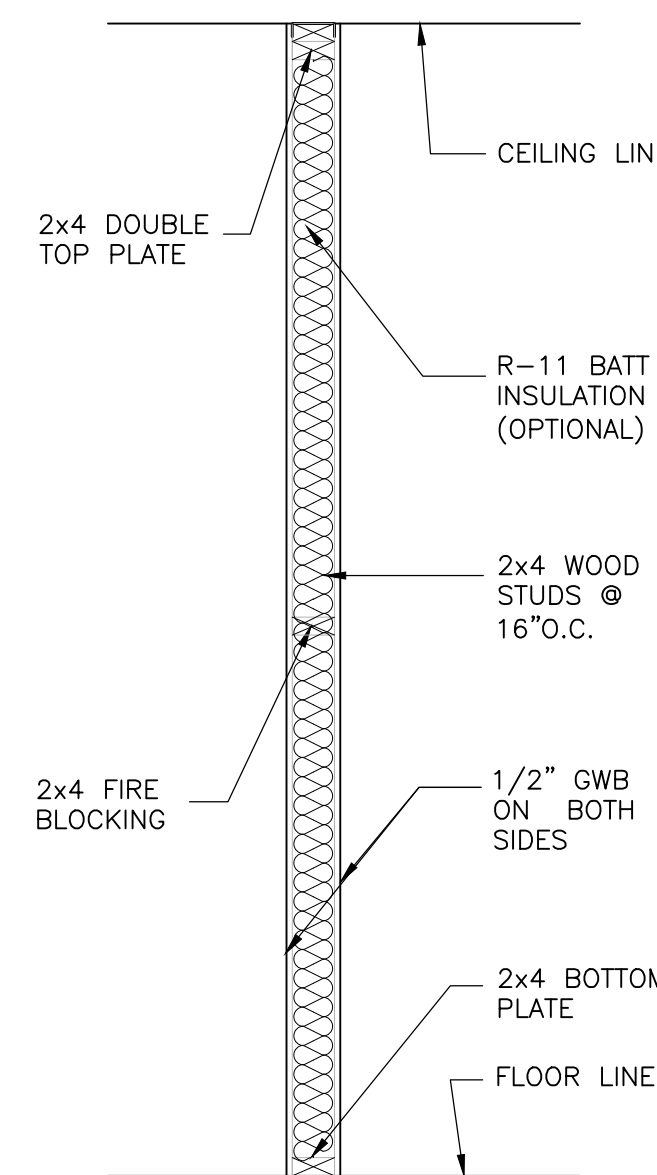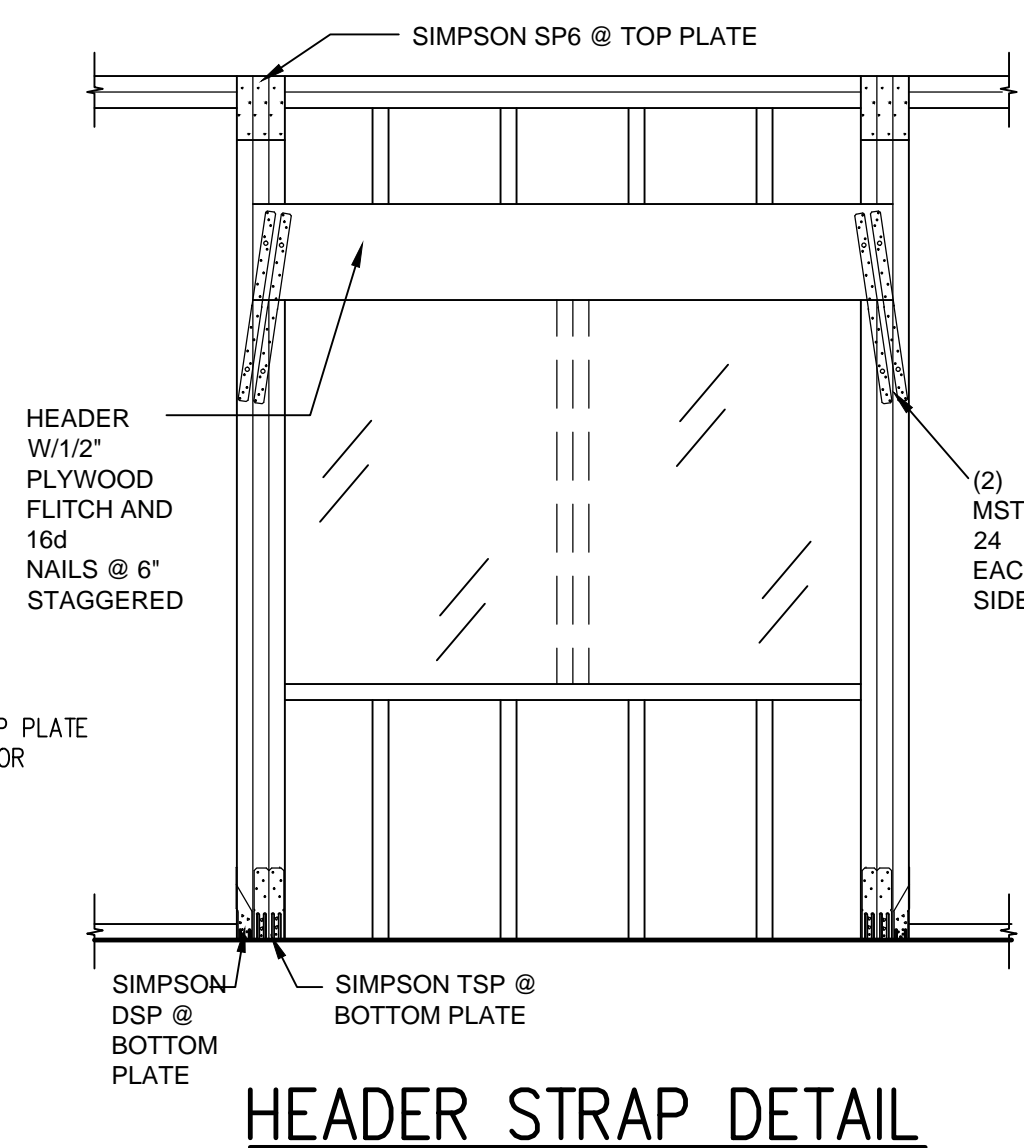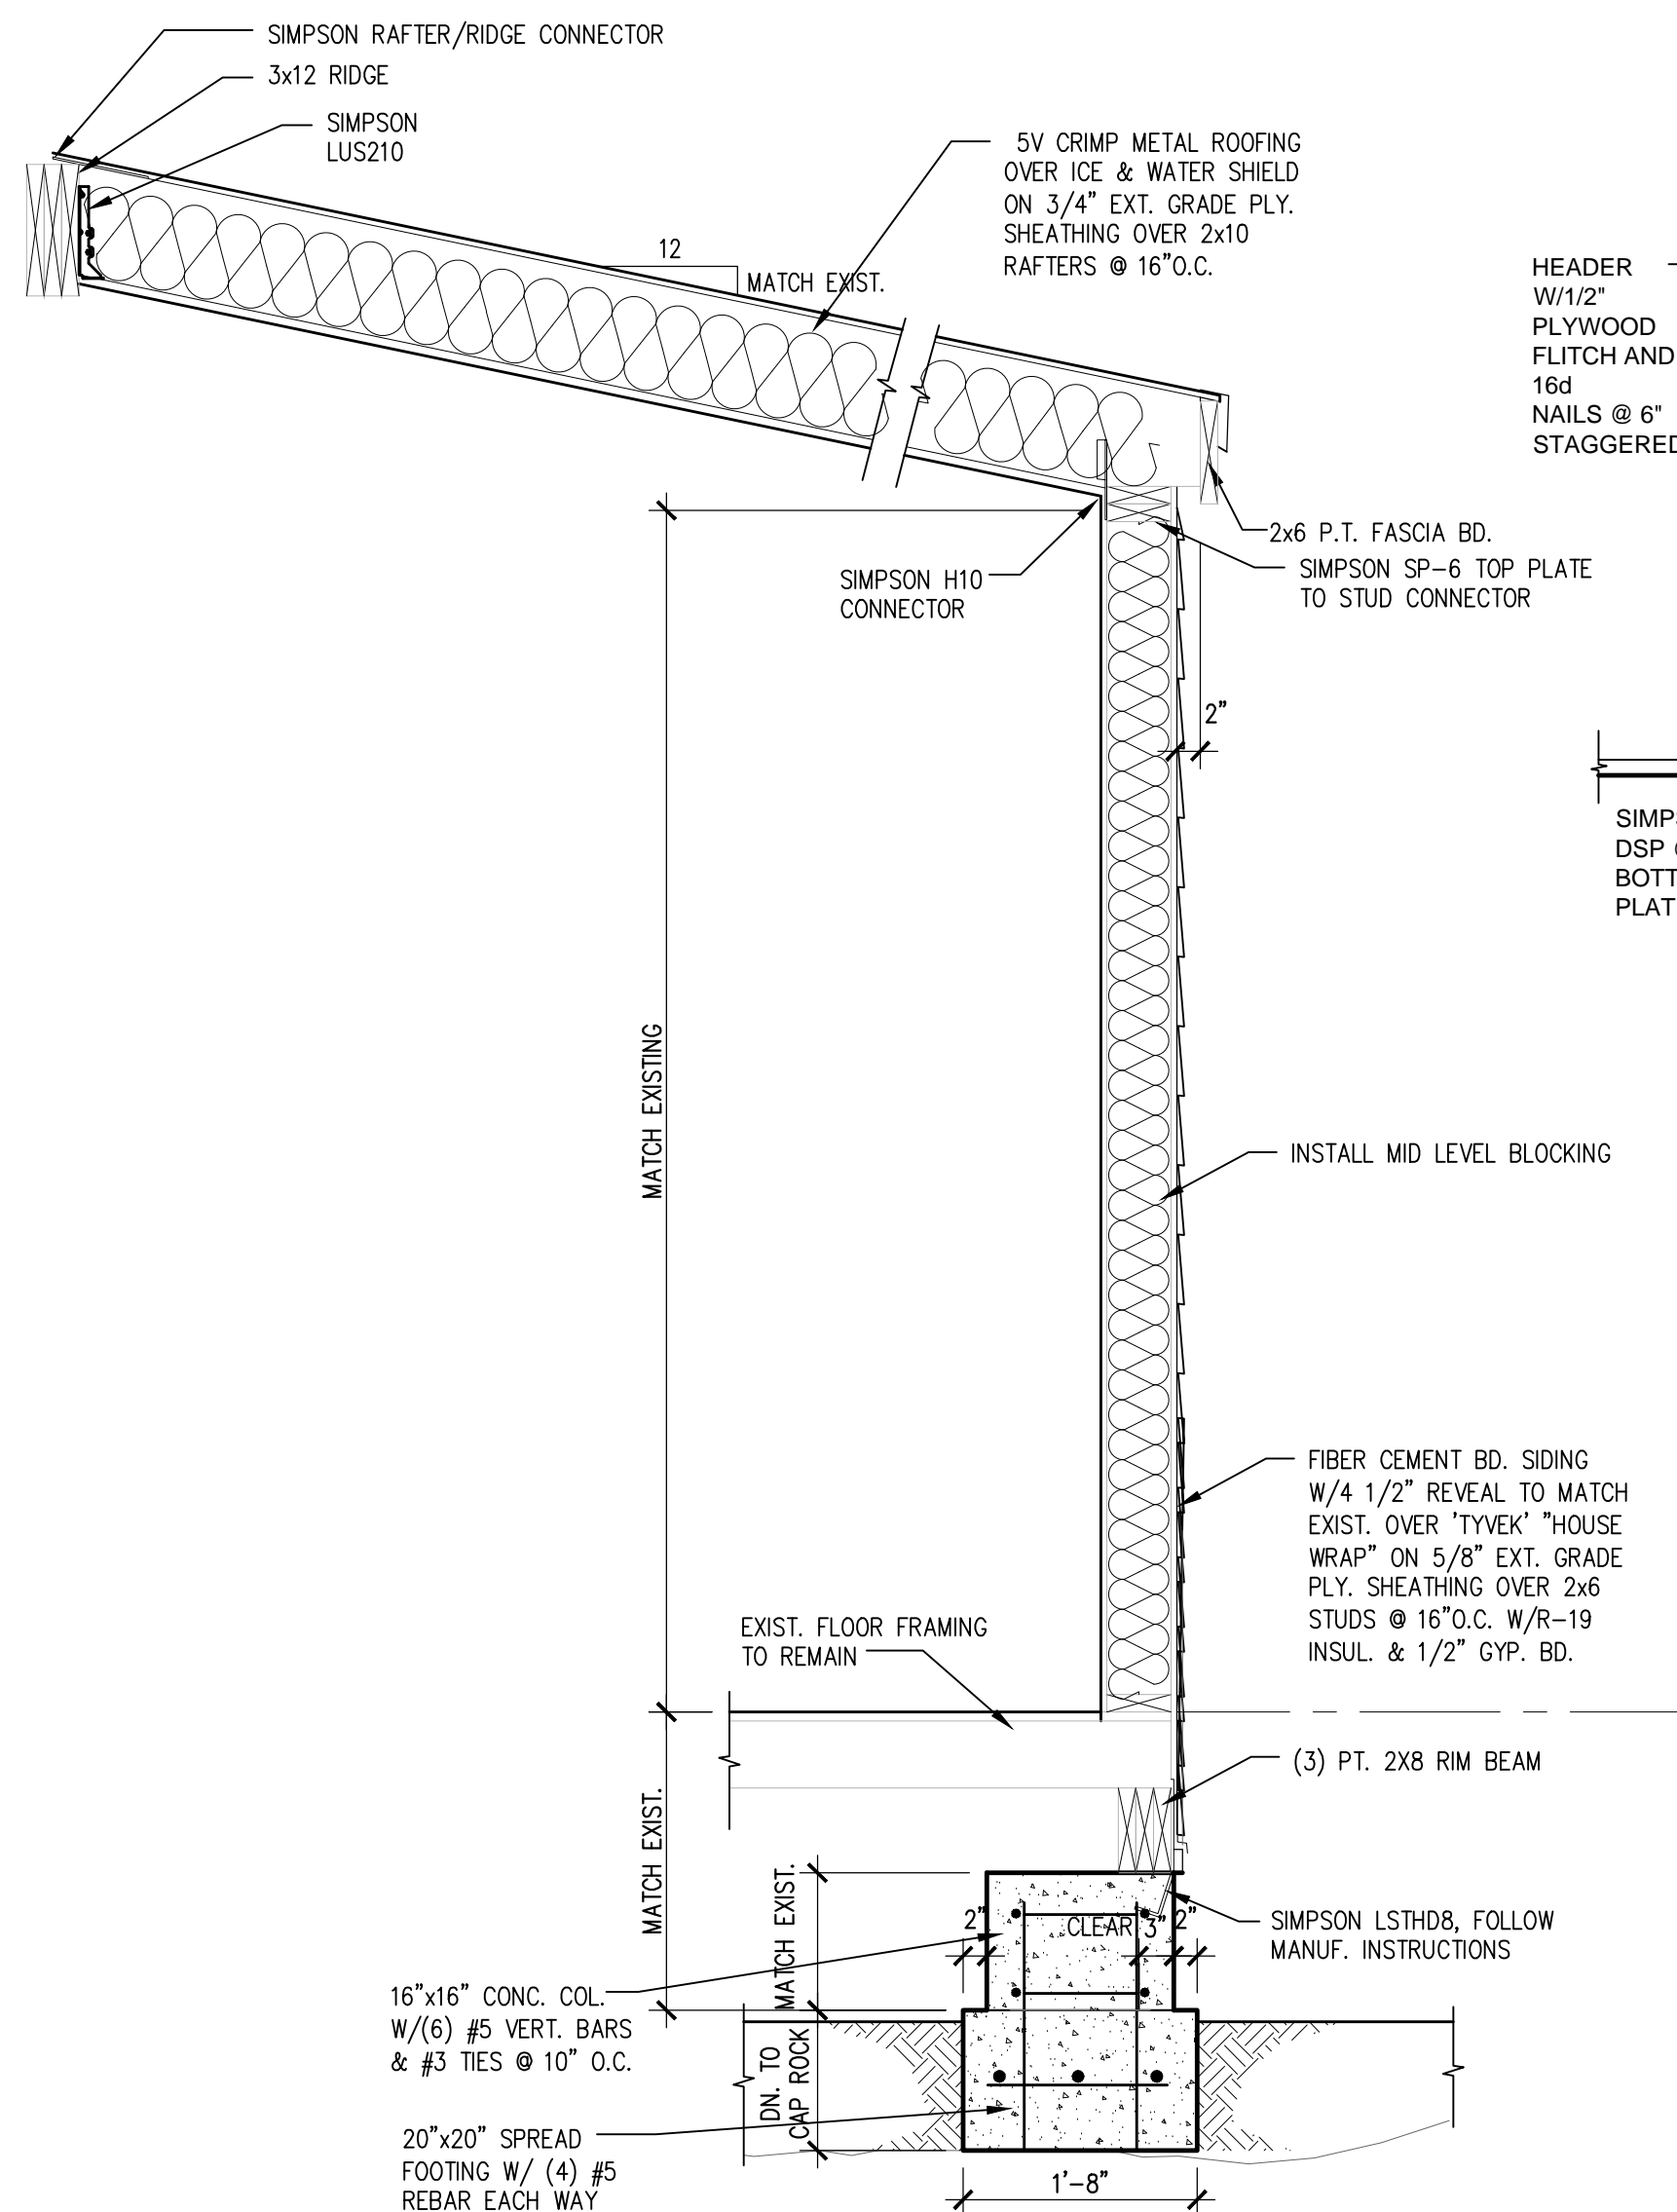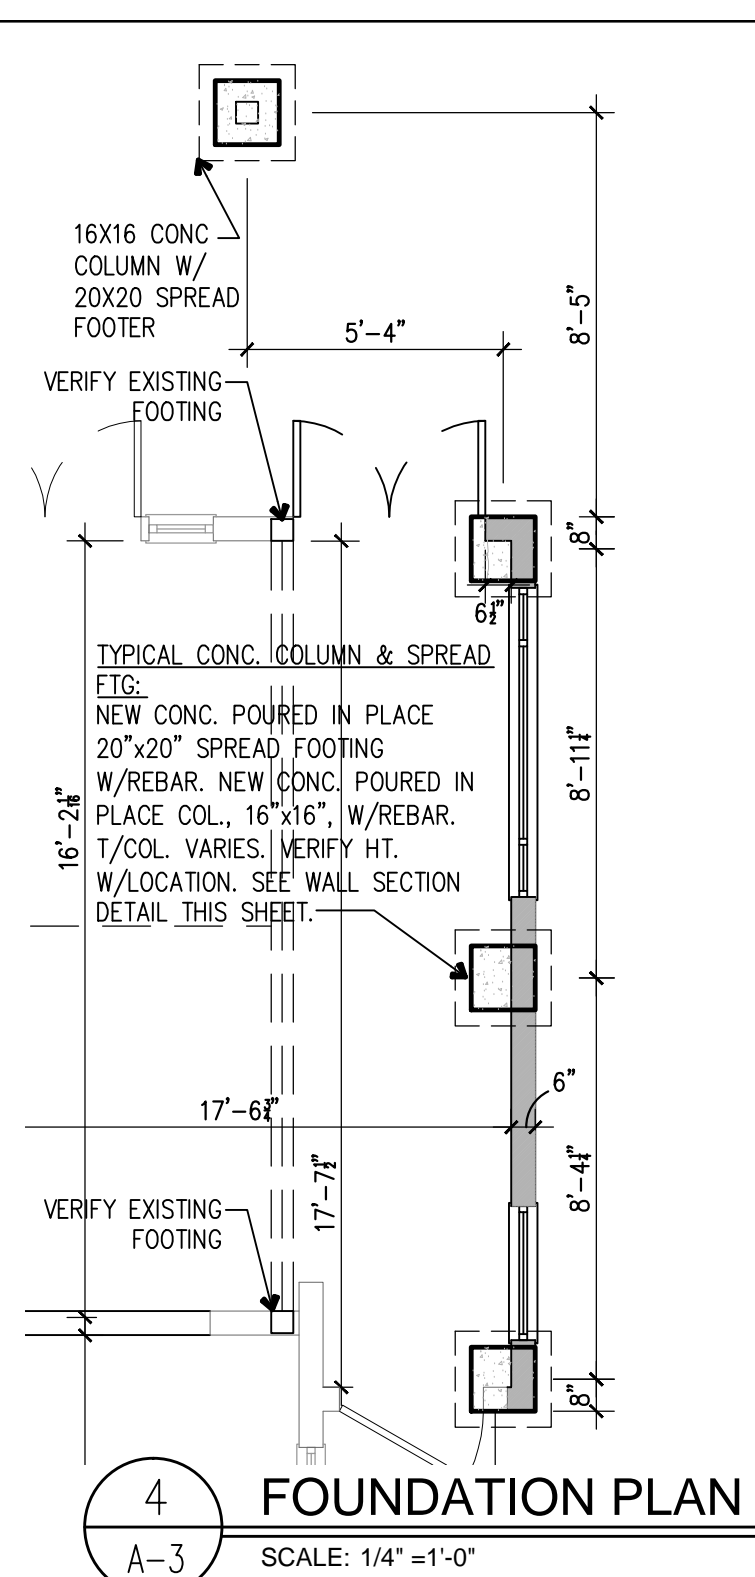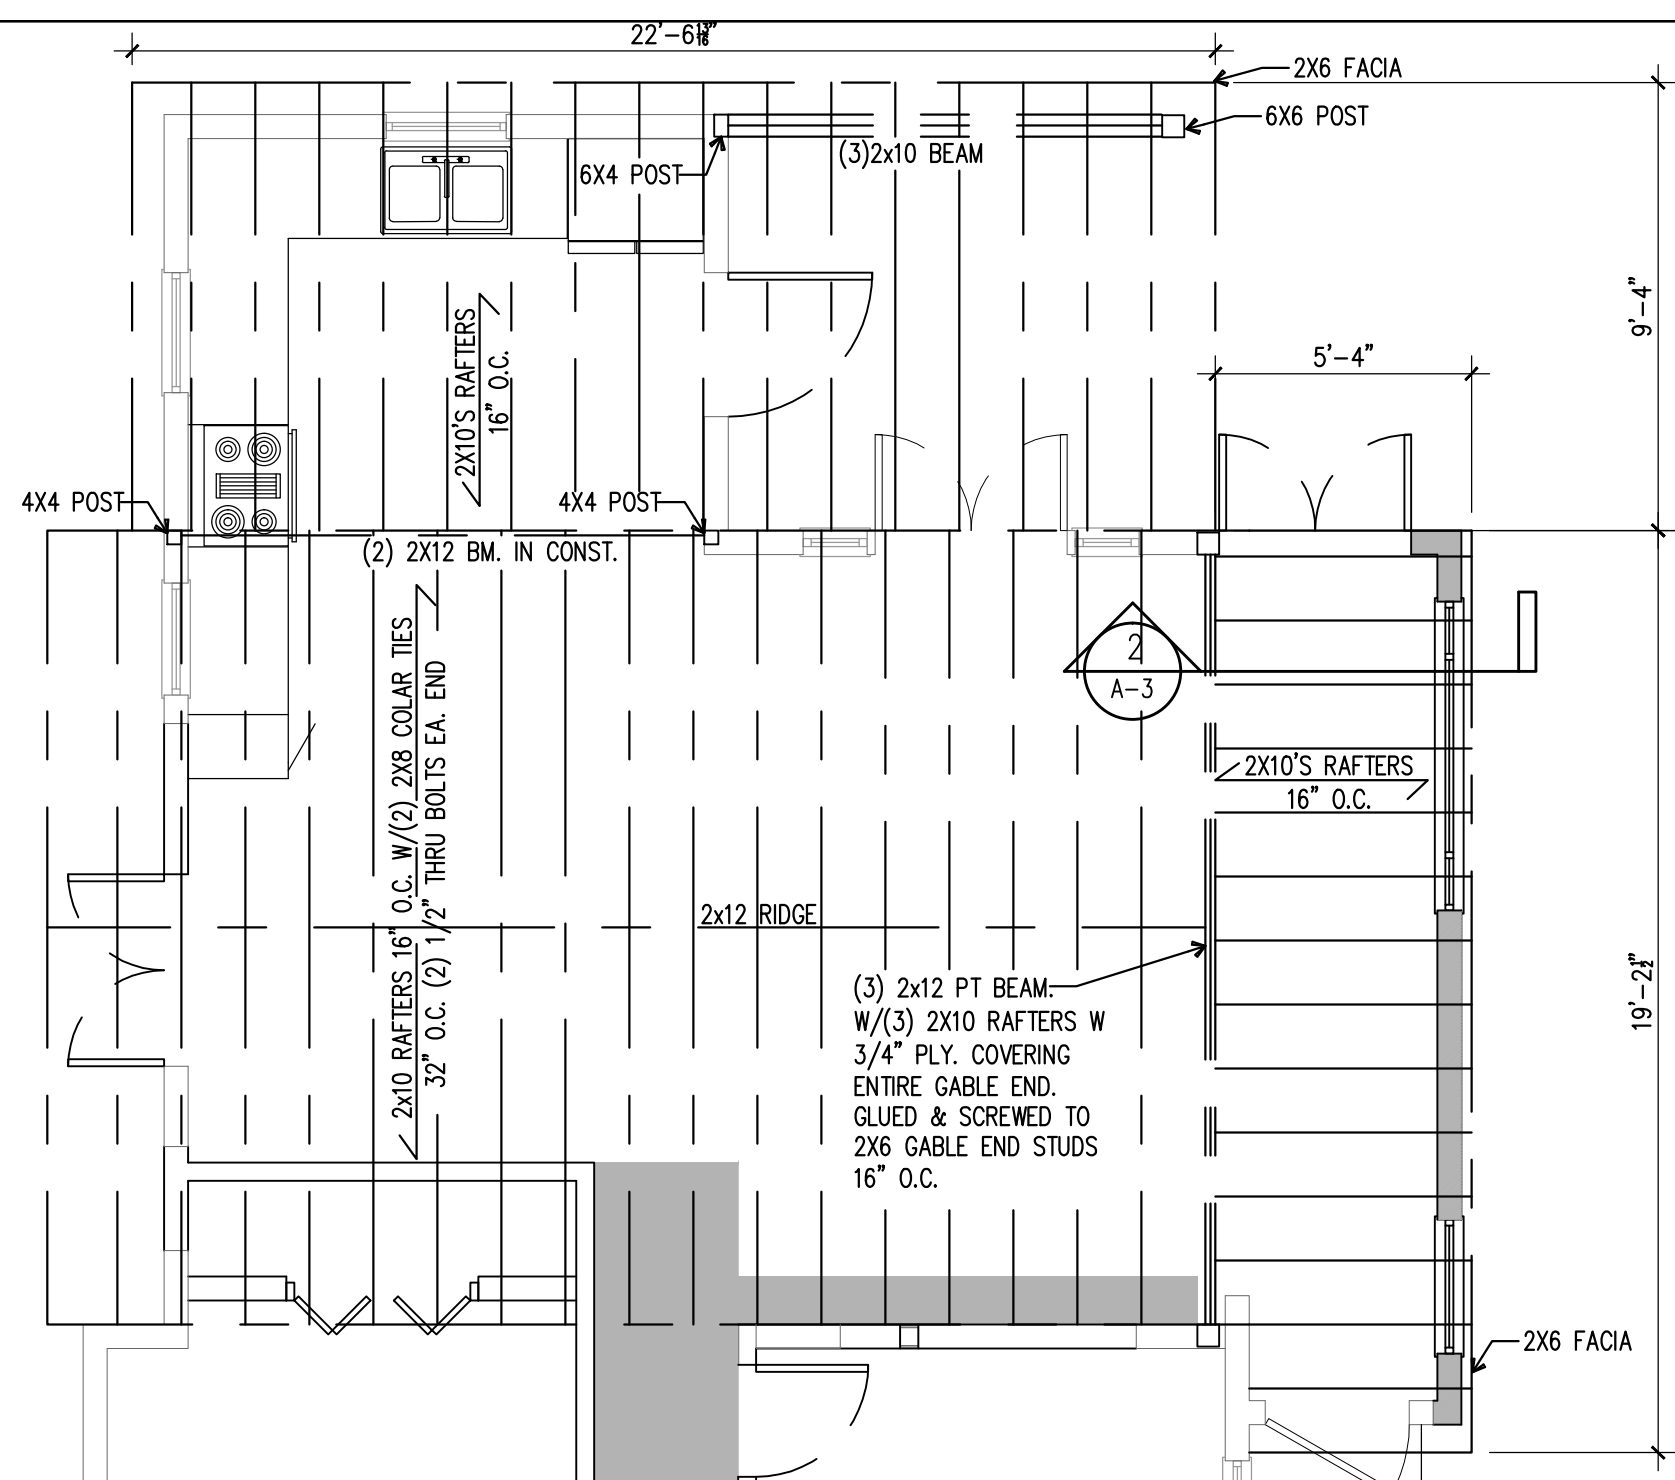

- FINISH NOTES**
1. PROVIDE GYPSUM DRYWALL ON ALL WALLS UNLESS OTHERWISE NOTED AND AS FOLLOWS:
    - A. STEEL TRUSS CHANNELS, ASTM C-645, WITH FLANGE EDGES BENT BACK 90 DEGREES AND DOUBLED OVER TO FORM  $\frac{1}{4}$ " MINIMUM UP. MINIMUM THICKNESS OF BASE (UNCOATED) METAL, GALVANIZED FINISH-TYPE AND MINIMUM DEPTH AS FOLLOWS; THICKNESS IS 0.0329 INCH, DEPTH IS 1-5 1/8".
    - B. GYPSUM BOARD,  $\frac{1}{2}$ " THICKNESS (UNLESS OTHERWISE INDICATED), ASTM C-840 AND ASTM C-36. USE TYPE X FOR FIRE RESISTANCE-RATED ASSEMBLIES. PROVIDE TAPERED EDGES. USE WATER-RESISTANT GYPSUM BOARD, ASTM C-630 FOR GYPSUM BOARD,  $\frac{1}{4}$ " AREA SUBJECT TO MOISTURE. PROVIDE GALVANIZED METAL TRIM ACCESSORIES COMPLYING WITH ASTM C-1047. PROVIDE TAP AND THREE COATS SPACKLE, SCREW GYPSUM BOARD TO METAL FRAMING.
    - C. AT FIRE RATED WALL ASSEMBLIES, TYPE X SHALL BE INSTALLED CONTINUOUS PAST ANY INTERSECTING PARTITIONS. SHEET INSTALLATION LAYERING, PENETRATIONS, AND TREATMENT OF RECESSED ELECTRICAL BOXES, ETC. SHALL BE IN ACCORDANCE WITH ASSEMBLY DETAIL.
  2. CERAMIC TILE SHALL BE FURNISHED AND INSTALLED WHERE INDICATED. TILE GROUTING PRODUCTS SHALL BE AS MANUFACTURED BY AMERICAN LALON, DAL-TILE CORPORATION OR APPROVED EQUIV. FLOOR TILE SHALL BE 12X12 UNFINISHED FLOOR TILE,  $\frac{3}{16}$ ", CUSHION EDGE AND NON-SLIP SURFACE. WALL TILE SHALL BE 4X4,  $\frac{3}{16}$ ", CUSHION EDGE. PROVIDE ALL TRIM AND ACCESSORIES NECESSARY TO PROVIDE A COMPLETE INSTALLATION INCLUDING BULLNOSE, COVE, BASE, BEADS, ETC. USE BONSAI MULTIPURPOSE PREMIUM TRIM-SET GROUT W/ LATEX ADDITIVE B-730 OR EQUIV. (ANSI A118.4). USE MOISTURE RESISTANT,  $\frac{1}{2}$ " THICK CONCRETE BACKER BOARD UNDER ALL TILE.
  3. EXISTING WOOD FLOOR RESTORATION: REMOVE ALL EXISTING CARPET, LINOLEUM AND OTHER EXISTING FLOORING. PROVIDE REMAINING SUB FLOORING UNLESS OTHERWISE NOTED. REMOVE AND REPLACE DAMAGED BOARDS (NOTIFY ENGINEER OF RECORD PRIOR TO CONTINUING IF ROTTED OR DAMAGED WOOD IS ENCOUNTERED). SAND EXISTING FLOORING SMOOTH WITH SANDING MACHINE USING A MINIMUM OF COARSE MEDIUM AND FINE SANDING LAYERS. FILL ALL HOLES AND GAPS WITH ZAR LATEX PATCHING COMPOUND, COLOR TINT TO MATCH EXISTING. HOLES OR VOIDS OVER  $\frac{1}{2}$ " IN DEPTH SHALL BE FILLED IN SUCCESSIVE LAYERS OF  $\frac{1}{2}$ " EACH, ALLOW DRYING BETWEEN APPLICATIONS. SAND SMOOTH AND STAIN FILL MATERIAL AS REQUIRED TO MATCH EXISTING. APPLY (2) COATS OF ZAR QUICK DRY GLOSS PRIMER/SEALER POLYURETHANE IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS. (LIGHTLY SAND BETWEEN COATS) APPLY (2) FINISH COATS OF ZAR GLOSS POLYURETHANE IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS. (SAND LIGHTLY BETWEEN COATS)
  4. CARPETING AND PADDING SHALL BE SELECTED BY OWNER AND INSTALLED BY CONTRACTOR. PROVIDE \$25 PER SQUARE YARD ALLOWANCE FOR PURCHASE DELIVERY AND INSTALLATION OF NEW CARPETING AND PADDING.
  5. PROVIDE PAINTING FOR ALL EXPOSED INTERIOR AND EXTERIOR SURFACES UNLESS NOTED OTHERWISE OR INDICATED TO REMAIN NATURAL. ALL SURFACES TO BE PAINTED OR OTHERWISE FINISHED SHALL BE PROPERLY PREPARED AND PRIMED PRIOR TO PAINTING OR OTHERWISE FINISHING. IF A SURFACE IS NOT SPECIFICALLY INDICATED TO BE PAINTED, MATCH ADJACENT SURFACES. PAINTING IS NOT REQUIRED ON PREFINISHED ITEMS, FINISHED METAL SURFACES, CONCEALED SURFACES, OPERATING PARTS AND LABELS. (DO NOT PAINT OVER U.F. FACTORY MUTUAL, OR OTHER CODE-REQUIRED LABELS OR EQUIPMENT NAME, IDENTIFICATION, PERFORMANCE DATA OR NOMENCLATURE PLATES.) PROVIDE SAMPLES OF EACH COLOR, TEXTURE AND FINISH TO BE APPLIED. RESUBMIT UNTIL ALL COLORS, TEXTURES AND FINISHES ARE APPROVED BY OWNER.
  6. REMOVE AND REPLACE ALL ROTTED OR DAMAGED WOOD AND REPLACE WITH SIMILAR WOOD TO MATCH EXISTING SURFACES. USE PRESSURE TREATED WOOD. SPLICE NEW BOARDS INCONSPICUOUSLY AND STAGGER JOINTS AS REQUIRED. SCRAPE LOOSE PAINT OFF EXISTING WOOD SURFACES, SAND SMOOTH AND APPLY PRIMER. CAULK ALL SEAMS, JOINTS AND GAPS.
  7. WALL COVERINGS INDICATED SHALL BE FURNISHED BY OWNER. CONTRACTOR TO PROVIDE WALL SURFACES THAT HAVE BEEN TAPED, FLOATED AND SANDED TO PROPERLY RECEIVE WALL COVERINGS.

- WOOD AND FRAMING NOTES**
1. EXCEPT WHERE NOTED OTHERWISE, ALL FRAMING LUMBER SHALL BE SOUTHERN PINE, MC 19%, NO. 2 DENSE, AS GRADED BY THE SOUTHERN PINE INSPECTION BUREAU.
  2. ALL TIMBER CONSTRUCTION SHALL CONFORM TO THE LATEST EDITION AFT.
  3. ALL WOOD SHALL BE PRESSURE TREATED WITH CHEMICALS TO PROTECT FROM INSECTS AND DECAY. ALLOW TO DRY AFTER TREATMENT. PROVIDE CONNECTORS AND FASTENERS COMPATIBLE WITH PRESSURE TREATED WOOD FRAMING. PROVIDE SEPARATION BARRIER SUCH AS BUILDING PAPER FOR NON-COMPATIBLE COMPONENTS SUCH AS ALUMINUM WINDOW FRAMES.
  4. ALL WOOD CONNECTIONS SHALL HAVE SIMPSON STRONG-IRIE CO. OR EQUAL CONNECTORS. ALL CONNECTORS SHALL BE INSTALLED WITH MANUFACTURER RECOMMENDED FASTENERS BEFORE LOADING.
  5. CUTTING AND NOTCHING OF FLOOR JOISTS SHALL CONFORM TO THE FOLLOWING:
    - a. NOTCH DEPTH IN THE TOP OR BOTTOM OF THE JOISTS AND BEAMS SHALL NOT EXCEED ONE-SIXTH OF THE DEPTH OF THE MEMBER AND SHALL NOT BE LOCATED IN THE MIDDLE ONE-THIRD OF THE SPAN. (INCLUDING BIRDS MOUTH CUTS).
    - b. NOTCH DEPTH AT THE ENDS OF THE MEMBER SHALL NOT EXCEED ONE-FOURTH THE DEPTH OF THE MEMBER.
    - c. THE TENSION SIDE OF BEAMS, JOISTS AND RAFTERS OF FOUR INCHES OR GREATER NOMINAL THICKNESS SHALL NOT BE NOTCHED, EXCEPT AT ENDS OF MEMBERS.
    - d. HOLES BORED OR CUT INTO JOISTS SHALL NOT BE CLOSER THAN TWO INCHES TO THE TOP OF BOTTOM OF THE JOISTS. THE DIAMETER OF THE HOLE SHALL NOT EXCEED ONE-THIRD THE MEMBER DEPTH.
    - e. HOLES BORED IN BEARING WALL STUDS SHALL NOT EXCEED ONE-THIRD OF STUD.
    - f. HOLES BORED BETWEEN ALL JOISTS 2 x 6 OR GREATER AT INTERVALS NOT TO EXCEED 8 FEET AND AT ALL SUPPORTS.
  6. PROVIDE SOLID BLOCKING AT MID HEIGHT ON CENTER BETWEEN STUDS. (MINIMUM )
  7. ALL WALL STUDS SHALL BE SPF NO. 2 DENSE GRADE OR BETTER.
  8. SEE PLANS FOR WALL STUD SIZE AND SPACING.
  9. ALL STUD BEARING WALLS SHALL BE PROVIDED WITH 2 CONTINUOUS TOP PLATES AND CONTINUOUS BOTTOM PLATES WITH A MINIMUM OF ONE ROW OF HORIZONTAL BRIDGING AT MID-HEIGHT OF WALL UNLESS NOTED OTHERWISE. "SPICES AT TOP PLATE" SHALL OCCUR OVER STUD. SPICES SHALL BE STAGGERED A MINIMUM OF FOUR FEET.
  10. ALL LINEAL'S OVER STUDS SHALL BE AS SHOWN UNLESS NOTED OTHERWISE.
    - (1) 2 x 6 FOR INTERIOR OPENINGS UP TO 4'-0"
    - (2) 2 x 6 FOR EXTERIOR OPENINGS UP TO 4'-0"
    - (3) 2 x 8 FOR INTERIOR OPENINGS UP TO 6'-0"
    - (4) 2 x 8 FOR EXTERIOR OPENINGS UP TO 6'-0"
    - (5) 2 x 10 FOR INTERIOR OPENINGS UP TO 8'-0"
    - (6) 2 x 10 FOR EXTERIOR OPENINGS UP TO 8'-0"
    - (7) 2 x 12 FOR INTERIOR OPENINGS UP TO 10'-0"
    - (8) 2 x 12 FOR EXTERIOR OPENINGS UP TO 10'-0"
  13. EXTERIOR WALL STUDS SHALL BE STRAPPED TO ROOF TRUSSES OR RAFTERS WITH SIMPSON CONNECTORS OR EQUAL. PROVIDE 3 STUDS (MIN.) FOR GIDER TRUSS AND BEAM BEARING.
  14. WHERE WOOD JOISTS/BEAMS ETC. FRAME INTO OTHER MEMBERS INSTALL SIMPSON "LUS" SERIES GALVANIZED JOIST HANGERS.
  15. FLOOR DECKING SHALL BE IN ACCORDANCE WITH RECOMMENDATIONS OF THE AMERICAN PLYWOOD ASSOCIATION (APA). PLYWOOD SHEATHING SHALL BE APA STRUCTURAL I, IDENTIFIED WITH APA GRADE-TRADEMARK AND SHALL MEET THE REQUIREMENTS OF US PRODUCT STANDARD PSI OR APA PP-108. ALL PLYWOOD WITH AN EDGE EXPOSED TO THE EXTERIOR SHALL BE EXTERIOR GRADE. FLOOR DECKING SHALL BE A 3/4" MINIMUM AND GLUED AND FASTENED TO FLOOR FRAMING. ROOF DECKING SHALL BE 3/8" MINIMUM AND NAILED WITH 80 PAILS @ 6" IN THE FIELD AND 4" ALONG THE EDGES.
  16. FINISH CARPENTRY SHALL INCLUDE TRIM, FRAMES, PANELING AND CABINETRY. PROFILES AND PLASTIC LAMINATE ARE TO BE AS SELECTED BY THE OWNER OR NOTED ON THE DRAWINGS. CABINETS SHALL BE CUSTOM OR PREMIUM GRABES AS NOTED OR DETERMINED BY THE ARCHITECT. ALL BOARD SHALL NOT BE USED. SELECT GRADE SOUTHERN YELLOW PINE SHALL BE USED AS A QUALITY STANDARD FOR TRIM, FRAMES AND BASE UNLESS OTHERWISE NOTED. ALL WORK SHALL BE PERFORMED BY SKILLED FINISH CARPENTERS.
  17. WOOD SHELVING SHALL BE 2" PLYWOOD WITH EDGE BANDING AND PAINTED.


- ### HEAT & MOISTURE PROTECTION
1. PROVIDE INSULATION AS SHOWN ON THE DRAWINGS AND AS FOLLOWS:
    - A. FACED MINERAL FIBER BLANKET/BATT INSULATION: PROVIDE THERMAL INSULATION PRODUCED BY COMBINING MINERAL FIBERS OF TYPE DESCRIBED BELOW WITH THERMOSETTING RESINS TO COMPLY WITH ASTM C-665 FOR TYPE III, CLASS A (BLANKETS WITH REFLECTIVE VAPOR-RETARDER MEMBRANE FACING WITH FLAME SPREAD OF 25 OR LESS), FOL-SORM-HR-AT ON FOL-SORM-POLYETHYLENE VAPOR-RETARDER MEMBRANE ON ONE FACE, AS FOLLOWS:
      - MINERAL FIBER TYPE: FIBERS MANUFACTURED FROM GLASS.
    - B. SURFACE BURNING CHARACTERISTICS: MAXIMUM FLAME SPREAD VALUE OF 25 AND MAXIMUM SMOKE DEVELOPED VALUE OF 50.
    - C. FLANGED UNITS: PROVIDE BLANKETS/BATTS FABRICATED WITH FACING THAT INCORPORATES 4" WIDE FLANGES ALONG THE EDGES TO ATTACH TO FRAMING MEMBERS.
  2. POLYISOCYANURATE BOARD INSULATION: PROVIDE RIGID, CELLULAR THERMALINSULATION WITH GLASS-FIBER-REINFORCED POLYISOCYANURATE. CLOSED-CELL FOAM CORE AND ALUMINUM FOIL FACING LAMINATED TO BOTH SIDES AND COMPLYING WITH FS IH-1-1972 J1, CLASS 2, AGED, R VALUES OF 8 AND 7.2 AT 40 AND 75 DEGREES FAHRENHEIT, RESPECTIVELY. AND FOLLOWS:
    - A. SURFACE BURNING CHARACTERISTICS: MAXIMUM FLAME SPREAD VALUE OF 25 AND MAXIMUM SMOKE DEVELOPED VALUE OF 50.
    - B. THICKNESS 1" FOR SPECIFICATION CRITERIA (SEE DRAWINGS FOR REQUIRED THICKNESS OR R VALUE AT EACH LOCATION) COMPLY WITH MANUFACTURER RECOMMENDATIONS FOR INSTALLATION. SEAL ALL JOINTS AS REQUIRED.
  3. INSULATION SHALL BE R-30 MINIMUM IN ATTIC SPACES.
  4. FLASHING SHALL BE GALVANIZED AND INCLUDE BASE FLASHING, STOPS, BUILT-IN VALVEYS, GUTTERS, SCUPPERS, AND MISCELLANEOUS METAL ACCESSORIES: USE ZINC-COATED, COMMERCIAL QUALITY ASTM A-526 60G HOT-DIPPED GALVANIZED, 24 GAGE STEEL UNLESS OTHERWISE NOTED. SHAPES SHALL MATCH EXISTING PROFILES OF FLASHING AND STOPS. SHIP, FABRICATE TO THE MAXIMUM EXTENT POSSIBLE, COMPLY WITH DETAILS SHOWN AND APPLICABLE REQUIREMENTS OF SMACNA "ARCHITECTURAL SHEET METAL MANUAL" AND MANUFACTURER RECOMMENDATIONS.
  5. PROVIDE SEALANTS AS FOLLOWS:
    - A. SILICONIZED ACRYLIC CAULK - 25 YR, PAINTABLE, NON-STAINING, MILDREW RESISTANT. FOR INTERIOR AND EXTERIOR USE, FOR WOOD AND MASONRY, AS A FILLER FOR CRACKS, VOIDS AND HOLES IN PREPARATION FOR PAINT OR OTHER FINISH.
    - B. POLYEMASEAL ALL-PURPOSE ADHESIVE CAULK, PAINTABLE, NON-STAINING, MILDREW RESISTANT. FOR INTERIOR AND EXTERIOR USE AS A FILLER AND JOINT SEAL AT TILE, CLAS AND COUNTERS.
    - C. SILICONE RUBBER SEALANT - FS TT-S-00154, TYPE A, ONE-PART NON-SAG LOW MODULES SILICONE RUBBER SEALANT. FOR INTERIOR AND EXTERIOR USE IN WORKING JOINTS WHERE SOME MOVEMENT IS ANTICIPATED, FOR WOOD, MASONRY, METAL AND GLASS. PROVIDE BACKER ROD DEPTH CONTROL IN ALL JOINTS GREATER THAN 1".



1. ALL WORK SHALL BE FORMED IN ACCORDANCE WITH THE 2007 MECHANICAL CODE, FLORIDA ENERGY EFFICIENCY CODE AND ALL LOCAL ORDINANCES.
2. THE CONTRACTOR SHALL FURNISH ALL LABOR, MATERIALS, EQUIPMENT, SUPERVISION, PERMITS, FEES AND INSPECTIONS NECESSARY TO PROVIDE THE WORK COMPLETE AND READY FOR USE.
3. THE CONTRACTOR SHALL VERIFY SPACE CONDITIONS AND DIMENSIONS AND SHALL COORDINATE WORK WITH ALL OTHER TRADES PRIOR TO FABRICATING DUCTWORK OR INSTALLING EQUIPMENT OR PIPING.
4. PRIMARY DUCTWORK SHALL BE CONSTRUCTION OF ONE AND HALF-INCH THICK (R-6 MINIMUM) FIBERGLASS DUCTBOARD WITH REINFORCED ALUMINUM FOIL FACED COVERING FABRICATED AND INSTALLED PER SMACNA RECOMMENDATIONS.
5. ALL VENTILATION AND EXHAUST DUCTWORK SHALL BE OF GALVANIZED SHEET METAL CONSTRUCTION PER SMACNA RECOMMENDATIONS.
6. REFRIGERATION PIPING SHALL BE TYPE "L" COPPER TUBING SIZED AND INSTALLED PER MANUFACTURER'S RECOMMENDATIONS. INSULATED SUCTION AND CONDENSATE PIPING WITH 1/4" THICK FOAM PLASTIC OF FIRE RETARDANT TYPE 25/30 MAXIMUM SMOKE DEVELOPED AND FLAME SPREAD RATING RESPECTIVELY PER TESTS IN MFPA-255, FINISH WHERE EXPOSED WITH TWO COATS OF ACRYLIC LACQUER IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.
7. ALL EQUIPMENT, MATERIALS AND WORKMANSHIP SHALL BE GUARANTEED FOR A PERIOD OF ONE YEAR FROM THE DATE OF ACCEPTANCE. COMPRESSORS SHALL CARRY A FIVE-YEAR FACTORY GUARANTEE. THE CONDITION SYSTEM SHALL BE BALANCED TO OBTAIN COMFORT CONDITIONS IN ALL AREAS WITHOUT DRAFTING.
8. THERMOSTATS SHALL BE HEAT/COOL TYPE WITH FAN AND SYSTEM SELECTOR SWITCH ON SUB BASE. MOUNT FIVE FEET ABOVE FINISHED FLOOR WHERE SHOWN.
9. ALL DUCT ELBOWS GREATER THAN FORTY FIVE (45) DEGREES SHALL BE FITTED WITH TURNING VANES.
10. PROVIDE READY ACCESSIBILITY TO DAMPERS AND OTHER PARTS OF THE SYSTEM REQUIRED TO BE REACHED FOR MAINTENANCE AND OPERATIONS.
11. VERIFY ALL VOLTAGE AND ELECTRICAL CONTRACTOR BEFORE ORDERING EQUIPMENT.
12. VIBRATION ISOLATION SHALL BE PROVIDED FOR ALL EQUIPMENT PER MANUFACTURER'S RECOMMENDATIONS.
13. ALL OUTSIDE EQUIPMENT SHALL BE SECURED TO WITHSTAND FORCES GENERATED BY 150 MPH WINDS.
14. FLEXIBLE DUCT SHALL BE FACTORY FABRICATED ROUN DUCTWORK COMPOSED OF CORROSION-RESISTANT REINFORCING WITH HELIX PERMANENTLY BONDED AND ENCLOSED IN POLYESTER FILM WITH A MINIMUM OF ONE AND ONE HALF INCH (1/4 POF) (R-6 MINIMUM) DENSITY FIBERGLASS INSULATION BATT SHEATHED IN A VAPOR BARRIER OF ALUMINUM METALIZED POLYESTER FILM LAMINATED TO GLASS FIBER MESH, ELASTOMER COAT COATED. THE DUCT SHALL COMPLY WITH MFPA BULLETIN 90-A AND BE LISTED A CLASS 1 AIR CURT 1L 181 DUCT SHALL BE "WIRE HOLE" TYPE WC OR EQUAL.

1. THE CONTRACTOR SHALL FURNISH ALL LABOR, MATERIAL, EQUIPMENT AND SUPERVISION NECESSARY TO PROVIDE THE WORK COMPLETE AND READY FOR USE. THE NEW WORK SHALL INCLUDE COMPLETE HOT AND COLD WATER SYSTEMS AND VENT, WASTE AND DRAIN SYSTEMS IN ACCORDANCE WITH ALL APPLICABLE CODES.
2. ALL PLUMBING WORK SHALL BE INSTALLED IN ACCORDANCE WITH THE 2010 PLUMBING CODE, THE ENERGY CONSERVATION CODE AND ALL APPLICABLE LOCAL ORDINANCES.
3. CONTRACTOR SHALL PAY FOR ALL PERMITS, FEES, INSPECTIONS AND TESTING.
4. CONTRACTOR SHALL GUARANTEE ALL MATERIALS AND WORKMANSHIP FOR ONE YEAR.
5. PLUMBING DRAWINGS (PLANS, DIAGRAMS, ETC.) ARE DIAGRAMMATIC AND SHOULD NOT BE SCALED. THE DRAWINGS DO NOT SHOW EVERY BEND, OFFSET, ELBOW AND OTHER FITTINGS WHICH MAY BE REQUIRED FOR PROPER INSTALLATION IN THE SPACE ALLOCATED NOR AS REQUIRED TO COORDINATE WITH OTHER TRADES. ANY WORK NOT SHOWN ON THE DRAWINGS BUT CONSIDERED NECESSARY FOR THE PROPER COMPLETION OF THE WORK SHALL BE PROVIDED WITHOUT ADDITIONAL CHARGE TO THE OWNER.
6. THE CONTRACTOR SHALL COORDINATE HIS WORK WITH ALL OTHER WORK UNDER THIS CONTRACT.
7. THE OWNER WILL NOT BE HELD LIABLE FOR ANY CHANGES THAT ARE NOT BROUGHT TO THE ATTENTION OF THE OWNER OR FIELD CHANGES THAT ARISE FROM CONTRACTOR ERROR OR OMISSION ON THE PART OF THE CONTRACTOR.
8. THE CONTRACTOR SHALL VERIFY EXISTING SITE CONDITIONS AND THE LOCATION, SIZE AND ELEVATION OF ALL EXISTING MAIN, WATER AND SEWER CONNECTIONS PRIOR TO COMMENCING WORK. THE CONTRACTOR SHALL NOTIFY AND RECEIVE CLEARANCE FROM THE APPROPRIATE UTILITY COMPANIES PRIOR TO EXCAVATING.
9. VERIFY ALL DIMENSIONS AND CLEARANCES AT THE SITE AND IN THE BUILDING PRIOR TO COMMENCEMENT OF INSTALLATION.
10. THE CONTRACTOR SHALL SATISFACTORILY REPAIR AND/OR REPLACE EXISTING WORK, FEATURES AND EQUIPMENT DAMAGED AS A RESULT OF HIS WORK. SURFACES AND FINISHES SHALL BE RESTORED TO MATCH ADJACENT SURFACES AND FINISHES.
11. THE CONTRACTOR SHALL INSPECT EXISTING CONDITIONS PRIOR TO BID AND BECOME FAMILIAR WITH THE SCOPE OF WORK. NO EXTRAS WILL BE ALLOWED FOR THE CONTRACTORS FAILURE TO COMPLY WITH THIS REQUIREMENT.
12. ALL PLUMBING FIXTURES SHALL BE SELECTED BY THE OWNER AND INSTALLED BY THE CONTRACTOR. (PLUMBING FIXTURES INDICATED ON DRAWING ARE FOR REFERENCE ONLY, FIXTURES OR EQUAL QUALITY, AND CRAFTSMANSHIP MAY BE USED AS DIRECTED).
13. ALL FIXTURES SHALL BE PROTECTED FROM WATER HAMMER WITH AIR CHAMBER SIZED IN ACCORDANCE WITH P.D.I. STANDARDS. (JOSAN OR EQUAL)
14. PROVIDE CONTROL VALVES TO ALL RISERS, BRANCHES, GROUPS OF FIXTURES AND EACH PIECE OF EQUIPMENT. CONTROL VALVES SHALL BE CAST BRASS OR BRONZE GATE VALVES.
15. PROVIDE FULLY ACCESSIBLE CLEANOUTS ON SANITARY PIPING AT THE BASE OF EACH SOIL AND WASTE PIPE AND AT EACH CHANGE IN ELEVATION.
16. PROVIDE MINIMUM PITCH OF  $\frac{1}{8}"$  PER FOOT FOR ALL HORIZONTAL BRANCHES AND SEWER TRADES.
17. ALL WATER PIPING SHALL BE TYPE M COPPER WITH WROUGHT COPPER SOLDERED JOINT FITTINGS.
18. PROVIDE DIELECTRIC FITTINGS FOR JOINING DISSIMILAR METALS.
19. SANITARY DRAIN PIPING WITHIN THE BUILDING AND BELOW THE GROUND SHALL BE SCHEDULE 40 PVC.
20. WATER HEATER SHALL BEAR LABEL INDICATING COMPLIANCE WITH ASHRAE STD. 90. WATER HEATER SHALL BE EQUIPPED WITH A DRAIN PAN WITH  $\frac{1}{2}"$  MIN. SIDES AND  $2"$  CLEARANCE ON ALL SIDES. PROVIDE  $\frac{3}{4}"$  DRAIN OUTLET LOCATED  $\frac{1}{2}"$  ABOVE BOTTOM OF PAN. P&T RELF VALVE AND DRAIN PAN PIPING SHALL BE TYPE M COPPER.
21. UNDERGROUND PIPING SHALL BE PROTECTED WITH A COAT OF BITUMINOUS COMPOUND.
22. ALL FLOOR DRAINS SHALL HAVE TRAP PRIMERS TO PROTECT TRAP SEAL.
23. ALL VENTS THROUGH ROOF SHALL MAINTAIN MINIMUM  $10'$  HORIZONTAL CLEARANCE FROM ANY MECHANICAL AIR INTAKE.
24. ALL PIPING SHALL BE SUPPORTED RIGIDLY.
25. ALL CUTTING AND NOTCHING REQUIRED FOR THE INSTALLATION OF PLUMBING WORK SHALL BE ACCOMPLISHED IN AN APPROVED MANNER. APPROVAL SHALL BE OBTAINED FROM THE ENGINEER OF RECORD PRIOR TO CUTTING OR DRILLING STRUCTURAL MEMBERS UNLESS SPECIFICALLY ADDRESSED HEREIN.
26. WATER USE FOR PLUMBING FIXTURES SHALL NOT EXCEED THE FOLLOWING:  
WET CLOSETS: 1.6 GALLONS PER FLUSH  
SHOWERS: 2.5 GALLONS PER MINUTE  
FAUCETS: 2.0 GALLONS PER MINUTE  
HOT HOBS SHALL BE PROTECTED BY APPROVED BACK-SIPHONAGE BACKFLOW PREVENTERS.
28. TEST ALL WATER PIPING AT 100 PSI HYDROSTATIC PRESSURE A MINIMUM OF 2 HOURS.
29. TEST ALL SOIL, WASTE AND VENT PIPING WITH A  $10'$  HEAD OF WATER. WATER LEVEL TO REMAIN UNCHANGED FOR 2 HOURS MINIMUM.
30. THE CONTRACTOR SHALL MAINTAIN ONE COMPLETE SET OF DRAWINGS TO INDICATE ALL CHANGES MADE TO THE PLUMBING DESIGN, THE AS-BUILT DRAWINGS SHALL BE DELIVERED TO THE OWNER AFTER COMPLETION OF WORK.

1. THE CONTRACTOR SHALL PROVIDE ALL MATERIAL, LABOR, EQUIPMENT AND SUPERVISION NECESSARY TO PROVIDE THE WORK COMPLETE AND READY TO USE.
2. ALL WORK SHALL BE INSTALLED IN ACCORDANCE WITH THE LATEST EDITION OF THE NATIONAL ELECTRICAL CODE (NEC) AND ALL OTHER APPLICABLE CODES AND STANDARDS.
3. NO PIPE, CONDUIT OR JUNCTION BOX SHALL BE INSTALLED IN STRUCTURAL SLABS, COLUMNS OR BEAMS UNLESS SPECIFICALLY SHOWN ON THE STRUCTURAL DRAWINGS.
4. THE CONTRACTOR IS RESPONSIBLE FOR EVALUATING EXISTING CONDITIONS AT THE SITE AND WITHIN THE BUILDING PRIOR TO BID.
5. THE CONTRACTOR SHALL COORDINATE WITH THE LOCAL UTILITY COMPANY FOR NEW SERVICE AND ANY SPECIAL REQUIREMENTS.
6. ELECTRICAL DRAWINGS (PLANS, DIAGRAMS, ETC.) ARE DIAGRAMMATIC AND SHOULD NOT BE SCALED. THE DRAWINGS DO NOT SHOW EVERY BEND, OFFSET, ELBOW AND OTHER FITTINGS WHICH WILL BE REQUIRED FOR THE PROPER INSTALLATION IN THE SPACE ALLOCATED OR AS REQUIRED TO COORDINATE WORK WITH THAT OF OTHER TRADES. ANY WORK NOT SHOWN BUT CONSIDERED NECESSARY FOR PROPER COMPLETION OF THE WORK SHALL BE PROVIDED WITHOUT ADDITIONAL CHARGES TO THE OWNER.
7. ALL WORK SHALL BE INSTALLED IN A NEAT AND WORKMANLIKE MANNER.
8. THE CONTRACTOR SHALL SATISFACTORILY REPAIR AND/OR REPLACE EXISTING WORK, FEATURES AND/OR EQUIPMENT DAMAGED AS A RESULT OF HIS WORK. SURFACES AND FINISHES SHALL BE RESTORED TO MATCH ADJACENT AREAS.
9. ALL CUTTING AND NOTCHING REQUIRED FOR THE INSTALLATION OF ELECTRICAL WORK SHALL BE ACCOMPLISHED IN AN APPROVED MANNER. APPROVAL SHALL BE OBTAINED FROM THE ENGINEER PRIOR TO CUTTING OR DRILLING STRUCTURAL MEMBERS UNLESS SPECIFICALLY ADDRESSED HEREIN.
10. EXISTING ELECTRICAL WORK, FEATURES AND EQUIPMENT INSTALLED AND/OR REQUIRED TO BE REMOVED FOR THE WORK SHALL BE DISPOSED BY THE CONTRACTOR INCLUDING ABANDONED RACEWAYS, WIRING, BOXES, SWITCHES AND OTHER ELECTRICAL ITEMS NOT PLANNED TO REMAIN IN USE.
11. ALL DEVICE BOXES SHALL BE INSTALLED FLUSH AND CONDUITS RUN CONCEALED IN FINISHED AREAS EXCEPT AS SPECIFICALLY SHOWN OR NOTED OTHERWISE.
12. ALL WIRE SIZE SHALL BE #12 THW/THHN UNLESS OTHERWISE NOTED ON DRAWINGS.
13. CONDUCTORS #6 AND LARGER SHALL BE THW.
14. ALL CONDUCTORS SHALL BE COPPER.
15. ALL MATERIAL SHALL BE UL APPROVED.
16. A TYPEWRITTEN PANEL TALLY SHALL BE AFFIXED TO THE PANEL DOOR AFTER COMPLETION OF WORK THAT REFLECTS ALL CHANGES AND ADDITIONS.
17. ALL BRANCH CIRCUITS SHALL BE PROPERLY PHASE BALANCED.
18. ALL FLOOR PENETRATIONS SHALL BE SEALED WITH A FIRE SEAL SIMILAR TO "OZ" FLAMESEAL.
19. ALL NON-POWER RELATED WIRING IN CEILING A/C PLenum RUNNING WITHOUT CONDUIT SHALL BE TEFELON COVERED CLAMPED FOR USE IN PLenums.
20. ALL OUTLETS, SWITCHES AND COVER PLATES SHALL HAVE WHITE FINISH OR OTHER COLOR SELECTED BY OWNER AND LEVITON 5350/5252 SERIES OR EQUAL.
21. ALL BRANCH CIRCUITS SHALL BE EQUIPPED WITH A GREEN EQUIPMENT GROUNDING CONDUCTOR SIZED IN ACCORDANCE WITH NEC 250.95.
22. ALL EQUIPMENT CONDUITS SHALL BE PROVIDED WITH NYLON PULP STRINGS.
23. FUSES SHALL BE DUAL ELEMENT, TIME DELAY, UNLESS OTHERWISE NOTED.
24. ALL EQUIPMENT SHALL BE PROPERLY MOUNTED IN ACCORDANCE WITH CEILING MANUFACTURER RECOMMENDATIONS IF APPLICABLE AND LOCAL REQUIREMENTS. MOUNTING DEVICES MUST BE CAPABLE OF SUPPORTING CEILING FAN FIXTURES.
25. ALL RECESS CANS SHALL BE IC RATED, AND CONTROLLED BY DIMMER SWITCHES.
26. ALL CABLES SHALL BE RUN WITHOUT SPLICES UNLESS OTHERWISE NOTED.
27. PROVIDE REQUIRED CONNECTION FOR GARAGE DOOR OPERATOR(S), KITCHEN APPLIANCES, AND REFRIGERATOR EQUIPMENT.
28. ALL BATHROOM, GARAGE AND EXTERIOR RECEPTACLE OUTLETS AND KITCHEN RECEPTACLE OUTLETS WITHIN 6' OF WATER SOURCE SHALL BE GFI PROTECTED. ALL EXTERIOR RECEPTACLE OUTLETS SHALL BE WATER-SOURCE PROTECTED. ALL BEDROOM RECEPTACLE OUTLETS SHALL BE ARC FAULT PROTECTED IN ACCORDANCE WITH NEC 210-12.
29. THE CONTRACTOR SHALL MAINTAIN ONE COMPLETE SET OF DRAWINGS TO INDICATE ALL CHANGES MADE TO THE DESIGN. THE AS-BUILT DRAWINGS SHALL BE DELIVERED TO THE OWNER AFTER COMPLETION OF THE WORK.
30. ALL SMOKE DETECTORS SHALL BE WIRED IN TANDEM.

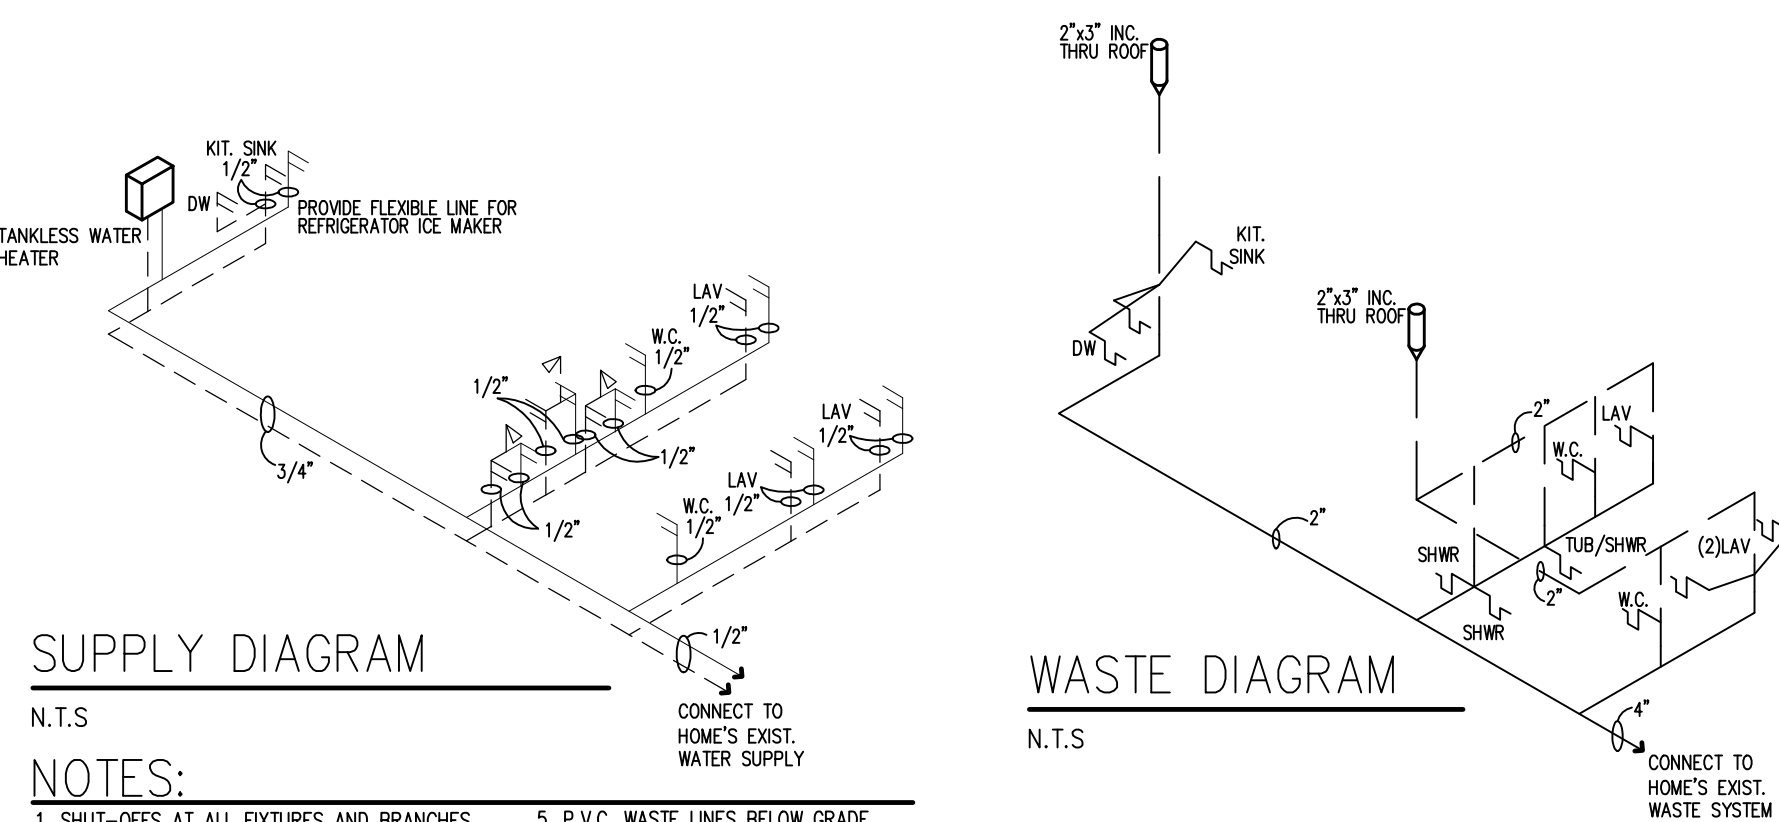


NOTES:

1. SHUT-OFFS AT ALL FIXTURES AND BRANCHES.
2. ABOVE GRADE WATER PIPING, COPPER.
3. BELOW GRADE WATER PIPING, COPPER.
4. P.V.C. WASTE LINES ABOVE GRADE.

2 MECHANICAL PLAN  
A-4 SCALE: 1/4" = 1'-0"

1 ELECTRICAL PLAN  
A-4 SCALE: 1/4" = 1'-0"

RESIDENTIAL RENOVATION  
HARC SUBMITTAL

AutoCad File No.

Revisions:  
TO HARC 11-12-14

Title:

ELECTRICAL  
MECHANICAL AND  
PLUMBING PLAN

Sheet Number:  
**MEP-1**  
Date: NOVEMBER 3, 2014

# NOTICING

# Public Meeting Notice

The Historic Architectural Review Commission will hold a public hearing at 5:30 p.m., November 25, 2014 at Old City Hall, 510 Greene Street, Key West, Florida. The purpose of the hearing will be to consider a request for:

**ADD NEW “SAWTOOTH” ROOF TO REAR PORTION OF CONTRIBUTING HOUSE, EXTENSION OF EXISTING SHED ROOF, AND NEW POOL. DEMOLITION OF HISTORIC HIP AND SHED ROOFS ON A CONTRIBUTING HOUSE.**

**FOR- #614 FRANCES STREET**

**Applicant – Meridian Engineering**

**Application # H14-01-1744**

If you wish to see the application or have any questions, you may visit the Planning Department during regular office hours at 3140 Flagler Avenue, call 809-3973 or visit our website at [www.keywestcity.com](http://www.keywestcity.com).

**THIS NOTICE CAN NOT BE REMOVED FROM THE SITE UNTIL HARC FINAL DETERMINATION**



# PROPERTY APPRAISER INFORMATION



**Scott P. Russell, CFA**  
**Property Appraiser**  
**Monroe County, Florida**

Key West (305) 292-3420  
Marathon (305) 289-2550  
Plantation Key (305) 852-7130

## Property Record Card -

**Maps are now launching the new map application version.**

**Alternate Key: 1010944 Parcel ID: 00010650-000000**

### Ownership Details

**Mailing Address:**

ROSS ELIZABETH  
1015 FLEMING ST  
KEY WEST, FL 33040-6962

### Property Details

**PC Code:** 08 - MULTI FAMILY LESS THAN 10UNITS

**Millage Group:** 10KW


**Affordable  
Housing:** No

**Section-  
Township-Range:** 06-68-25

**Property  
Location:** 614 FRANCES ST KEY WEST

**Legal** KW PT LOT 2 SQR 56 G22-335/38 OR722-656 OR859-959/1708 OR1279-634/635 OR1279-638/43-RESO 93-482  
**Description:** OR1279-634/35Q/C OR1279-636/637Q/C OR1279-644/48AFF OR1284-1804/05C OR1286-2179/85-E OR2185-2036  
OR2399-104/107 OR2423-2104/06

**Click Map Image to open interactive viewer**

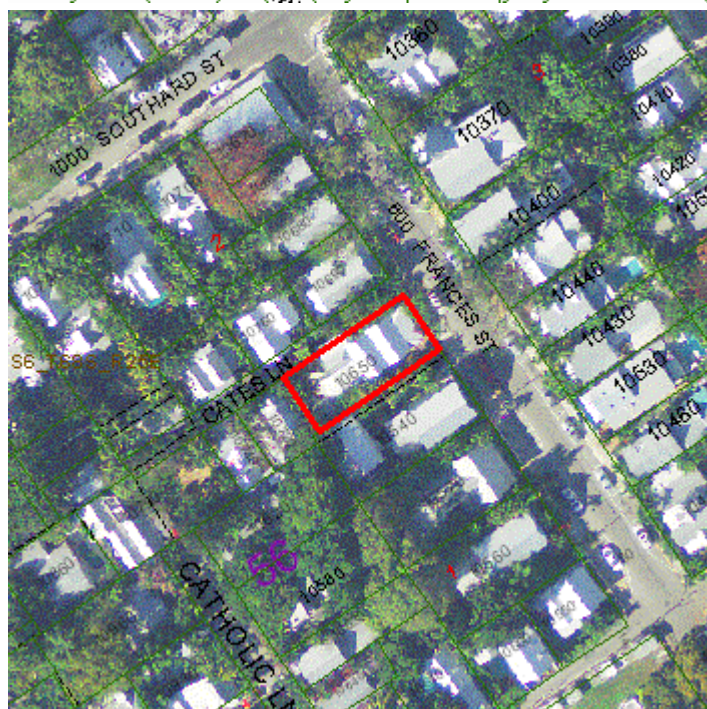

## Land Details

Land Use Code	Frontage	Depth	Land Area
010D - RESIDENTIAL DRY	40	90	3,627.00 SF

## Building Summary

Number of Buildings: 1  
 Number of Commercial Buildings: 0  
 Total Living Area: 1390  
 Year Built: 1933

## Building 1 Details

Building Type R3

Effective Age 23

Year Built 1933

Functional Obs 0

Condition G

Perimeter 216

Special Arch 0

Economic Obs 0

Quality Grade 450

Depreciation % 30

Grnd Floor Area 1,390

Inclusions: R3 includes 3 3-fixture baths and 3 kitchens.

Roof Type GABLE/HIP

Heat 1 FCD/AIR DUCTED

Heat Src 1 ELECTRIC

Roof Cover METAL

Heat 2 NONE

Heat Src 2 NONE

Foundation WD CONC PADS

Bedrooms 3

### Extra Features:

2 Fix Bath 0

3 Fix Bath 0

4 Fix Bath 0

5 Fix Bath 0

6 Fix Bath 0

7 Fix Bath 0

Extra Fix 2

Vacuum 0

Garbage Disposal 0


Compactor 0

Security 0

Intercom 0

Fireplaces 0

Dishwasher 0

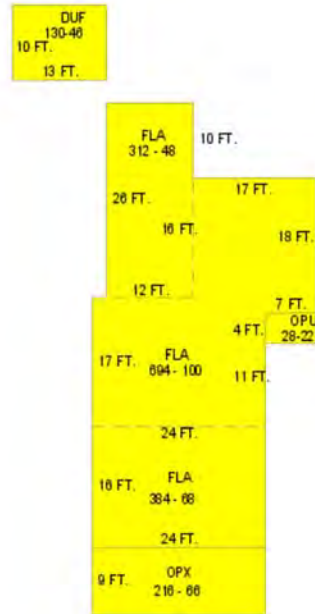

### Sections:

Nbr	Type	Ext Wall	# Stories	Year Built	Attic A/C	Basement %	Finished Basement %	Area
1	FLA	12:ABOVE AVERAGE WOOD	1	1933	N Y	0.00	0.00	384
2	OPU		1	1992	N Y	0.00	0.00	28
4	DUF	1:WD FRAME/COMPOSITE	1	1992	N Y	0.00	0.00	130
5	OPX		1	1933				216
6	FLA	12:ABOVE AVERAGE WOOD	1	1933	Y			694

7	<u>FLA</u>	12:ABOVE AVERAGE WOOD	1	1933	Y	312
---	------------	--------------------------	---	------	---	-----

## Misc Improvement Details

Nbr	Type	# Units	Length	Width	Year Built	Roll Year	Grade	Life
2	FN2:FENCES	156 SF	26	6	1982	1983	2	30
3	WD2:WOOD DECK	1,111 SF	0	0	1982	1983	2	40
5	FN2:FENCES	140 SF	35	4	2000	2001	2	30
6	PT2:BRICK PATIO	275 SF	11	25	2000	2001	2	50

## Building Permits

Bldg	Number	Date Issued	Date Completed	Amount	Description	Notes
	12-1219	04/11/2012	10/11/2012	5,500		1200sf OF MAINT & PAINT 5SQRS VCRIMP
	M953348	10/01/1995	12/01/1995	3,200		3.5 TON AC
	E953776	11/01/1995	12/01/1995	2,000		ELECTRICAL
	P953981	11/01/1995	12/01/1995	800		FIXTURES
	0004322	12/21/2000	11/02/2001	500		REPAIRS TO PORCH
	03-0924	03/18/2003	08/08/2003	1,500		REPAIR SEWER

## Parcel Value History

Certified Roll Values.

[View Taxes for this Parcel.](#)

Roll Year	Total Bldg Value	Total Misc Improvement Value	Total Land Value	Total Just (Market) Value	Total Assessed Value	School Exempt Value	School Taxable Value
2014	149,189	7,800	237,568	394,557	394,557	0	394,557
2013	153,452	7,857	220,993	382,302	299,767	25,000	310,158
2012	155,583	7,913	119,705	283,201	283,200	25,000	258,201
2011	155,583	7,973	165,745	329,301	321,876	25,000	304,301
2010	159,846	8,158	117,863	285,867	285,867	0	285,867
2009	201,417	8,215	316,249	525,881	525,881	0	525,881
2008	185,236	8,275	362,700	556,211	556,211	0	556,211
2007	218,051	8,317	598,455	824,823	824,823	0	824,823
2006	373,864	5,577	344,565	724,006	724,006	0	724,006
2005	373,864	5,773	272,025	651,662	494,610	25,000	469,610
2004	204,813	6,030	253,890	464,733	360,482	25,000	335,482
2003	197,227	6,220	126,945	330,392	272,071	25,000	247,071
2002	221,360	6,482	97,929	325,771	267,724	25,000	242,724
2001	177,657	6,672	97,929	282,258	238,559	25,000	213,559
2000	185,427	7,261	68,913	261,601	221,048	25,000	196,048
1999	148,921	6,034	68,913	223,869	195,181	25,000	170,181

<b>1998</b>	126,508	5,139	68,913	200,560	179,248	25,000	154,248
<b>1997</b>	117,472	4,922	61,659	184,053	167,701	25,000	142,701
<b>1996</b>	77,454	3,542	61,659	142,655	139,393	25,000	114,393
<b>1995</b>	69,374	3,192	61,659	134,225	132,775	25,000	107,775
<b>1994</b>	62,042	2,962	61,659	126,664	126,664	25,000	101,664
<b>1993</b>	62,042	3,050	61,200	126,293	126,293	25,000	101,293
<b>1992</b>	74,892	2,633	61,200	138,726	138,726	25,000	113,726
<b>1991</b>	74,892	2,701	61,200	138,793	138,793	25,000	113,793
<b>1990</b>	68,542	2,796	54,900	126,238	126,238	25,000	101,238
<b>1989</b>	89,198	2,602	54,000	145,800	145,800	25,000	120,800
<b>1988</b>	39,064	2,289	41,400	82,753	82,753	25,000	57,753
<b>1987</b>	38,570	2,343	24,660	65,573	65,573	25,000	40,573
<b>1986</b>	38,780	2,410	23,760	64,950	64,950	25,000	39,950
<b>1985</b>	37,565	2,459	17,949	57,973	57,973	25,000	32,973
<b>1984</b>	35,000	2,530	17,949	55,479	55,479	25,000	30,479
<b>1983</b>	35,000	359	17,949	53,308	53,308	25,000	28,308
<b>1982</b>	26,243	359	17,949	44,551	44,551	25,000	19,551

## Parcel Sales History

NOTE: Sales do not generally show up in our computer system until about two to three months after the date of sale. If a recent sale does not show up in this list, please allow more time for the sale record to be processed.

Thank you for your patience and understanding.

<b>Sale Date</b>	<b>Official Records Book/Page</b>	<b>Price</b>	<b>Instrument</b>	<b>Qualification</b>
<b>6/30/2009</b>	2423 / 2104	620,000	<u>WD</u>	<u>02</u>
<b>1/30/2009</b>	2399 / 104	948,000	<u>WD</u>	<u>12</u>
<b>2/8/2006</b>	2185 / 2036	1,185,000	<u>WD</u>	<u>Q</u>
<b>7/1/1982</b>	959 / 1708	70,000	<u>WD</u>	<u>Q</u>
<b>2/1/1977</b>	T) /	25,000	00	<u>Q</u>

This page has been visited 44,970 times.

Monroe County Monroe County Property Appraiser  
 Scott P. Russell, CFA  
 P.O. Box 1176 Key West, FL 33041-1176