



Historic Architectural Review Commission Staff Report for Item 10

To: Chairman Bryan Green and Historic Architectural Review
Commission Members

From: Enid Torregrosa-Silva, MSHP
Historic Preservation Planner

Meeting Date: February 24, 2021

Applicant: Paul Earle, Owner

Application Number: H2021-0003

Address: 1122 Stump Lane

Description of Work:

After-The-Fact demolition of historic elements.

Site Facts:

The house under review is a historic and contributing resource to the historic district. The one-story frame vernacular house was built circa 1889 and has kept its original form until between 1912 and 1926 when the front porch was added. At some point in time, and before 1965 the front porch deck was changed to concrete and board and batted siding was covered with asbestos siding. Also, windows were changed to jalousie units after 1965.

In December 30, 2020 the Building Department issued a Stop Work Order as contractor exceeded his permits for interior exploratory and interior permits. Footers were demolished and new footers were poured without any permits or approvals and were inspected as final. Asbestos siding has been removed and front columns were cut as the new footers are higher than the previous ones and the front concrete porch deck was kept on its location.

Ordinance Cited on Review:

- Section 102-217 (4), demolition for contributing or historic structures of the Land Development Regulations for façade at 419 Southard Street.

Staff Analysis:

The Certificate of Appropriateness under review is for the after the fact removal of portions of wooden front porch posts. It is staff's opinion that the request for this demolition should be reviewed based by the demolition criteria of Chapter 102 Section 218 of the LDR's. The criteria state the following;

(a) The historic architectural review commission shall issue a certificate of appropriateness for an application for demolition:

- 1. If the subject of the application is a contributing or historic building or structure, then it should not be demolished unless its condition is irrevocably compromised by extreme deterioration or it does not meet any of the criteria of section 102-125(1) through (9).*

The existing poles were in good condition and they were cut as the building was elevated for new and taller footers.

As staff understands that there was no extreme deterioration on the elements that were demolished, therefore the following criteria under section 102-125 must be applied to this review:

- 1 Embodies no distinctive characteristics of a type, period, or method of construction of aesthetic or historic significance in the city and is not a significant and distinguishable building entity whose components may lack individual distinction;*

Staff cannot attest to the date where the posts were installed. Nevertheless, these are part of the front porch which is a character defining feature of the house.

- 2 Is not specifically associated with events that have made a significant contribution to local, state, or national history;*

It is staff understanding that no significant events have ever happened in the site that has contributed to local, state, or national history.

- 3 Has no significant character, interest, or value as part of the development, heritage, or cultural characteristics of the city, state or nation, and is not associated with the life of a person significant in the past;*

Staff cannot attest to this.

- 4 Is not the site of a historic event with a significant effect upon society;*

It is staff's understanding that the site is not associated to any significant event.

- 5 Does not exemplify the cultural, political, economic, social, or historic heritage of the city;*

Wooden posts are an integral part of the front porch and should have been disconnected from the porch floor when the house was elevated. The house has plenty front yard to install reinforced elements.

- 6 *Does not portray the environment in an era of history characterized by a distinctive architectural style;*

Staff cannot affirm this.

- 7 *If a part of or related to a square, park, or other distinctive area, nevertheless should not be developed or preserved according to a plan based on the area's historic, cultural, natural, or architectural motif;*

This is not the case.

- 8 *Does not have a unique location or singular physical characteristic which represents an established and familiar visual feature of its neighborhood or of the city, and does not exemplify the best remaining architectural type in a neighborhood; and*

The columns have not of significant physical qualities, but rather they are of a traditional design.

- 9 *Has not yielded, and is not likely to yield, information important in history.*

Staff cannot attest to this.

The partial cut of historic columns on the front porch was unnecessary and put in risk the integrity of the front porch. If approved this will be the first of two readings.

APPLICATION



HARC MAJOR PROJECTS CERTIFICATE OF APPROPRIATENESS

A pre-application meeting with HARC staff is *required* prior to submittal

\$420 Non-Refundable Base Application Fee - Other Fees May Be Applicable

City of Key West

1300 WHITE STREET
KEY WEST, FLORIDA

HARC COA # <i>2021-0003</i>	REVISION #	INITIAL & DATE <i>PE 1-24-21</i>
FLOOD ZONE <i>AE-8</i>	ZONING DISTRICT <i>HH OR</i>	BLDG PERMIT # <i>BLDG 2020-2313</i>

ADDRESS OF PROPOSED PROJECT:

1122 STUMP LN Key West

NAME ON DEED:

1122 Porch Properties LLC PHONE NUMBER *205-541-2398*

OWNER'S MAILING ADDRESS:

1117 STUMP LN Key West EMAIL *paulearle13@gmail.com*

APPLICANT NAME:

PAUL EARLE PHONE NUMBER *205-541-2398*

APPLICANT'S ADDRESS:

1117 STUMP LN Key West EMAIL *paulearle13@gmail.com*

APPLICANT'S SIGNATURE:

Paul Earle

DATE *1-23-21*

ANY PERSON THAT MAKES CHANGES TO AN APPROVED CERTIFICATE OF APPROPRIATENESS MUST SUBMIT A NEW APPLICATION.

FLORIDA STATUTE 837.06: WHOEVER KNOWINGLY MAKES A FALSE STATEMENT IN WRITING AND WITH THE INTENT TO MISLEAD A PUBLIC SERVANT IN THE PERFORMANCE OF HIS OR HER OFFICIAL DUTY SHALL BE GUILTY OF A MISDEMEANOR OF THE SECOND-DEGREE PUNISHABLE PER SECTION 775.082 OR 775.083.

THE APPLICANT FURTHER HEREBY ACKNOWLEDGES THAT THE SCOPE OF WORK AS DESCRIBED IN THE APPLICATION SHALL BE THE SCOPE OF WORK THAT IS CONTEMPLATED BY THE APPLICANT AND THE CITY. THE APPLICANT FURTHER STIPULATES THAT SHOULD FURTHER ACTION BE TAKEN BY THE CITY FOR EXCEEDING THE SCOPE OF THE DESCRIPTION OF WORK, AS DESCRIBED HEREIN, AND IF THERE IS CONFLICTING INFORMATION BETWEEN THE DESCRIPTION OF WORK AND THE SUBMITTED PLANS, THE AFOREMENTIONED DESCRIPTION OF WORK SHALL BE CONTROLLING.

PROJECT INCLUDES: REPLACEMENT OF WINDOWS RELOCATION OF A STRUCTURE ELEVATION OF A STRUCTURE

PROJECT INVOLVES A CONTRIBUTING STRUCTURE: YES NO INVOLVES A HISTORIC STRUCTURE: YES NO

PROJECT INVOLVES A STRUCTURE THAT IS INDIVIDUALLY LISTED ON THE NATIONAL REGISTER: YES NO

DETAILED PROJECT DESCRIPTION INCLUDING MATERIALS, HEIGHT, DIMENSIONS, SQUARE FOOTAGE, LOCATION, ETC.

GENERAL: *Exterior Renovation to include siding, doors, windows and raise approx 9" with new piers.*

Interior Renovation to include floor, sheetrock, kitchen, bathroom and walls. to include new electric & plumbing

MAIN BUILDING:

DEMOLITION (PLEASE FILL OUT AND ATTACH DEMOLITION APPENDIX):

N/A

HARC MAJOR PROJECTS CERTIFICATE OF APPROPRIATENESS

ACCESSORY STRUCTURE(S): <i>N/A</i>	
PAVERS: <i>N/A</i>	FENCES: <i>N/A</i>
DECKS: <i>N/A</i>	PAINTING: <i>YES</i>
SITE (INCLUDING GRADING, FILL, TREES, ETC.): <i>N/A</i>	POOLS (INCLUDING EQUIPMENT): <i>N/A</i>
ACCESSORY EQUIPMENT (GAS, A/C, VENTS, ETC.): <i>HVAC Ductless</i>	OTHER: <i>New wood Front Porch</i>

APPLICATIONS MUST BE SUBMITTED IN PERSON WITH HARD COPIES BY 3PM ON THE SCHEDULED DEADLINE
PLEASE SEND AN ELECTRONIC COPY OF ALL DOCUMENTS: City_HARC@CITYOFKEYWEST-FL.GOV

OFFICIAL USE ONLY:	HARC COMMISSION REVIEW	EXPIRES ON:
MEETING DATE:	<input type="checkbox"/> APPROVED <input type="checkbox"/> NOT APPROVED <input type="checkbox"/> DEFERRED FOR FUTURE CONSIDERATION	INITIAL:
MEETING DATE:	<input type="checkbox"/> APPROVED <input type="checkbox"/> NOT APPROVED <input type="checkbox"/> DEFERRED FOR FUTURE CONSIDERATION	INITIAL:
MEETING DATE:	<input type="checkbox"/> APPROVED <input type="checkbox"/> NOT APPROVED <input type="checkbox"/> DEFERRED FOR FUTURE CONSIDERATION	INITIAL:
REASONS OR CONDITIONS:		
STAFF REVIEW COMMENTS:		
FIRST READING FOR DEMO:	SECOND READING FOR DEMO:	
HARC STAFF SIGNATURE AND DATE:	HARC CHAIRPERSON SIGNATURE AND DATE:	


SANBORN MAPS

TE


50'

KEY WEST
FLA.

80'

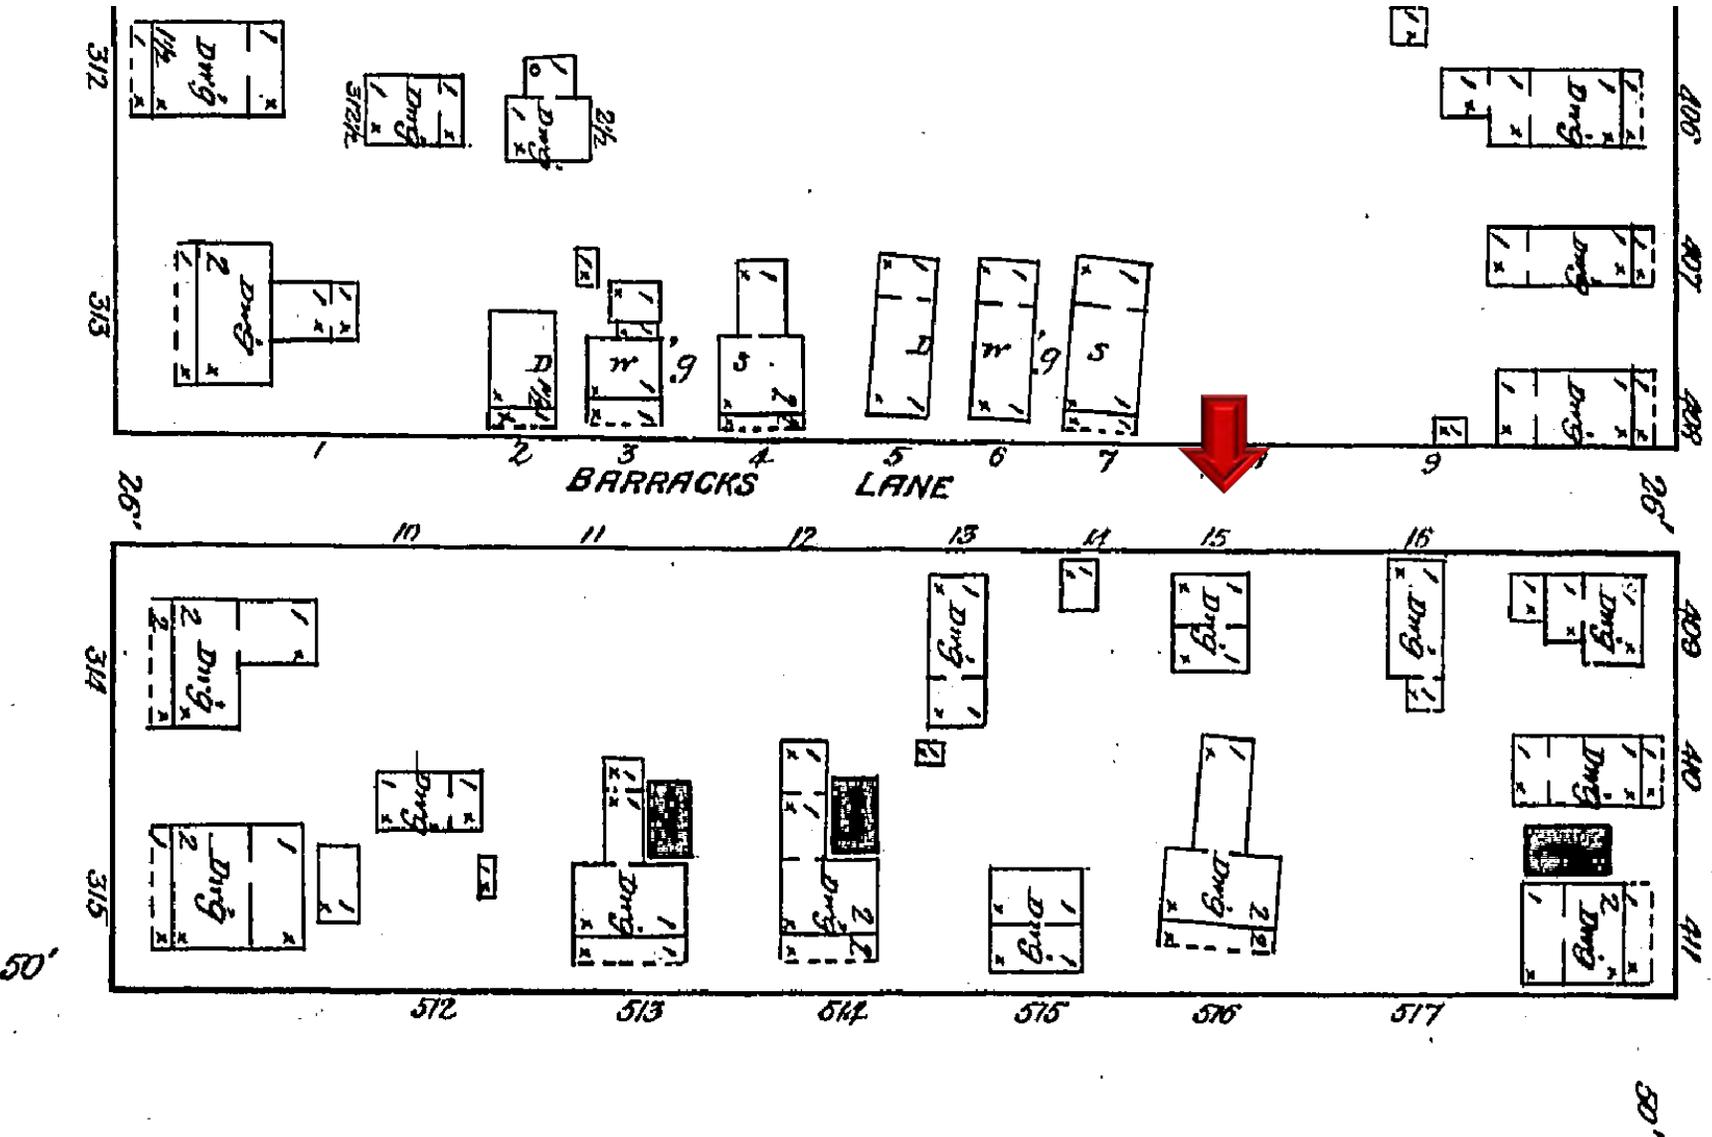


1889 Sanborn Map

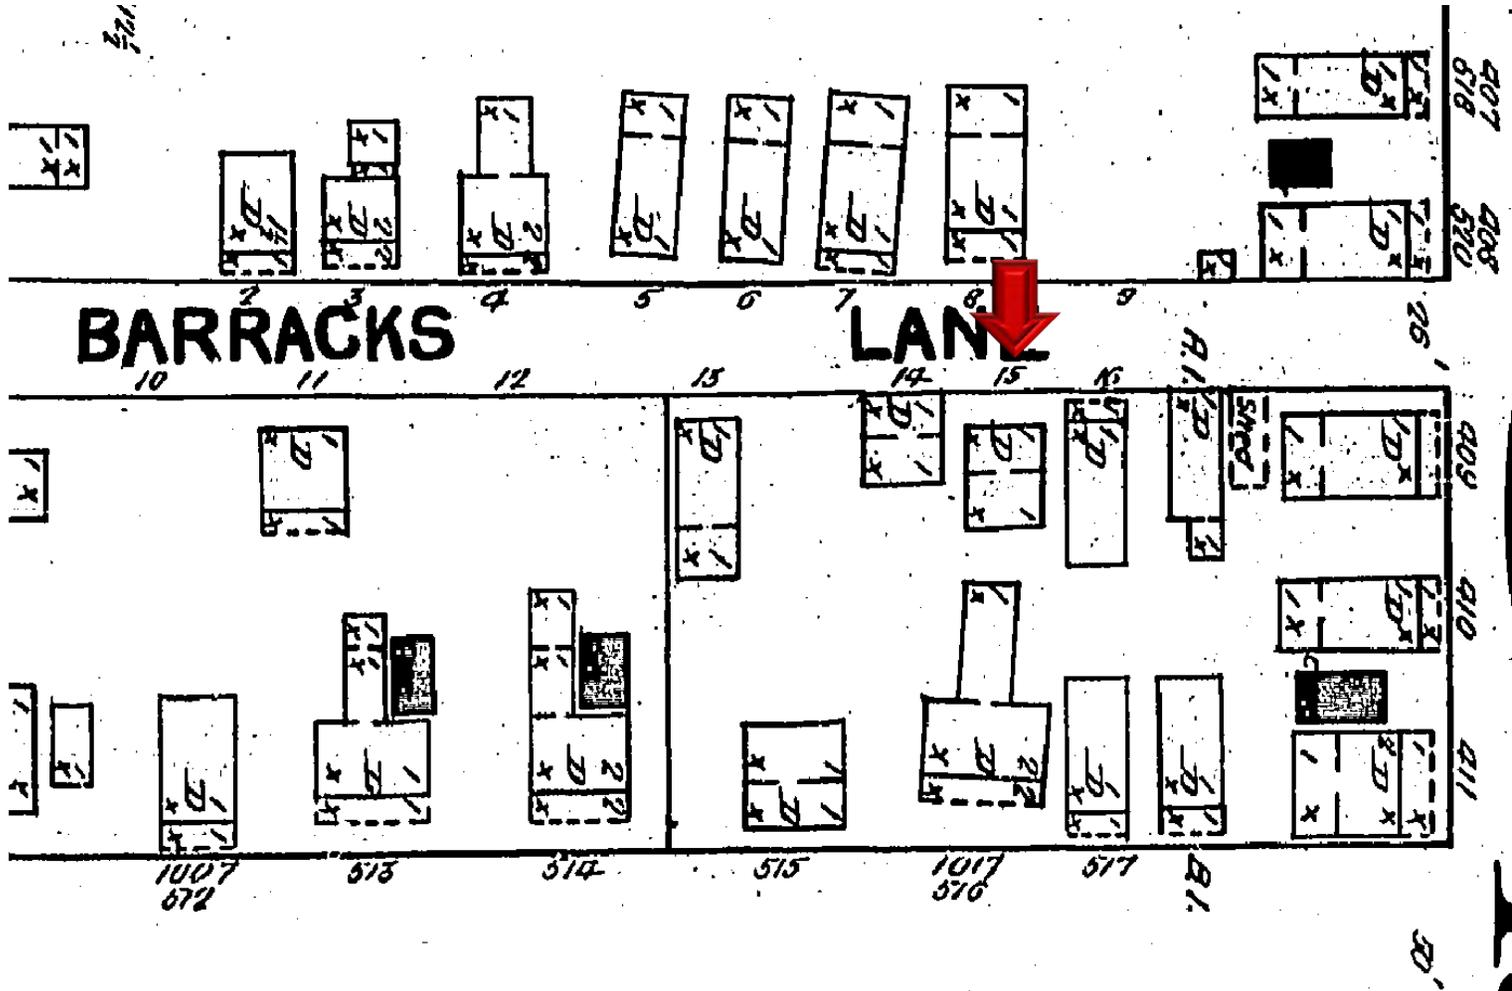


KEY WEST
FLA.


1892 Sanborn Map

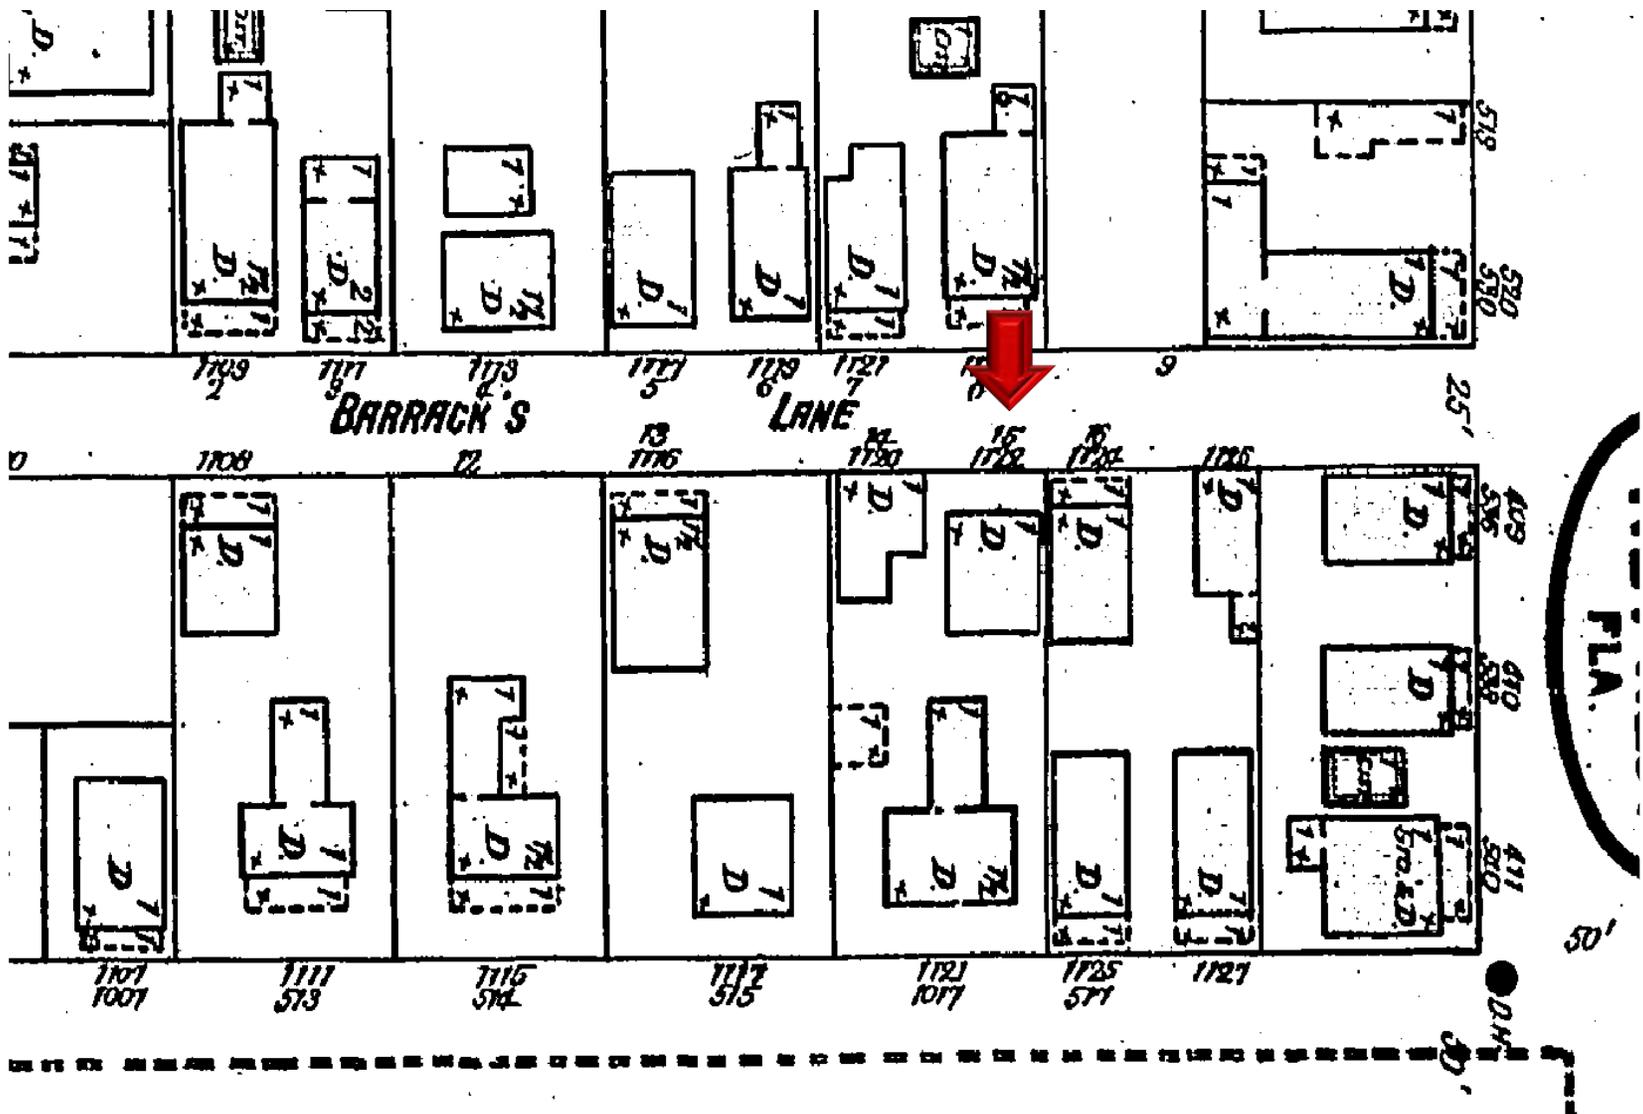


1899 Sanborn Map

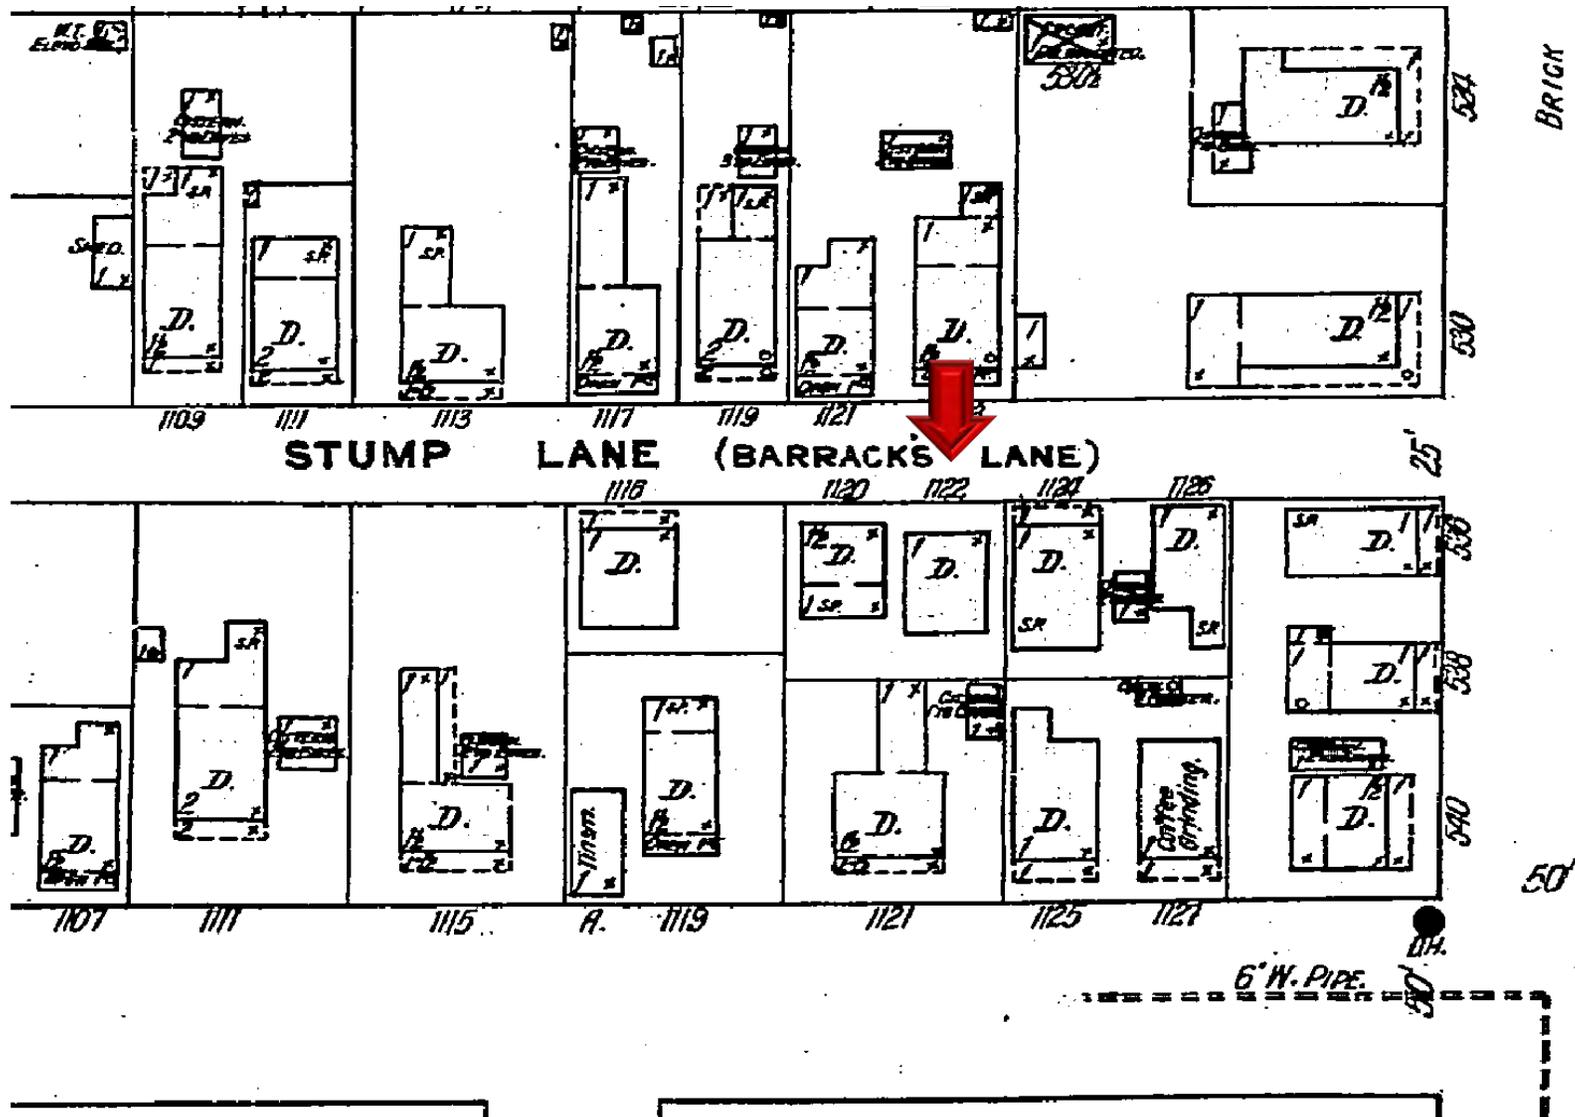


1912 Sanborn Map

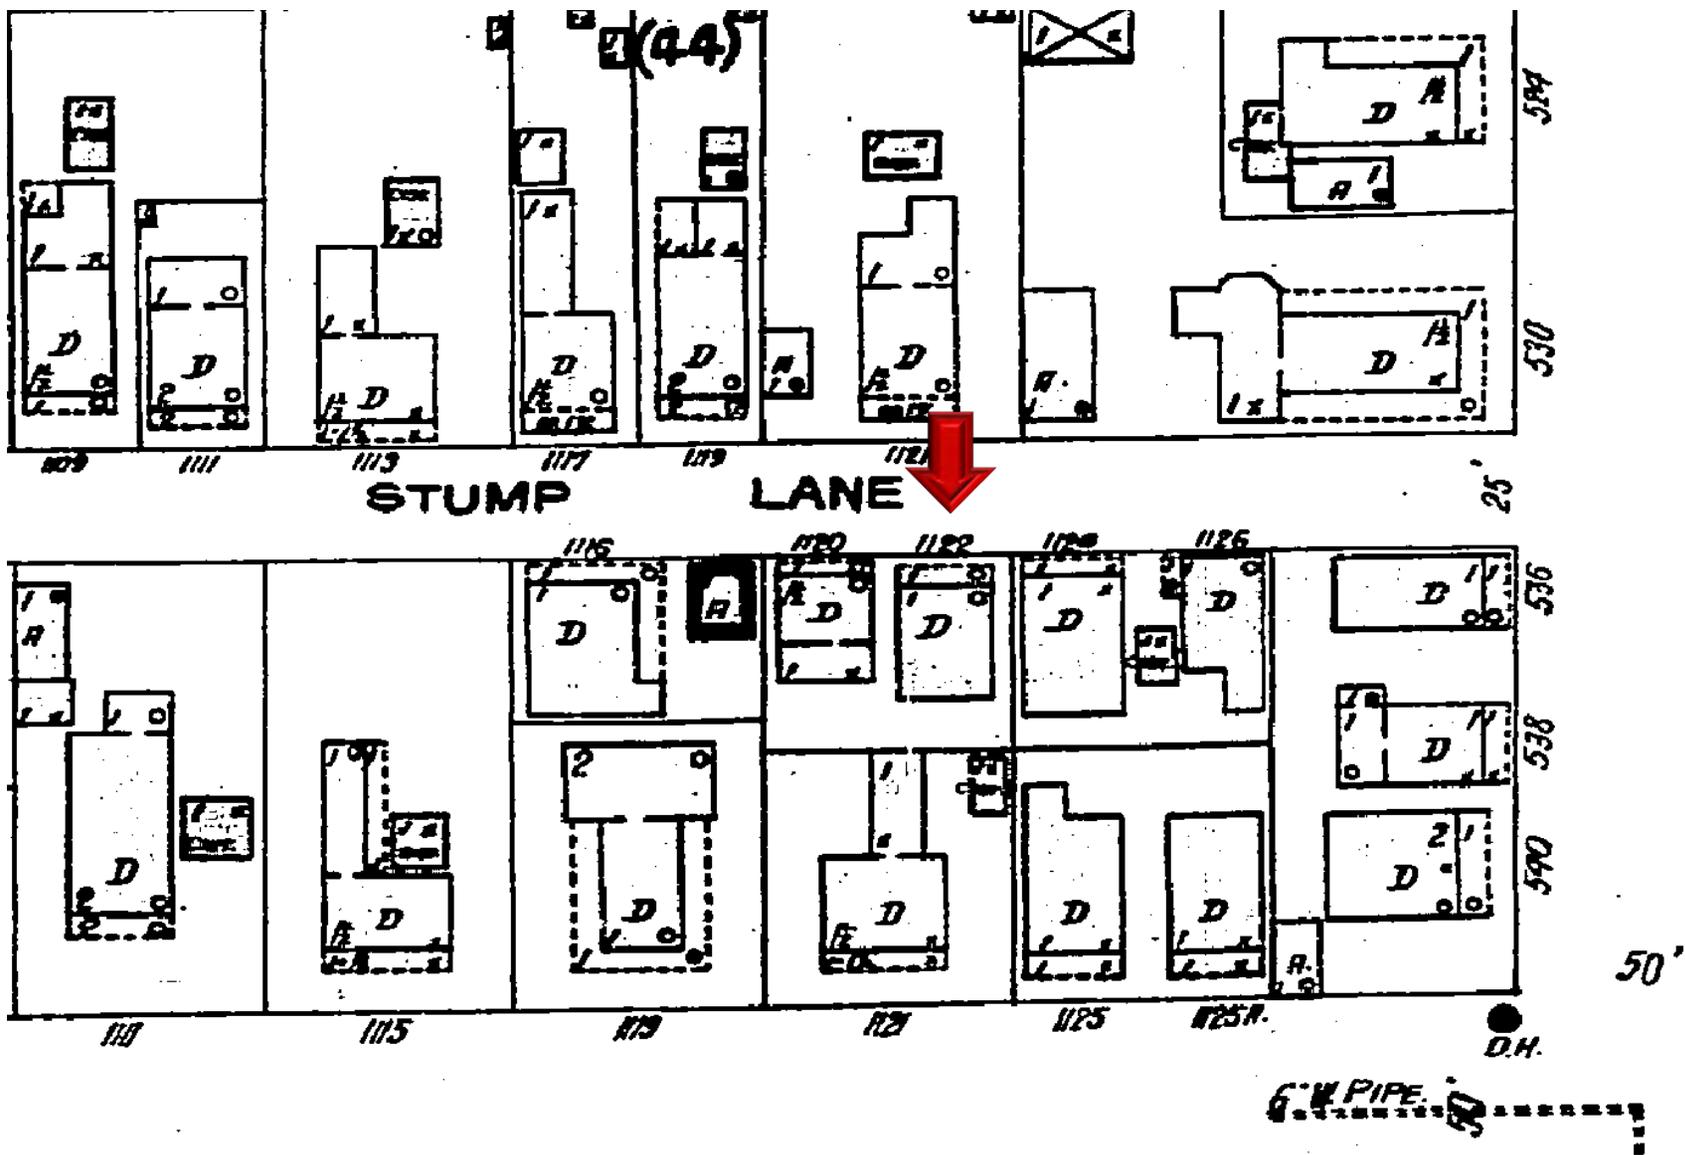

1926 Sanborn Map

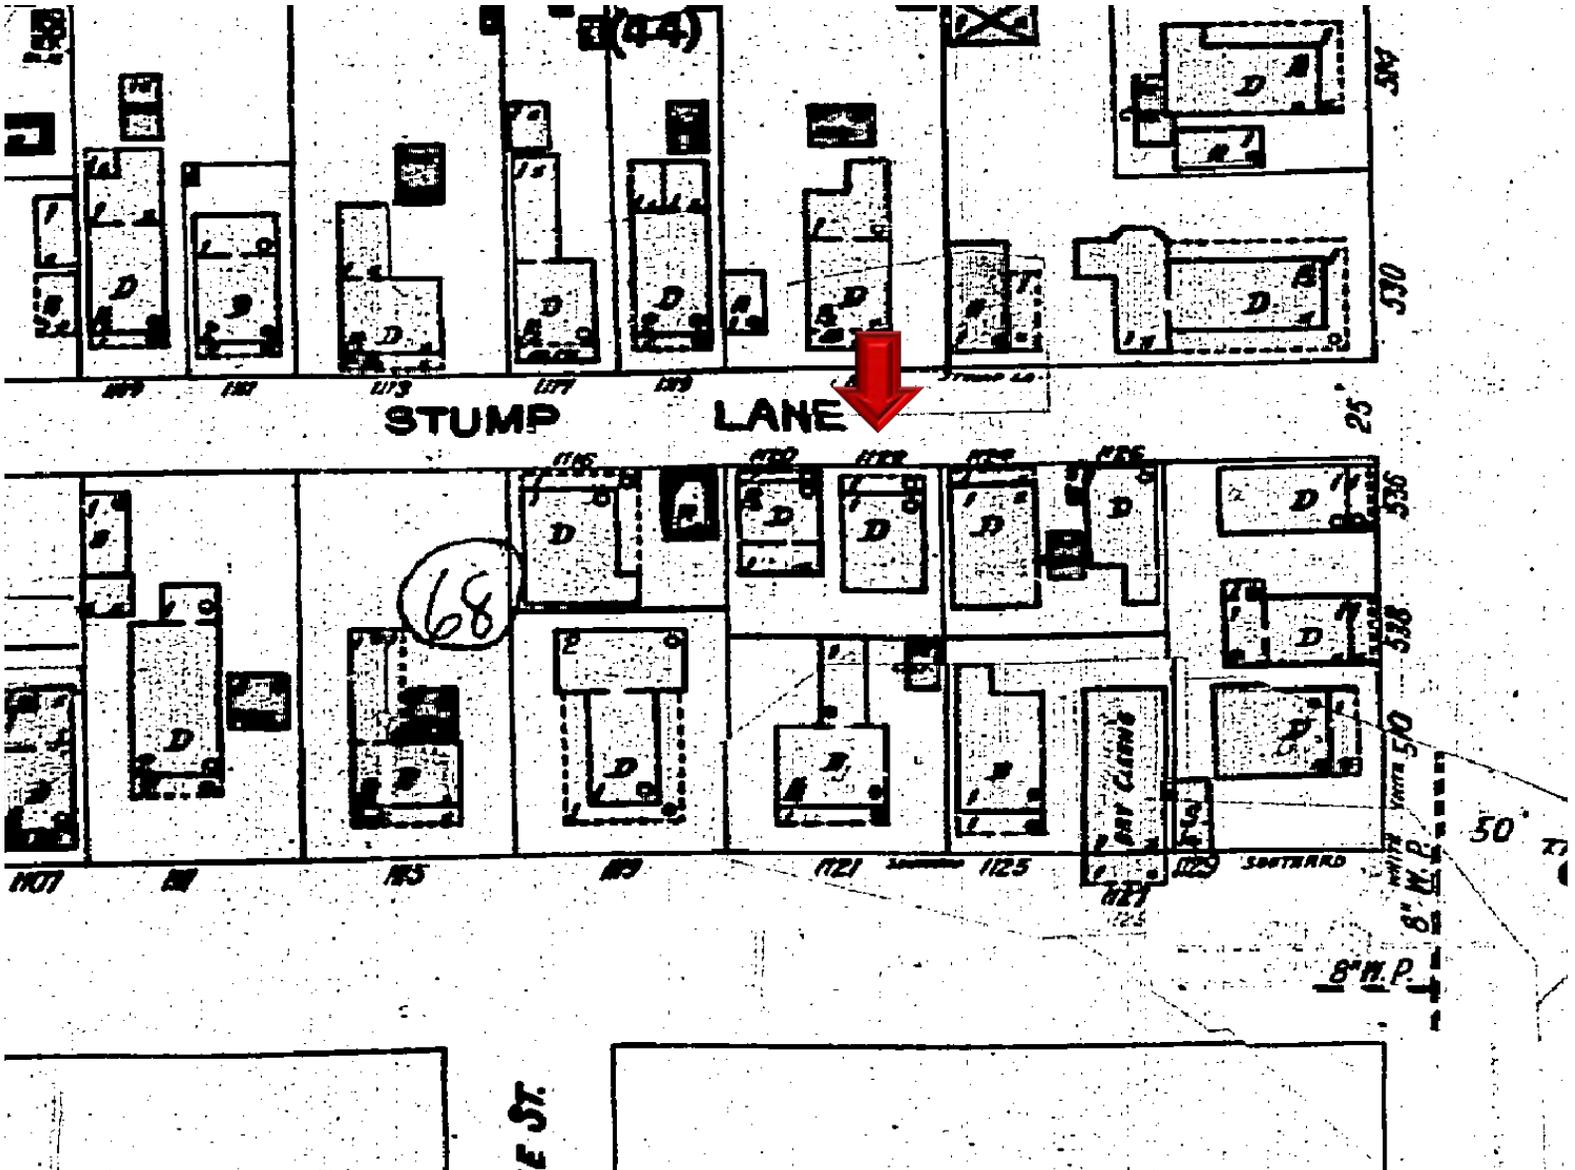

1948 Sanborn Map

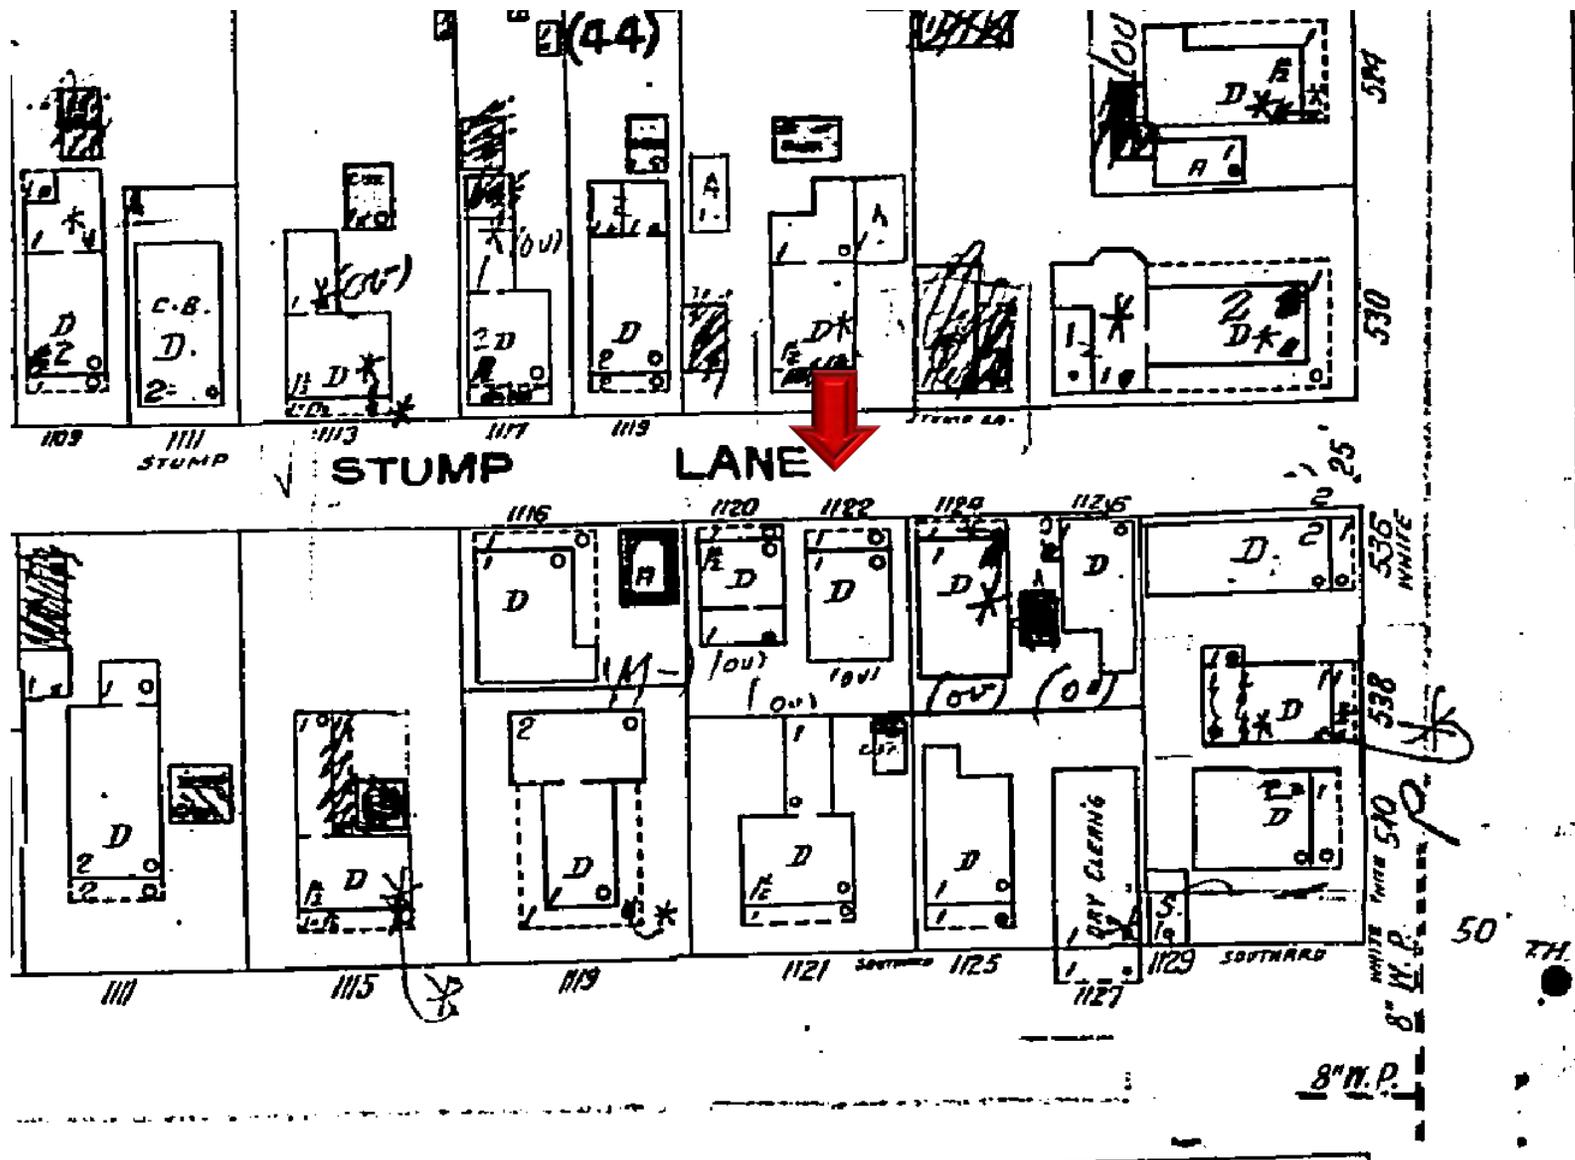

1962 Sanborn Map

PROJECT PHOTOS



1122 Stump Lane circa 1965. Monroe County Library.



Before work done.



Before work done.




Before work done.



Before work done.



Before work done.

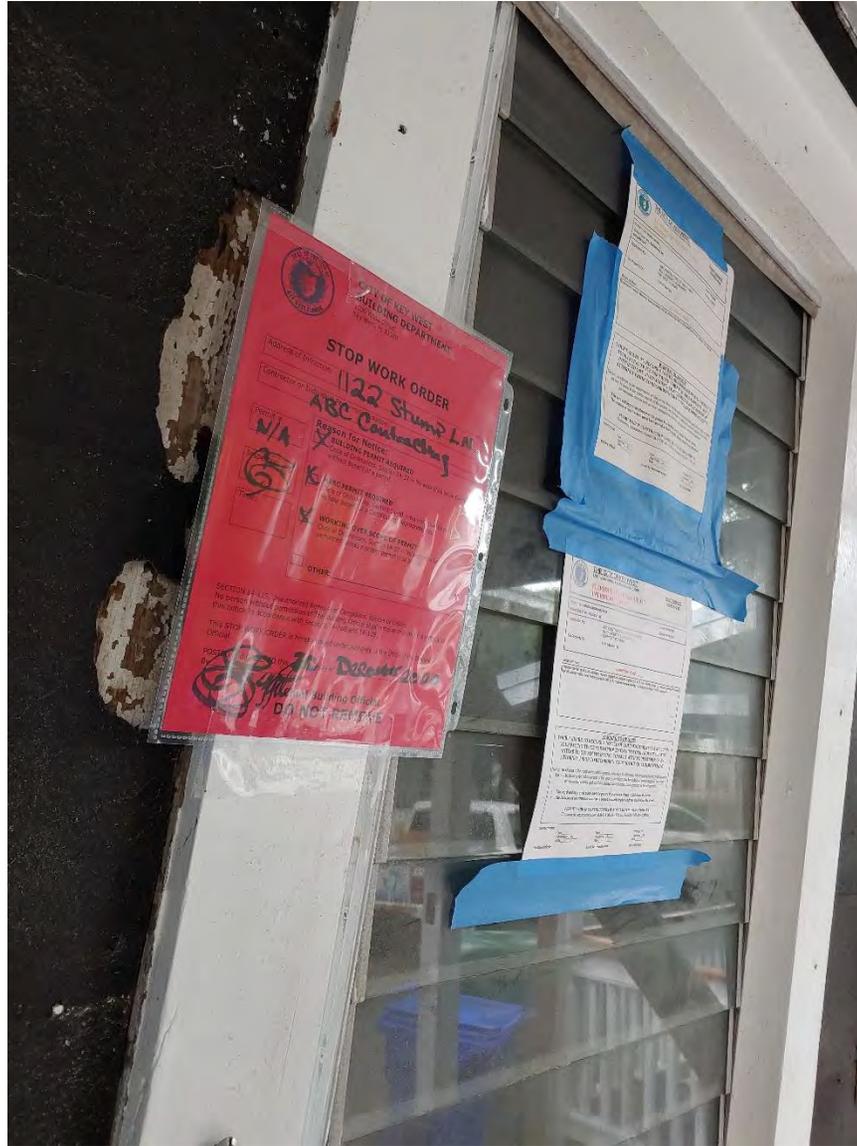

Stop Work Order.




















SURVEY

ASPHALT PAVEMENT

STUMP LANE (26' R/W)

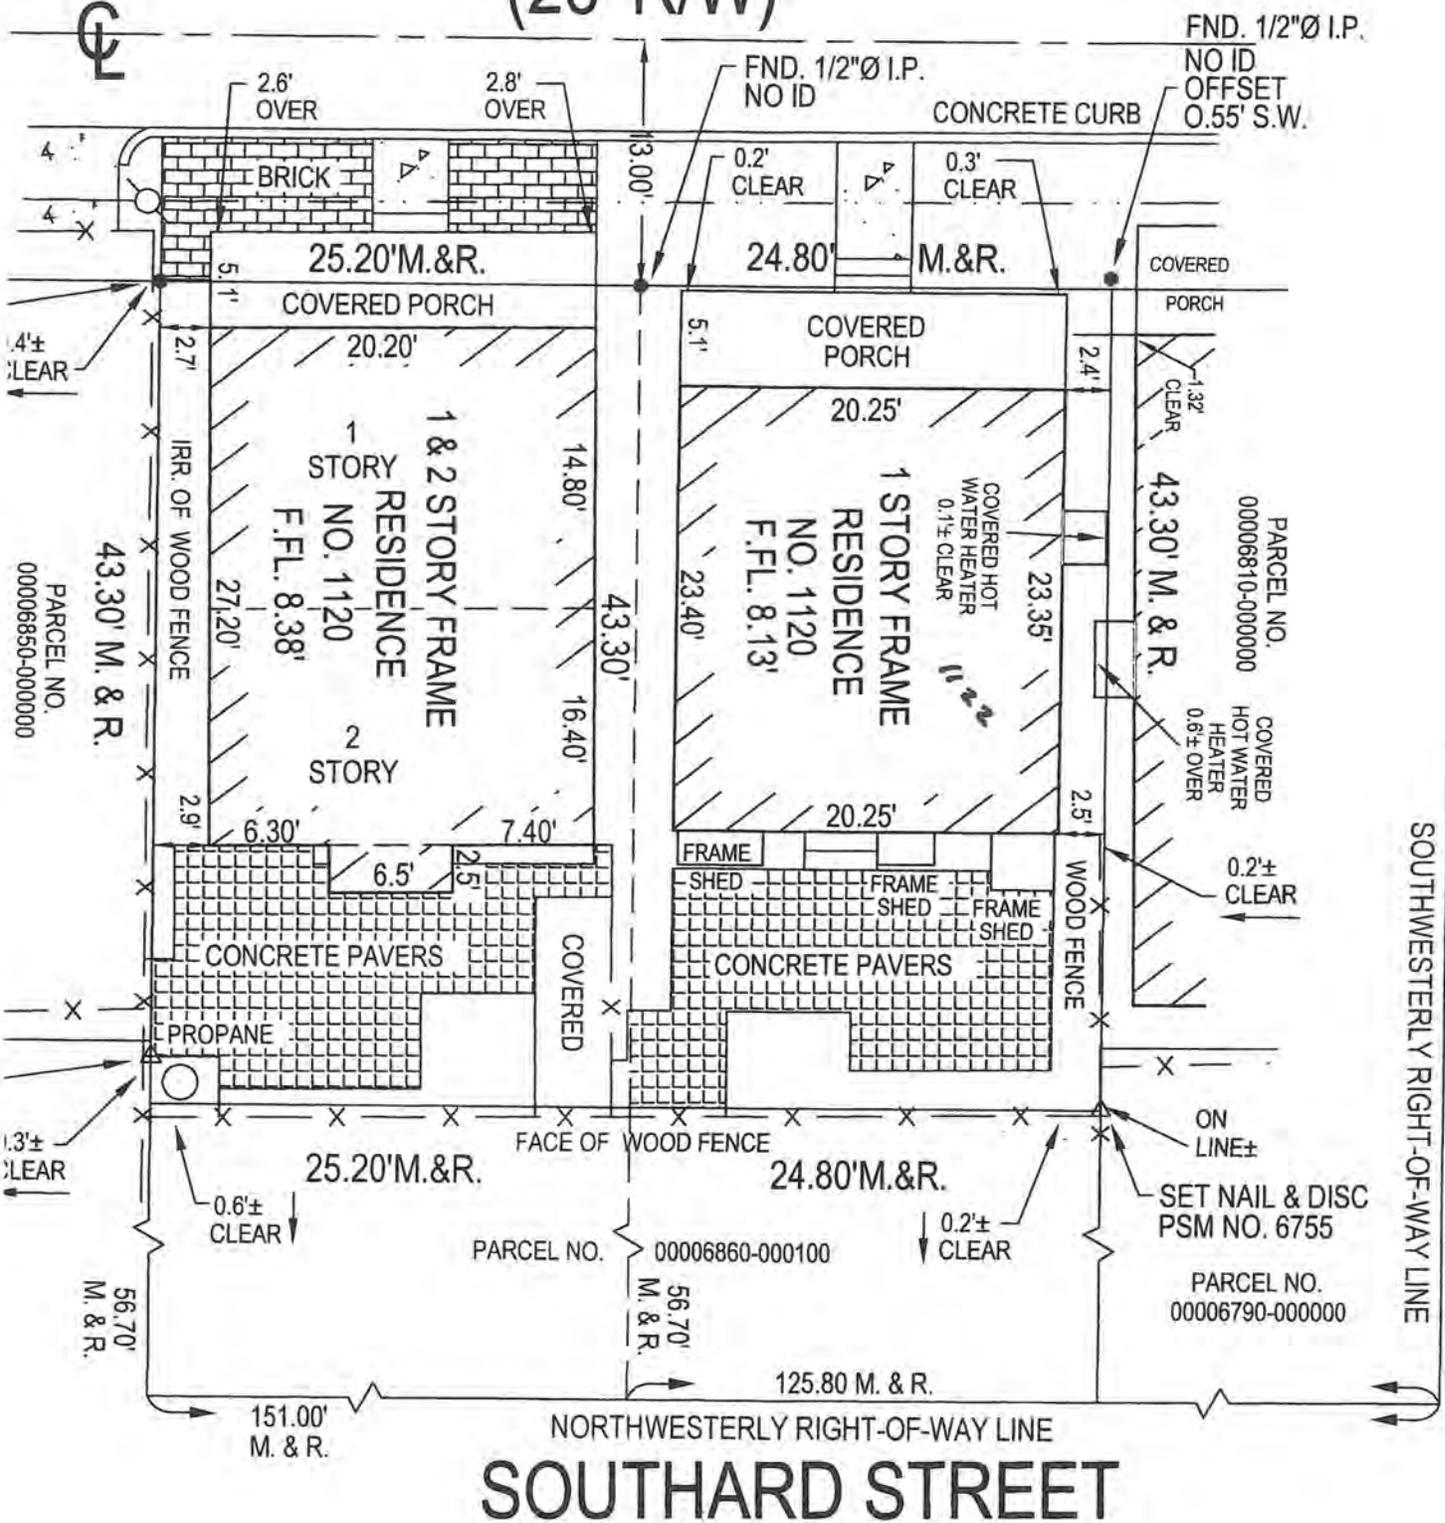

1120/1122 PORCH PROPERTYS, LLC
1120/1122 STUMP LANE
KEY WEST, FL 33040

Eddie A. Martinez
EDDIE A. MARTINEZ
 PROFESSIONAL SURVEYOR AND
 MAPPER NO. LS8755
 STATE OF FLORIDA

JOB No.	N/A	DRAWN:	DRF
FIELD BOOK:	N/A	REVISED:	EAM
SCALE:	1"=10'	SHEET No.	2 OF 2

DATE:
02-25-2020

SURVEYOR'S CERTIFICATE
 I HEREBY CERTIFY THAT THE ATTACHED IS
 MY KNOWLEDGE AND BELIEF, AND THAT I
 SURVEYORS AND MAPPERS PURSUANT TO
 VISIBLE ENCROACHMENTS OTHER THAN SI
 CAD FILE:
 \\Fred\land\Surveying Data\Data\MSM\Drawings\Key W

PROPOSED DESIGN

1122 STUMP LANE RESIDENTIAL UPGRADES

KEY WEST, FLORIDA 33040



SITE LOCATION

AREA OF CONSTRUCTION

SHEET INDEX

NO.	DESCRIPTION
1	COVER - LOCATION, SITE PLAN, SURVEY, GENERAL NOTES
2	EXISTING PLAN / DEMO PLAN, NOTES
3	EXISTING ELEVATIONS / DEMO PLAN, NOTES
4	PROPOSED PLAN / FLOOR PLAN, NOTES
5	ELEVATIONS, NOTES
6	ELEVATIONS, NOTES
7	FRAMING PLAN, DETAILS, NOTES
8	PLUMBING PLAN, HVAC PLAN, NOTES
9	ELECTRICAL PLAN, HVAC, NOTES

SITE DATA

	1122 STUMP LN.		FLOOD: AE-8		ZONE: HHDR	
	PROPOSED	EXISTING	ALLOWED	VAR. REQ.		
RE NO.	00006860-000000					
SETBACKS:						
FRONT	0.2'	0.2'	10'			NO
SIDE	2.4'	0.1'	5'			NO
SIDE	1.7'	1.7'	5'			NO
REAR	14.2'	11.3'	15'			NO
LOT SIZE	1,074 S.F.	1,074 S.F.	4,000 S.F. MIN.			NO
BUILDING COVERAGE	598 S.F. 56%	638 S.F. 60%	429 S.F. 40%			NO
BUILDING HEIGHT	16.5'	15.3'	30'			NO
IMPERVIOUS AREA	675 S.F. 63%	880 S.F. 82%	644 S.F. 60%			NO
OPEN SPACE	194 S.F. 18%	194 S.F. 18%	376 S.F. 35%			NO

GENERAL NOTES

All work shall comply with the 2017 6th edition Florida Building Code, latest edition, and all applicable laws, codes and ordinances of the city, county, and the state of Florida. In the city of Key West, applicable Codes forming the basis of this design and compliance requirements for the contractor include:

BUILDING: Florida Building Code, 2017
 ELECTRICAL: National Electrical Code, 2017
 PLUMBING: Florida Building Code (Plumbing), 2017
 MECHANICAL: Florida Building Code (Mech.), 2017
 GAS: LP Gas Code, 2017 edition (NFPA 58)

This project is designed in accordance with A.S.C.E. 7-16 to resist wind loads of 180 mph (gusts) (Exposure C)
 This project is designed in accordance with A.S.C.E. 24-14 for flood resistant design.
 Concrete: Building code requirements for concrete, American concrete institute, ACI 318-11.

TREE PROTECTION PLAN

All existing trees to remain UNO.
 Provide 3' fenced border around native trees within the construction area.
 If landscape area is to be removed or tree is damaged, notify architect.

Basic Building Structural Information

Floor and Roof Live Loads	
Attics:	20 psf w/ storage, 10 psf w/o storage
Habitable Attics, Bedroom:	30 psf
All Other Rooms:	40 psf
Garage:	40 psf
Roofs:	20 psf

Wind Design Data			
Ultimate Wind Speed:	180 mph	Nominal Wind Speed:	139 mph
Risk Category:	II	Wind Exposure:	C
Enclosure Classification:	Enclosed	End Zone Width:	4.00 ft.
Internal Pressure Coefficient:	0.18 +/-		

Components and Cladding Design Pressures	Roof Zone 1:		Roof Zone 2:		Roof Zone 3:	
		+25.8 psf max.,	-41.1 psf min.	+25.8 psf max.,	-71.5 psf min.	+25.8 psf max.,
	Roof at Zone 2 Overhangs:		Roof at Zone 3 Overhangs:			
	-83.6 psf min.		-140.7 psf min.			
	Wall Zone 4:		Wall Zone 5:			
	+44.9 psf max., -48.6 psf min.		+44.9 psf max., -60.0 psf min.			

The Nominal Wind Speed was used to determine the above Component and Cladding Design Pressures.

All exterior glazed openings shall be protected from wind-borne debris as per Section 1609.1.2 of the code.

The site of this building is not subject to special topographic wind effects as per Section 1609.1.1.1 of the code.



STREET VIEW (STUMP LANE)

1122 STUMP LANE
RESIDENTIAL UPGRADES
1122 STUMP LN. KEY WEST, FLORIDA 33040




WILLIAM ROWAN N
ARCHITECTURE
KEY WEST, FLORIDA
FLORIDA LICENSE: AR-001751
331 PRAIRIE LANE
305.236.3754

PROJECT NO :

1-25-2021
DATE : 9-21-2020

1

1 OF 9

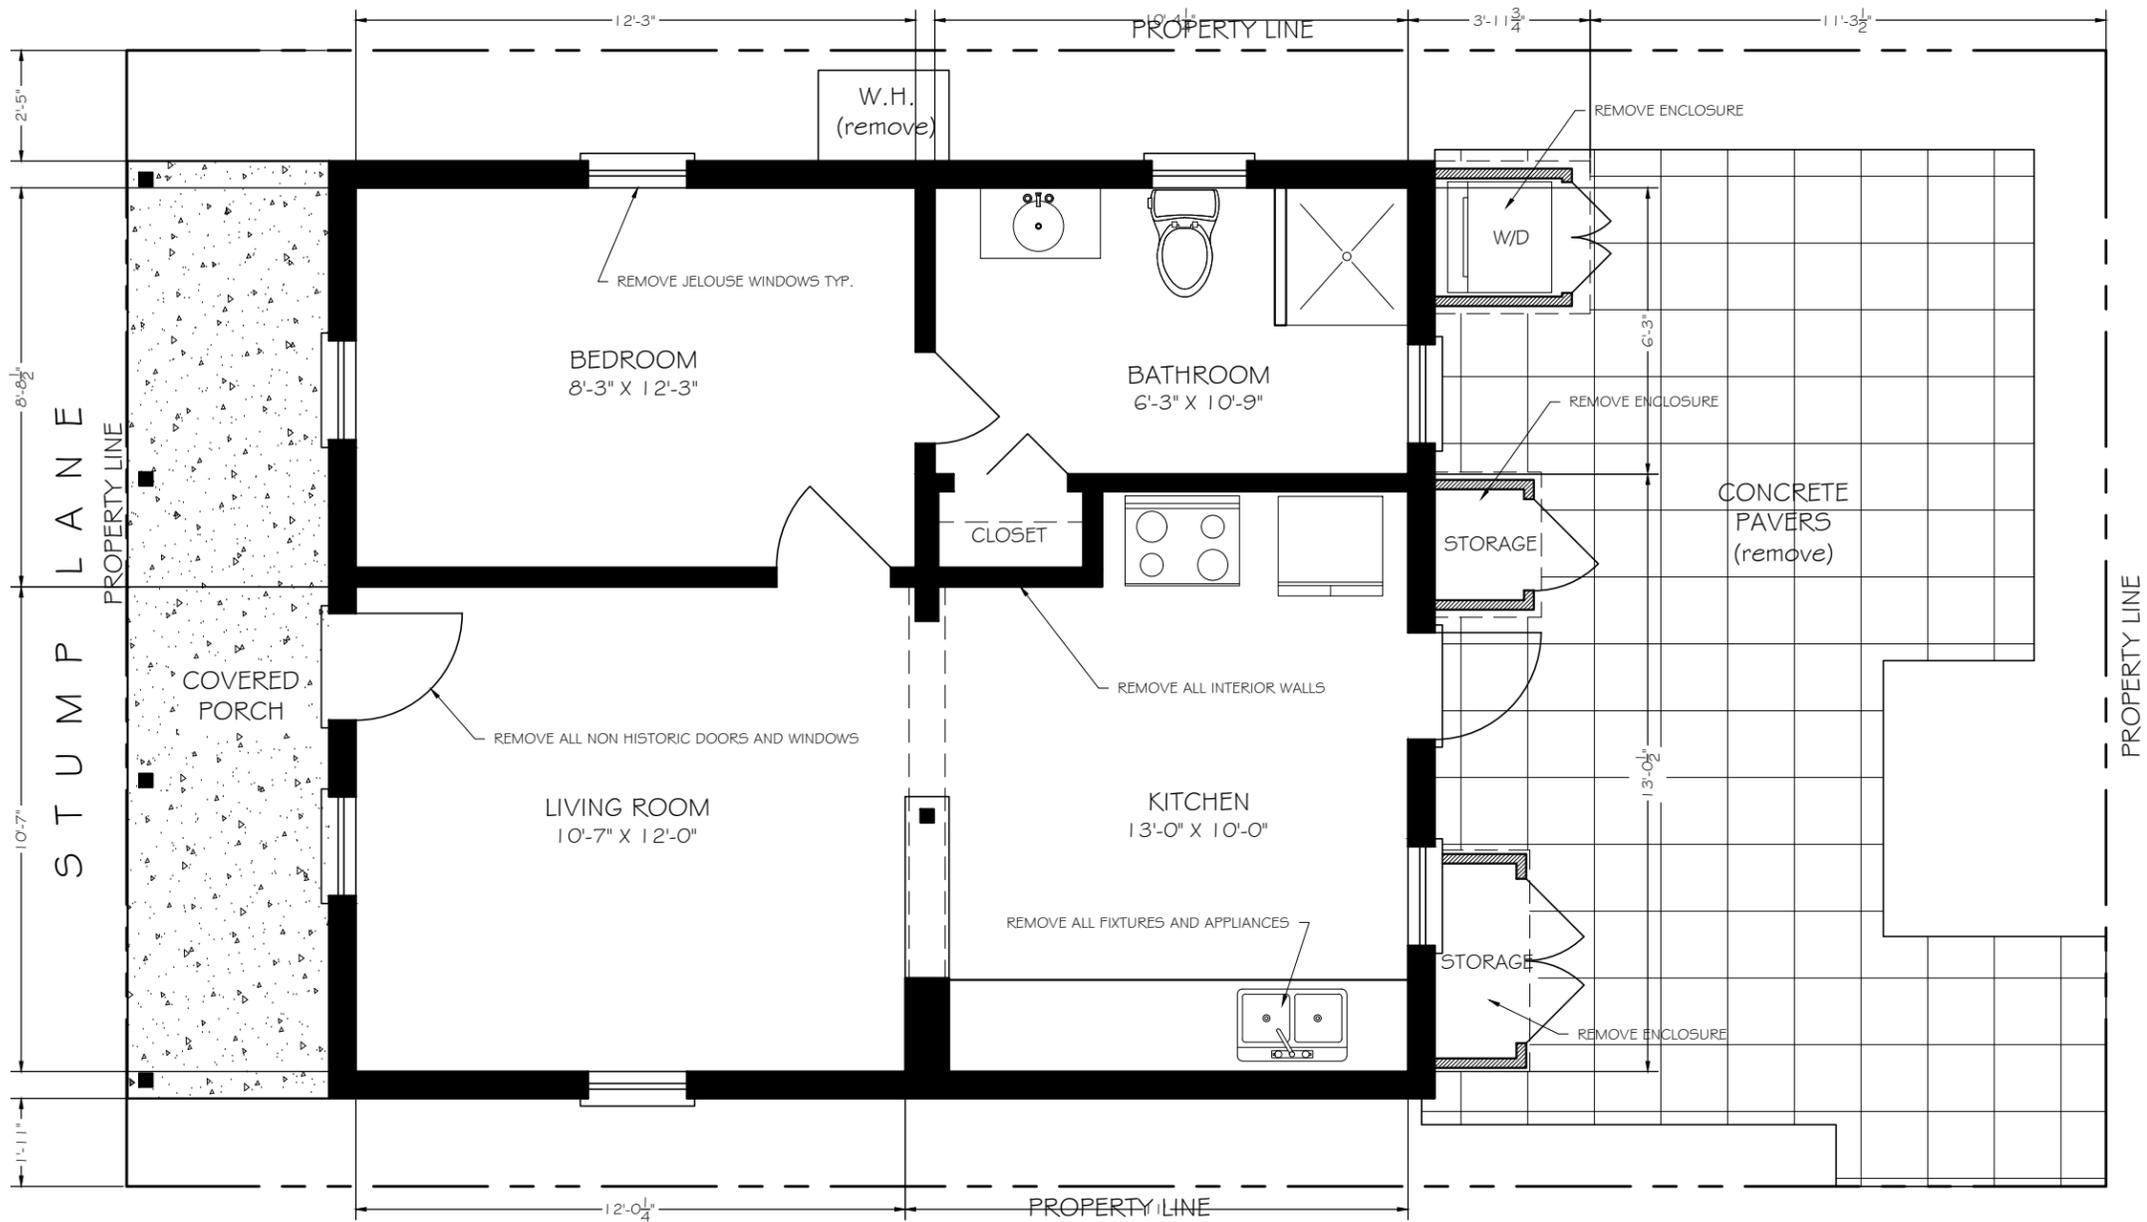

FIRST FLOOR PLAN
 1/4" = 1'-0" EXISTING

SITE DATA

	1122 STUMP LN. FLOOD: AE-8 ZONE: HHDR			
	PROPOSED	EXISTING	ALLOWED	VAR. REQ.
RE NO.	00006860-000000			
SETBACKS:				
FRONT	0.2'	0.2'	10'	NO
SIDE	2.4'	0.1'	5'	NO
SIDE	1.7'	1.7'	5'	NO
REAR	14.2'	11.3'	15'	NO
LOT SIZE	1,074 S.F.	1,074 S.F.	4,000 S.F. MIN.	NO
BUILDING COVERAGE	598 S.F. 56%	638 S.F. 60%	429 S.F. 40%	NO
BUILDING HEIGHT	16.5'	15.3'	30'	NO
IMPERVIOUS AREA	675 S.F. 63%	880 S.F. 82%	644 S.F. 60%	NO
OPEN SPACE	194 S.F. 18%	194 S.F. 18%	376 S.F. 35%	NO

DEMOLITION NOTES

1. If Demolition commences prior to permit, GC shall obtain demo permits.
2. Furnish all labor and materials as required to complete demolition and removal of all items as indicated.
3. Provide strict control of job cleaning and prevent dust and debris from emanating from demolition area. Keep area clean.
4. If any questions arise as to the removal of any material, clarify the point in question with the architect or owner before proceeding.
5. At completion of demolition work the construction areas shall be left in "broom clean" condition. All debris and misc. material shall be moved to waste area provided by the contractor.
6. Debris removal must be performed in accordance with owner and building management requirements and procedures.
7. Carefully remove all existing light fixtures and lenses (where demolition is note) and store for future use. Before indicated reinstallation, inspect each fixture and repair or replace parts as required. All relocated fixtures shall be in full operating order. All tubes and/or ballasts not reused shall be disposed of in a proper manner.
8. Contractor shall be responsible for patching and/or repairing any damage caused by him or his subcontractors to existing construction. Refinish to match existing adjacent finish or as noted herein.
9. Existing smoke detectors to remain as needed.
10. Removal of any equipment, cabling, switches, and conduit pertaining to data/communications and telephone shall be verified with telephone companies or service owner data/communications representative as required to prevent new construction delays.
11. Demolition is not necessarily limited to what is shown on the drawings. The intent is to indicate the general scope of demolition required to complete the work in accordance with the contract drawings.
12. Contractor to coordinate with owner for reuse of existing millwork.
13. Remove all concrete pavers at rear of property


1122 STUMP LANE
 RESIDENTIAL UPGRADES
 1122 STUMP LN. KEY WEST, FLORIDA 33040



WILLIAM ROWAN N.
 ARCHITECTURE
 321 BEACON LANE
 KEY WEST, FLORIDA
 FLORIDA LICENSE AR-001751


PROJECT NO.:

DATE: 1-25-2021
 9-21-2020

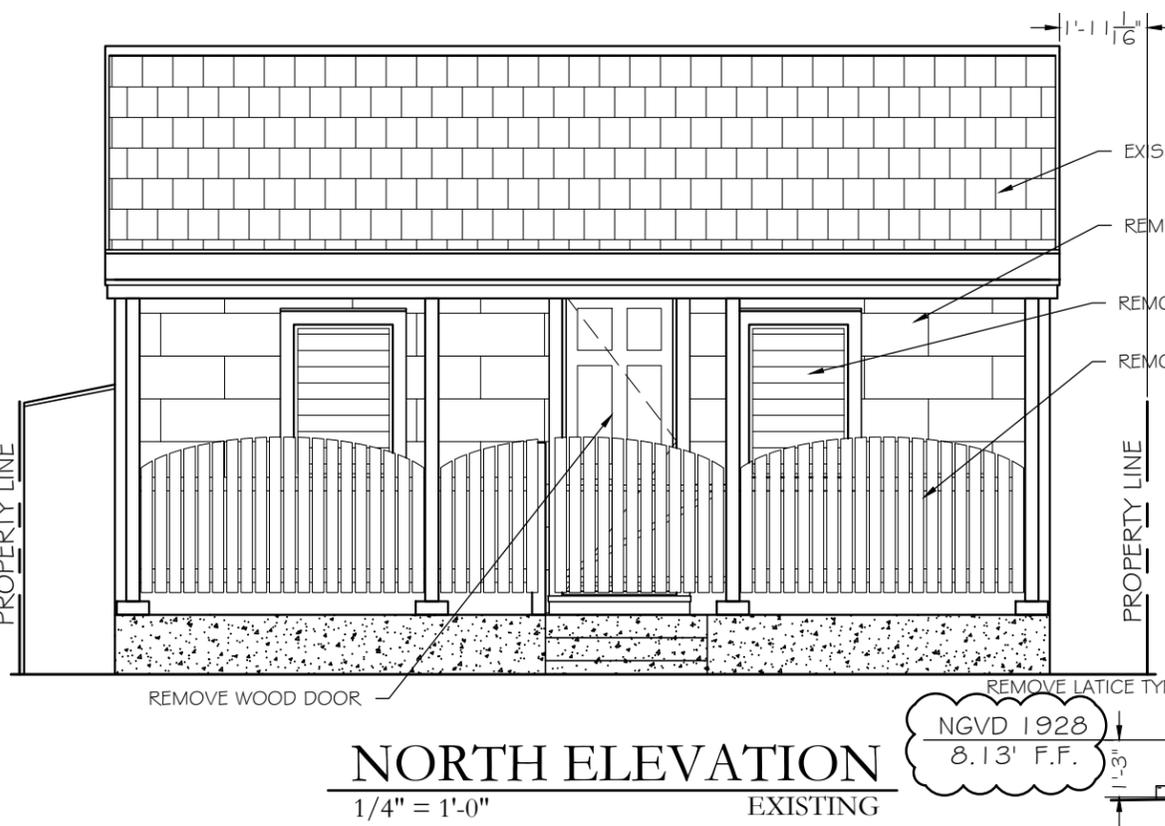

NORTH ELEVATION
1/4" = 1'-0" EXISTING


NGVD 1928
8.13' F.F.

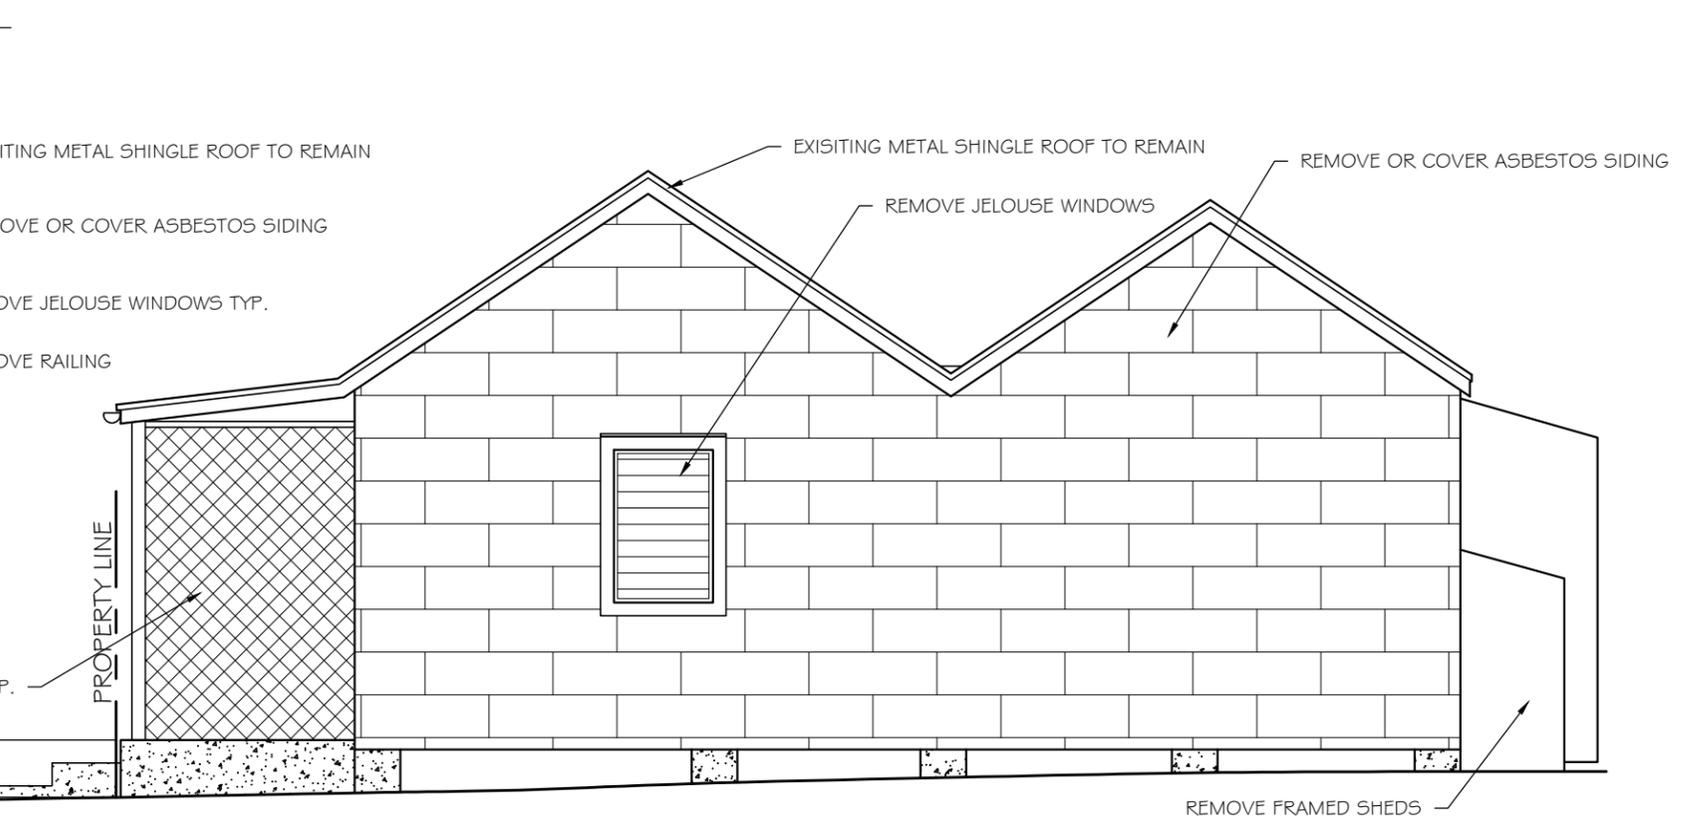

WEST ELEVATION
1/4" = 1'-0" EXISTING



SOUTH ELEVATION
1/4" = 1'-0" EXISTING

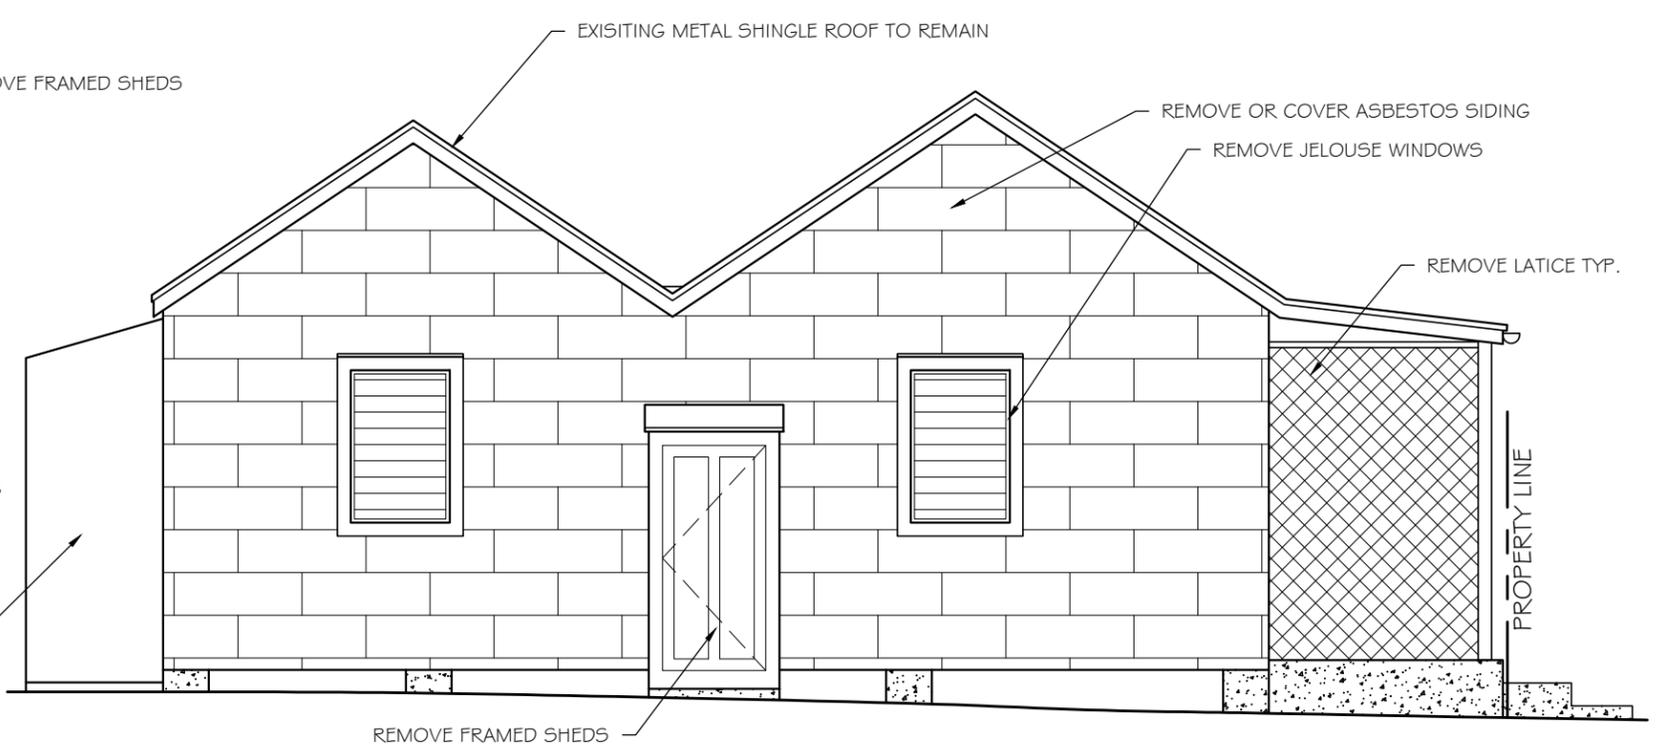

EAST ELEVATION
1/4" = 1'-0" EXISTING

I

ELECTRICAL / LIFE SAFETY


1122 STUMP LANE
RESIDENTIAL UPGRADES
1122 STUMP LN. KEY WEST, FLORIDA 33040



WILLIAM ROWAN N
ARCHITECTURE
331 PEACOCK LANE
305 296 5784
KEY WEST, FLORIDA
FLORIDA LICENSE #AR007751

PROJECT NO :

1-25-2021
DATE : 9-21-2020

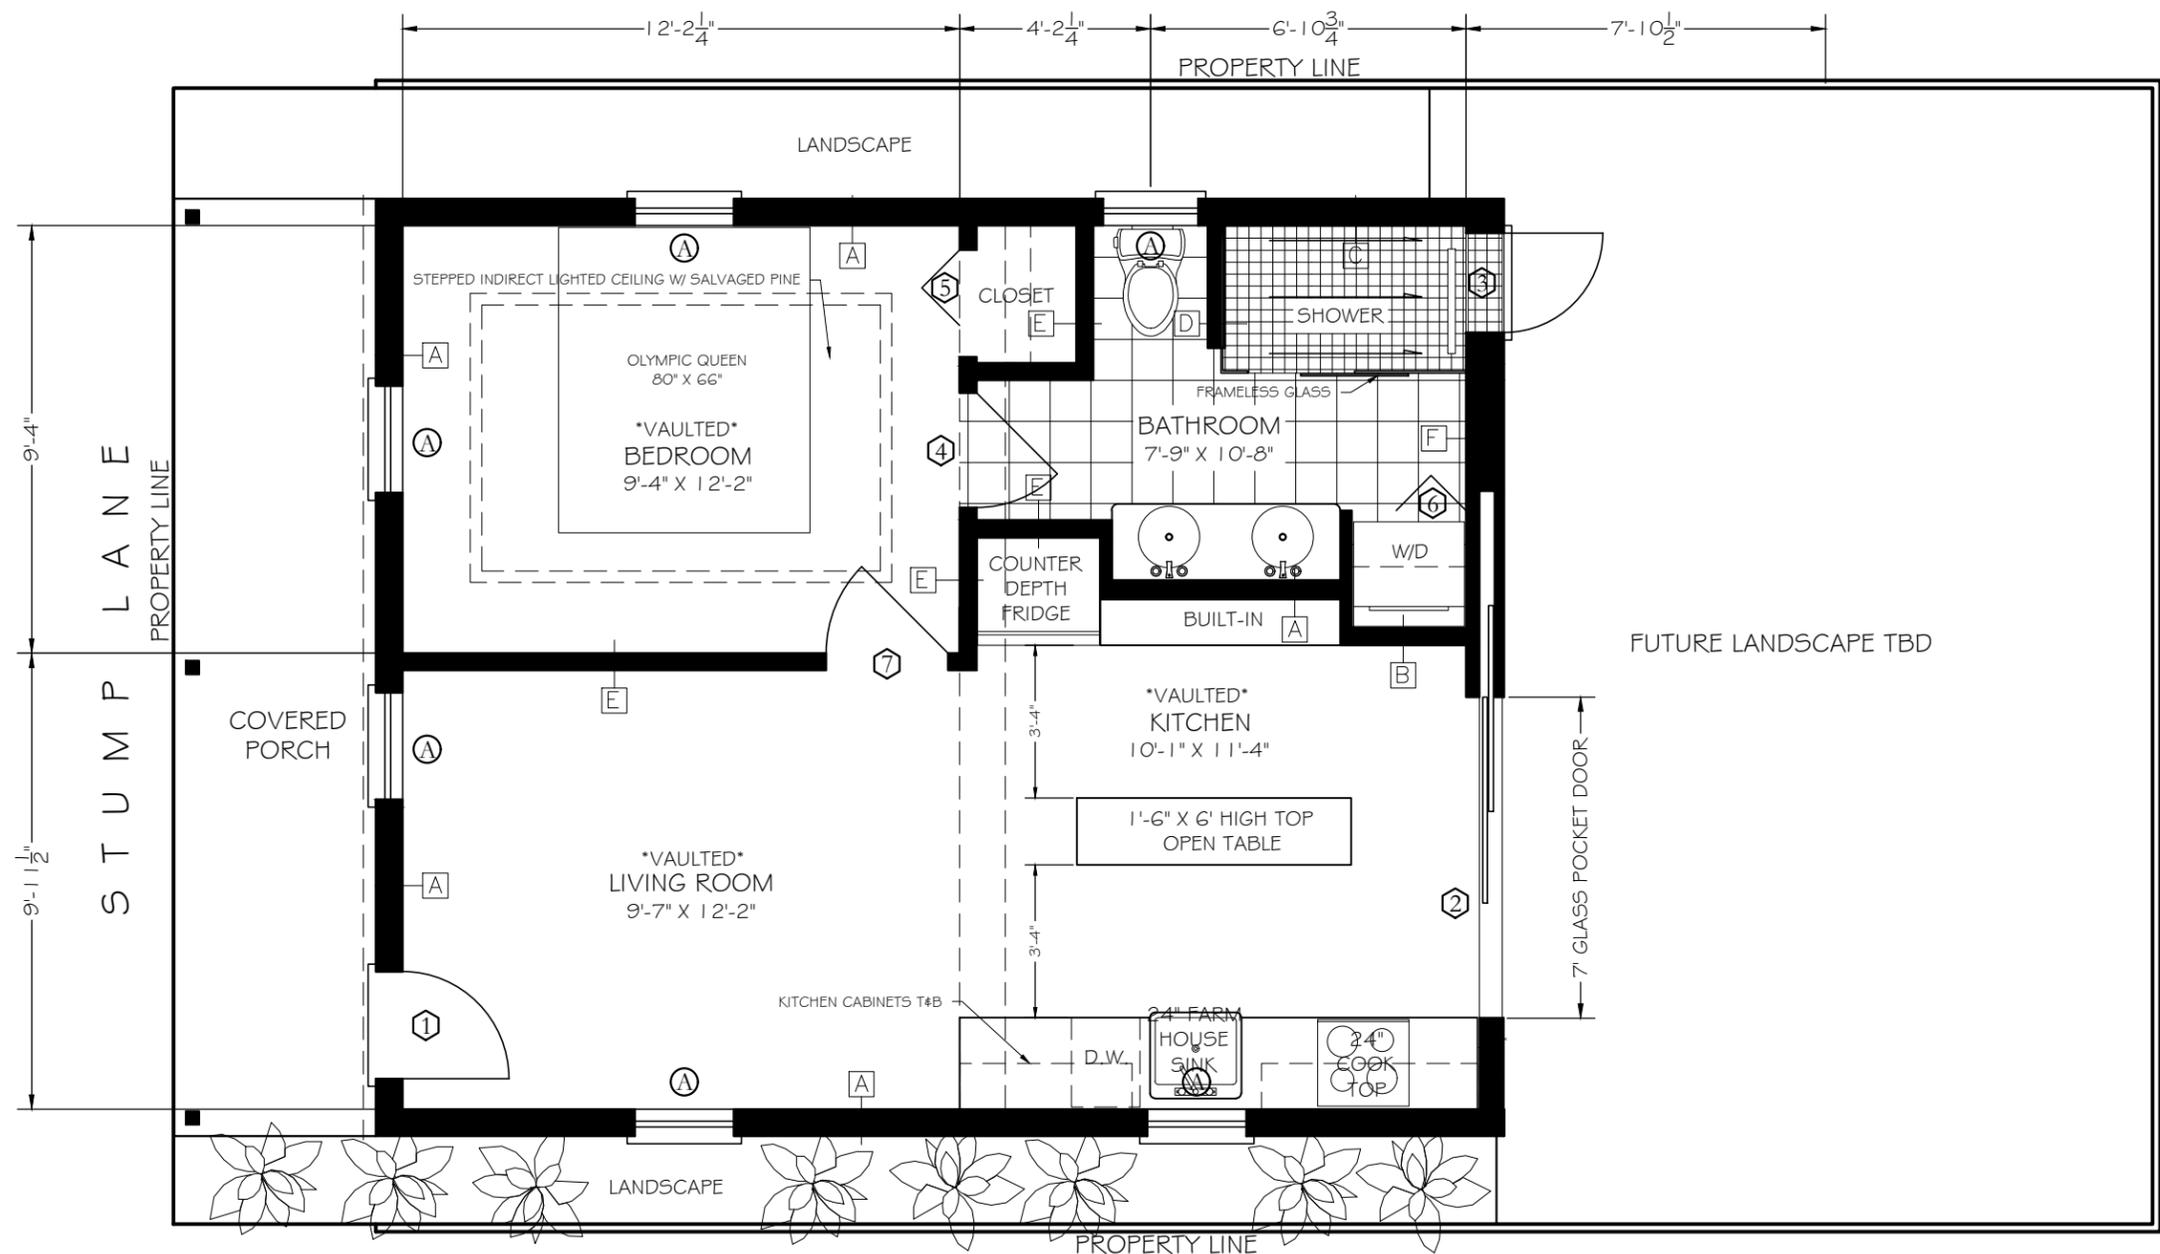

FIRST FLOOR PLAN
 1/4" = 1'-0" PROPOSED

DOOR & WINDOW SCHEDULE

MK.	D-W	MATERIAL	SIZE	DESCRIPTION	PRES. REQ.	ZONE	TYPE
1	D	WOOD	2'-10" X 6'-8"	ENTRY DOOR	+41.2 psf / -54.5 psf	5	I
2	D	IMPACT	9'-0" X 6'-8"	SLIDING GLASS	+37.3 psf / -45.1 psf	5	III
3	D	IMPACT	2'-4" X 6'-8"	PRIVACY GLASS	+41.2 psf / -54.5 psf	5	I
4	D	WOOD	2'-6" X 6'-8"	BATHROOM DOOR	N/A	N/A	III
5	D	WOOD	2'-4" X 6'-8"	CLOSET DOOR	N/A	N/A	IV
6	D	WOOD	2'-6" X 6'-8"	LAUNDRY DOOR	N/A	N/A	IV
7	D	WOOD	2'-6" X 6'-8"	BEDROOM DOOR	N/A	N/A	III
A	W	WOOD	HISTORICAL	HISTORIC MATCH	+42.1 psf / -45.6 psf	4	

WALL SCHEDULE

MK.	DESCRIPTION	NOTES
A	EXISTING 2X4 EXTERIOR WALL, STUDS 12" O.C. W/ MIN. 5/8" PLY SHEATHING INTERIOR OR EXTERIOR. R-19 INSULATION & 1/2" GYPSUM BOARD TYP.	
B	2X6 INTERIOR WET WALL STUDS 16" O.C.	
C	EXISTING 2X4 WALL, STUDS 12" O.C. W/ 1/2" CEMENT BOARD INTERIOR	
D	2X4 INTERIOR WALL STUDS 16" O.C. 1/2" GYPSUM OR CEMENT BOARD	
E	2X4 INTERIOR WALL STUDS 16" O.C. 1/2" GYPSUM EA. SIDE TYP.	
F	2X4 EXTERIOR WALL STUDS 12" O.C. 1/2" INTERIOR FIR OUT POCKET FOR SLIDING GLASS PANELS, CEMENT BOARD AT EXTERIOR ADJACENT TO PROPOSED POOL	

- CONSTRUCTION PLAN GENERAL NOTES**
- Do not scale drawings, written dimensions govern. All partition locations shall be as shown on the partition plan. In case of conflict, verify with the owner or architect.
 - All new gypsum board partitions shall be taped and sanded smooth with no visible joints. Patch and repair surfaces to match adjacent or adjoining surfaces where required. All surfaces shall be aligned and sanded smooth.
 - All partitions are dimensioned from finish face of gypsum board to finish face of gypsum board unless otherwise noted. All dimensions marked "Clear" or "clr" shall be maintained and shall allow for thicknesses of all wall finishes, U.N.O.
 - Dimensions noted "clear" or "clr" must be accurately maintained and shall not vary more than +/- 1/8" without instruction from architect and/or owner, as applicable.
 - Dimensions marked +/- mean a tolerance not greater nor smaller than 2 inches from indicated dimension, U.N.O. verify field dimensions exceeding tolerance with architect or owner.
 - All dimensions to the exterior window wall are to the inside face of sill, U.N.O.
 - Notify architect or owner of any discrepancies of conflicts in the locations of the new construction.
 - All exposed gypsum board edges to have metal edge trim work or equivalent.
 - All work shall be directed and installed, plumb, level, square, and true and in proper alignment.
 - Refer to cover sheet for additional notes, legends, symbols, abbreviations, and schedules.
 - Refer to electrical power plans for locations of switched, outlets and the like.
 - Obtain approval from architect or owner, as applicable, prior to modifying building components, systems and items not identified prior to adjusting any and all other field conditions required to fit plans.
 - All existing and new floor penetrations for piping shall be fully blocked and sealed in accordance with the applicable building fire codes.
 - Trim the bottoms of the doors to clear the top of finished floor, as applicable, by 1/2" maximum, U.N.O., Verify slab conditions, trim each door to fit condition. Where radical variations in floor elevation exist, doors shall be ordered with bottom stile sized to accommodate these undercut conditions.
 - Dimensions locating doors are to the inside of edge of jamb U.N.O.
 - All "wet walls" to receive concrete board or green board.
 - Existing plumbing in kitchen to remain. Tie into existing plumbing at closest route and / or location.
 - New electrical to be verified in existing panel.
 - New floor framing to be 2x10 pressure treated with blocking typ.

1122 STUMP LANE
 RESIDENTIAL UPGRADES
 1122 STUMP LN. KEY WEST, FLORIDA 33040



WILLIAM ROWAN N.
 ARCHITECTURE
 KEY WEST, FLORIDA
 FLORIDA LICENSE AR-001751
 331 PEACOCK LANE
 305.296.3784

PROJECT NO :
 DATE : 1-25-2021
 9-21-2020



NORTH ELEVATION
1/4" = 1'-0" PROPOSED

WOOD FRAMING NOTES:

1. LUMBER AND ITS FASTENINGS SHALL CONFORM TO THE NATIONAL DESIGN SPECIFICATIONS FOR WOOD CONSTRUCTION, LATEST EDITION.
2. ALL WOOD FRAMING SIZES, FRAMING, FASTENING REQUIREMENTS, ANCHORAGES, FIRESTOPS, AND CONNECTORS NOT SHOWN ON THESE PLANS TO BE PER THE SPECIFIED BUILDING CODE.
3. ALL STRUCTURAL LUMBER TO BE STRUCTURAL GRADE NO. 2 SPRUCE-PINE-FIR WITH A MAXIMUM MOISTURE CONTENT OF 19%. ALL LUMBER TO BE STAMPED WITH THE GRADE MARK OF AN APPROVED GRADING AGENCY.
4. ALL WOOD FRAMING EXPOSED TO WEATHER SHALL BE PRESSURE TREATED. ALL FASTENERS IN CONTACT WITH PRESSURE-TREATED WOOD TO BE HOT DIP GALVANIZED PER THE MANUFACTURERS RECOMMENDATIONS AND THE APPLICABLE BUILDING CODE.
5. THE FRAMING LAYOUTS DEPICTED ON THE PLANS ARE TO ILLUSTRATE GENERAL FRAMING CONDITIONS BUT DO NOT NECESSARILY DEPICT THE CORRECT QUANTITIES OR CONNECTIONS REQUIRED.
6. FASTENING FOR ALL STRUCTURAL MEMBERS NOT SPECIFICALLY SHOWN IN THE PLANS TO BE PER THE FASTENING SCHEDULE OF THE APPLICABLE BUILDING CODE.
7. BOLTS SHALL CONFORM TO ASTM 307, ANSI D18.2.1. SCREWS AND LAG SCREWS SHALL CONFORM TO ANSI B18.2.1. AND ANSI B18.6.1, RESPECTIVELY. BOLTS THROUGH WOOD SHALL BE FITTED WITH STANDARD WASHERS.
8. BOLT HOLES SHALL BE AT LEAST A MINIMUM DIAMETER OF 1/32" AND NO MORE THAN A MAXIMUM OF 1/16" LARGER THAN THE BOLT DIAMETER.
9. BOLT NUTS SHALL BE FINGER-TIGHT PLUS 1/3 TO 1/2 TURN WITH A HAND WRENCH, WITH CONSIDERATION GIVEN TO POSSIBLE FUTURE WOOD SHRINKAGE. CARE SHOULD BE TAKEN NOT TO OVER-TORQUE THE NUT. IMPACT WRENCHES SHOULD NOT BE USED AS THEY MAY PRELOAD THE CONNECTORS. BOLT NUTS SHALL BE PERIODICALLY RETIGHTENED.

10. UNLESS OTHERWISE NOTED, CONNECTORS SHALL BE INSTALLED WITH THE MAXIMUM NUMBER AND SIZE OF FASTENERS AS REQUIRED IN THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
11. THE NUMBER AND SIZE OF NAILS USED TO CONNECT WOOD MEMBERS SHALL BE ACCORDING TO THE APPLICABLE BUILDING CODE. REFER TO MANUFACTURER FOR NAILING REQUIREMENTS (TO ATTAIN MAXIMUM TABLE VALUES) FOR ALL WOOD-TO-WOOD MECHANICAL FASTENERS.
12. MULTIPLE STUDS SHALL BE GLUED AND NAILED TO 10d NAILS 24" O.C.
1. BRACING SHALL BE PROVIDED FOR ALL WALLS UNTIL SHEAR PANELS, FLOOR FRAMING, ROOF FRAMING, AND DECKING ARE INSTALLED.
13. CUTTING AND NOTCHING OF ALL LOAD BEARING STUDS SHALL BE LIMITED TO 25% OF THE STUD DEPTH.
14. ALL LOAD BEARING WALLS SHALL CONSIST OF A SINGLE STUD SILL PLATE AT THE BOTTOM AND A DOUBLE STUD TOP PLATE AT THE TOP. STUDS USED IN PLATES SHALL MATCH THE DIMENSIONS USED FOR STUDS WITHIN THE WALLS. STUD WALLS SHALL END WITH DOUBLE STUDS ON EACH END.
15. WALL OPENINGS LESS THAN AND INCLUDING 5'-0" WIDE ARE TO BE FRAMED WITH ONE KING STUD AND ONE JACK STUD ON EACH SIDE. WALL OPENINGS GREATER THAN 5'-0" WIDE SHALL BE FRAMED WITH ONE KING STUD AND TWO JACK STUDS ON EACH SIDE.
16. ALL BEAMS AND JOISTS TO BE FRAMED FLUSH WITH SUPPORTING MEMBER TO BE SUPPORTED BY APPROVED HANGERS WITHIN ENCLOSED CONDITIONED SPACE.
17. DOUBLE JOISTS ARE TO BE PROVIDED BELOW PARTITION WALLS THAT RUN PARALLEL TO JOISTS AND SOLID BLOCKING THE DEPTH OF THE JOISTS SHALL BE PROVIDED BETWEEN JOISTS BELOW PARTITION WALLS THAT FRAME PERPENDICULAR TO JOISTS.
18. WHERE HEADERS FRAME INTO STUDS, DOUBLE STUDS SHALL BE PROVIDED.



NGVD 1928
9.0± F.F.


WEST ELEVATION
1/4" = 1'-0" PROPOSED

1122 STUMP LANE
RESIDENTIAL UPGRADES
1122 STUMP LN. KEY WEST, FLORIDA 33040



WILLIAM ROWAN N
ARCHITECTURE
KEY WEST, FLORIDA
FLORIDA LICENSE AR-0017751
321 PEACOCK LANE
305 296 9784

PROJECT NO :
DATE : 1-25-2021
9-21-2020

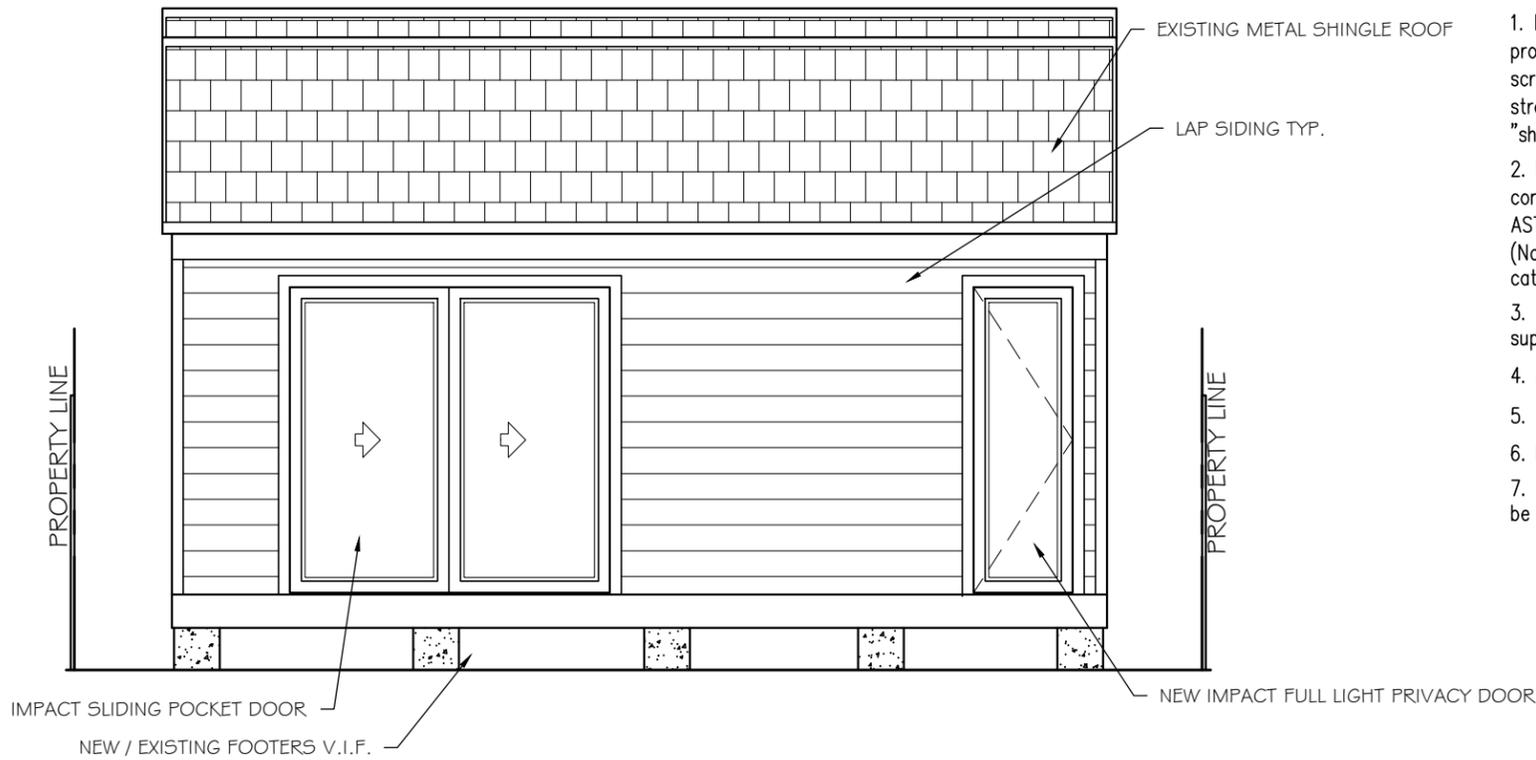



SOUTH ELEVATION
1/4" = 1'-0" PROPOSED

FASTENER / CONNECTOR NOTES:

1. Install all required fasteners per installation instructions provided by Simpson Strong-Tie Company Inc.: (a) use proper fastener type; (b) use proper fastener quantity; (c) fill all fastener holes; (d) do not overdrive or underdrive nails, including when using powder nailers; and (e) ensure screws are completely driven. Only bend products that are specifically designed to be bent. For those products that require bending (such as strap-type holdowns, straight-end twist straps, etc.), do not bend more than one full cycle. Cut joists to the correct length, do not "short-cut." The gap between the end of the joist and the header material should be no greater than 1/8" unless otherwise noted.
2. Unless otherwise noted, dimensions are in inches, loads are in pounds. Unless otherwise noted, welds, screws, bolts and nails may not be combined to achieve highest load value. 0.131" x 2 1/2", 0.148" x 3" and 0.162" x 3 1/2" specify common nails that meet the requirements of ASTM F1667. When a shorter nail is specified, it will be noted (for example 0.131" x 1 1/2"). Refer to Simpson Strong-Tie Nailing Guide, NDS (National Design Specification) and ASTM F1667 (American Society of Testing and Materials) for more nail info. Do not overload. Do not exceed catalog allowable loads, which would jeopardize the connection..
3. All engineered lumber shall be protected from rain and kept dry throughout the construction process. All long spans and cantilevers shall be supported without deflection until the building is dried in.
4. Joists, beams, and headers shall only be drilled, cut, or notched in strict accordance with the manufacturer's specifications.
5. All headers and beams shall be (2) 2x8 minimum, unless noted otherwise on plans. Refer to note 4 for support requirements.
6. Hardware such as holdowns, straps, and hangers are designed to be by Simpson Strong-Tie Company, Inc.
7. All columns shall be double stud minimum, unless noted otherwise, with the beam or header bearing fully on the column. Individual studs shall be nailed together per the general structural notes.

DOOR TYPES

SEE PLAN FOR LOCATIONS

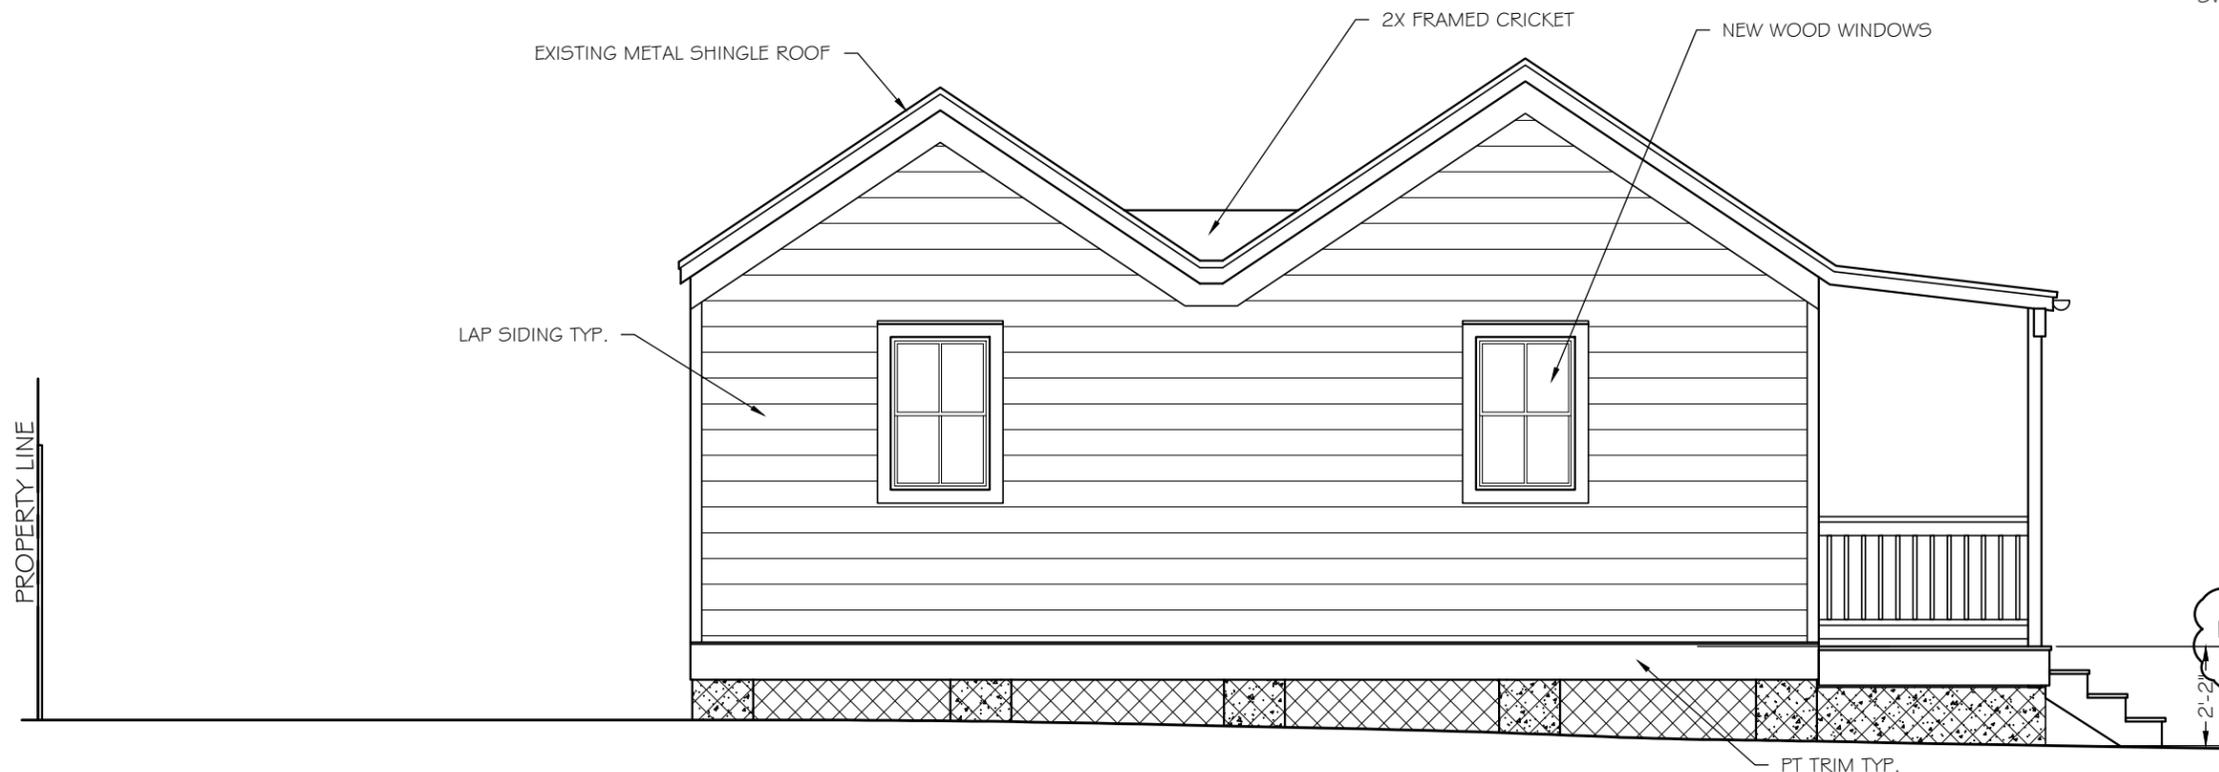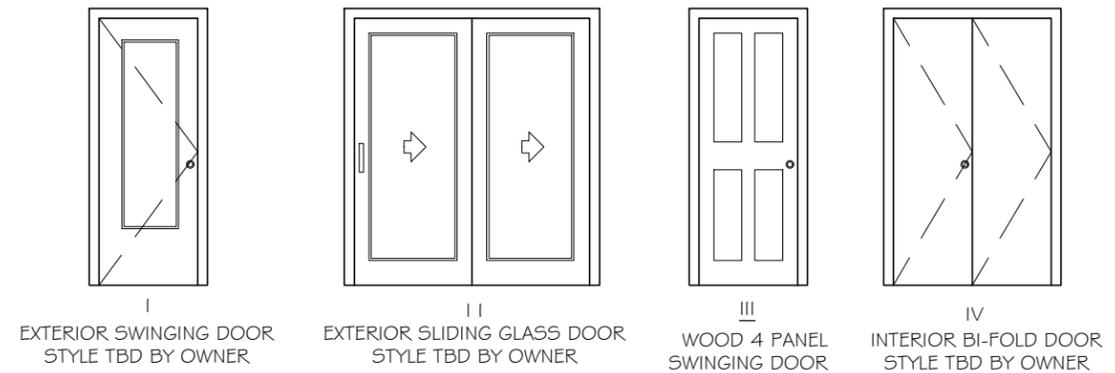

EAST ELEVATION
1/4" = 1'-0" PROPOSED

1122 STUMP LANE
RESIDENTIAL UPGRADES
1122 STUMP LN. KEY WEST, FLORIDA 33040



WILLIAM ROWAN N
ARCHITECTURE
KEY WEST, FLORIDA
FLORIDA LICENSE: AR-6017751

PROJECT NO :

1-25-2021
DATE : 9-21-2020

6

6 OF 9

NOTICING

Public Meeting Notice

The Historic Architectural Review Commission will hold a public meeting at **5:00 p.m., February 24, 2021 at City Hall, 1300 White Street**, Key West, Florida. In order to view the live feed of the meeting, you can tune in to Comcast channel 77, AT&T Uverse channel 99, or type this link into your browser:

http://keywestcity.granicus.com/MediaPlayer.php?publish_id=1&embed=1 If you wish to participate virtually, please contact HARC staff at 305-809-3975. The purpose of the hearing will be to consider a request for:

AFTER-THE-FACT RENOVATIONS AND ELEVATION OF A HISTORIC HOUSE. AFTER-THE-FACT DEMOLITION OF HISTORIC ELEMENTS.
#1122 STUMP LANE

Applicant – Paul Earle Application #H2021-0003

If you wish to see the application or have any questions, you may visit the Planning Department during regular office hours at 1300 White Street, call 305-809-3973 or visit our website at www.cityofkeywest-fl.gov.

THIS NOTICE CAN NOT BE REMOVED FROM THE SITE UNTIL HARC FINAL DETERMINATION

ADA ASSISTANCE: It is the policy of the City of Key West to comply with all requirements of the Americans with Disabilities Act (ADA). Please call the TTY number at 800-955-8771 or 800-955-8770 (Voice) or the ADA Coordinator at 305-809-3811 at least five business days in advance for sign language interpreters, assistive listening devices, or materials in accessible format.





HARC POSTING AFFIDAVIT

STATE OF FLORIDA:
COUNTY OF MONROE:

BEFORE ME, the undersigned authority, personally appeared PAUL EARLE, who, first being duly sworn, on oath, depose and says that the following statements are true and correct to the best of his/her knowledge and belief:

1. That a legal notice for Public Notice of Hearing of the Historic Architectural Review Commission (HARC) was placed on the following address:
1122 STUMP LN on the 18 day of FEB, 2021.

This legal notice(s) contained an area of at least 8.5"x11".

The property was posted to notice a public hearing before the Key West Historic Architectural Review Commission to be held on Feb 24th, 2021.

The legal notice(s) is/are clearly visible from the public street adjacent to the property.

The Certificate of Appropriateness number for this legal notice is H2021-0003

2. A photograph of that legal notice posted in the property is attached hereto.

Signed Name of Affiant:

Paul Earle
Date: 2-18-21
Address: 1117 STUMP LN
City: Key West
State, Zip: 33040

The forgoing instrument was acknowledged before me on this 18th day of February, 2021.

By (Print name of Affiant) Paul Earle who is personally known to me or has produced FL Driver License as identification and who did take an oath.

NOTARY PUBLIC

Sign Name: Madison Fallon
Print Name: _____
Notary Public - State of Florida (seal)
My Commission Expires: _____



PROPERTY APPRAISER INFORMATION



Disclaimer

The Monroe County Property Appraiser's office maintains data on property within the County solely for the purpose of fulfilling its responsibility to secure a just valuation for ad valorem tax purposes of all property within the County. The Monroe County Property Appraiser's office cannot guarantee its accuracy for any other purpose. Likewise, data provided regarding one tax year may not be applicable in prior or subsequent years. By requesting such data, you hereby understand and agree that the data is intended for ad valorem tax purposes only and should not be relied on for any other purpose.

By continuing into this site you assert that you have read and agree to the above statement.

Summary

Parcel ID 00006860-000000
 Account# 1007102
 Property ID 1007102
 Millage Group 10KW
 Location 1122 STUMP Ln, KEY WEST
 Address
 Legal KW PT LOT 1 SQR 44 C O C 216-22 OR533-180 OR1457-1047/49 OR1457-1050/52 OR1671-2304/05 OR3008-0441
 Description (Note: Not to be used on legal documents.)
 Neighborhood 6108
 Property SINGLE FAMILY RESID (0100)
 Class
 Subdivision
 Sec/Twp/Rng 06/68/25
 Affordable No
 Housing



Owner

1122 PORCH PROPERTIES LLC
 1117 Stump Ln
 Key West FL 33040

Valuation

	2020	2019	2018	2017
+ Market Improvement Value	\$58,771	\$52,241	\$52,241	\$53,057
+ Market Misc Value	\$977	\$977	\$977	\$977
+ Market Land Value	\$249,883	\$226,849	\$206,607	\$206,607
= Just Market Value	\$309,631	\$280,067	\$259,825	\$260,641
= Total Assessed Value	\$308,074	\$280,067	\$259,825	\$260,641
- School Exempt Value	\$0	\$0	\$0	\$0
= School Taxable Value	\$309,631	\$280,067	\$259,825	\$260,641

Land

Land Use	Number of Units	Unit Type	Frontage	Depth
SFR LANE (01LN)	1,073.84	Square Foot	24.8	43.3

Buildings

Building ID 455
 Style 1 STORY ELEV FOUNDATION
 Building Type S.F.R. - R1 / R1
 Gross Sq Ft 560
 Finished Sq Ft 460
 Stories 1 Floor
 Condition AVERAGE
 Perimeter 86
 Functional Obs 0
 Economic Obs 0
 Depreciation % 30
 Interior Walls DRYWALL
 Exterior Walls WD FRAME
 Year Built 1933
 EffectiveYearBuilt 1999
 Foundation WD CONC PADS
 Roof Type GABLE/HIP
 Roof Coverage METAL
 Flooring Type SFT/HD WD
 Heating Type NONE with 0% NONE
 Bedrooms 1
 Full Bathrooms 1
 Half Bathrooms 0
 Grade 450
 Number of Fire Pl 0

Code	Description	Sketch Area	Finished Area	Perimeter
OPX	EXC OPEN PORCH	100	0	0
FLA	FLOOR LIV AREA	460	460	0
TOTAL		560	460	0

Yard Items

Description	Year Built	Roll Year	Quantity	Units	Grade
BRICK PATIO	1969	1970	1	100 SF	2
CONC PATIO	1969	1970	1	36 SF	1
FENCES	1993	1994	1	276 SF	2

Sales

Sale Date	Sale Price	Instrument	Instrument Number	Deed Book	Deed Page	Sale Qualification	Vacant or Improved
2/6/2020	\$400,000	Warranty Deed	2255565	3008	0441	03 - Qualified	Improved
2/1/1973	\$22,000	Conversion Code		533	180	Q - Qualified	Improved


Permits

Number	Date Issued	Date Completed	Amount	Permit Type	Notes
21-0076	2/8/2021		\$0	Residential	Repair/new footers, Remove existing jalousie windows, replace with wood 2/2, New impact door rear of house, new exterior wood lap siding, repair/new exterior wood trim, new exterior wood steps, new wood porch, columns and railings
21-0189	2/8/2021		\$0	Residential	Residential electric - Install wiring in house per plans, lights, outlets, switches.
20-2313	10/29/2020		\$35,000	Residential	Replace kitchen and bath cabinets, replace drywall as needed approx 200 sq ft, new interior doors (2), reframe approx 20 linear feet of interior walls., new flooring approx 500 sq ft, replace trim as needed. All interior finishes. **NOC required**
20-0516	3/9/2020		\$2,000	Residential	Exploratory demo Remove approximately 400 sf of flooring 300 sf of drywall and kitchen cabinets *noc exempt*
19-3228	10/28/2019	11/5/2019	\$13,200	Residential	R&R ROOFING SYSTEM WITH VIC METAL SHINGLES
03-0311	2/4/2003	9/25/2003	\$1,800	Residential	PAINT&REPAIR SIDING

View Tax Info

[View Taxes for this Parcel](#)

Sketches (click to enlarge)

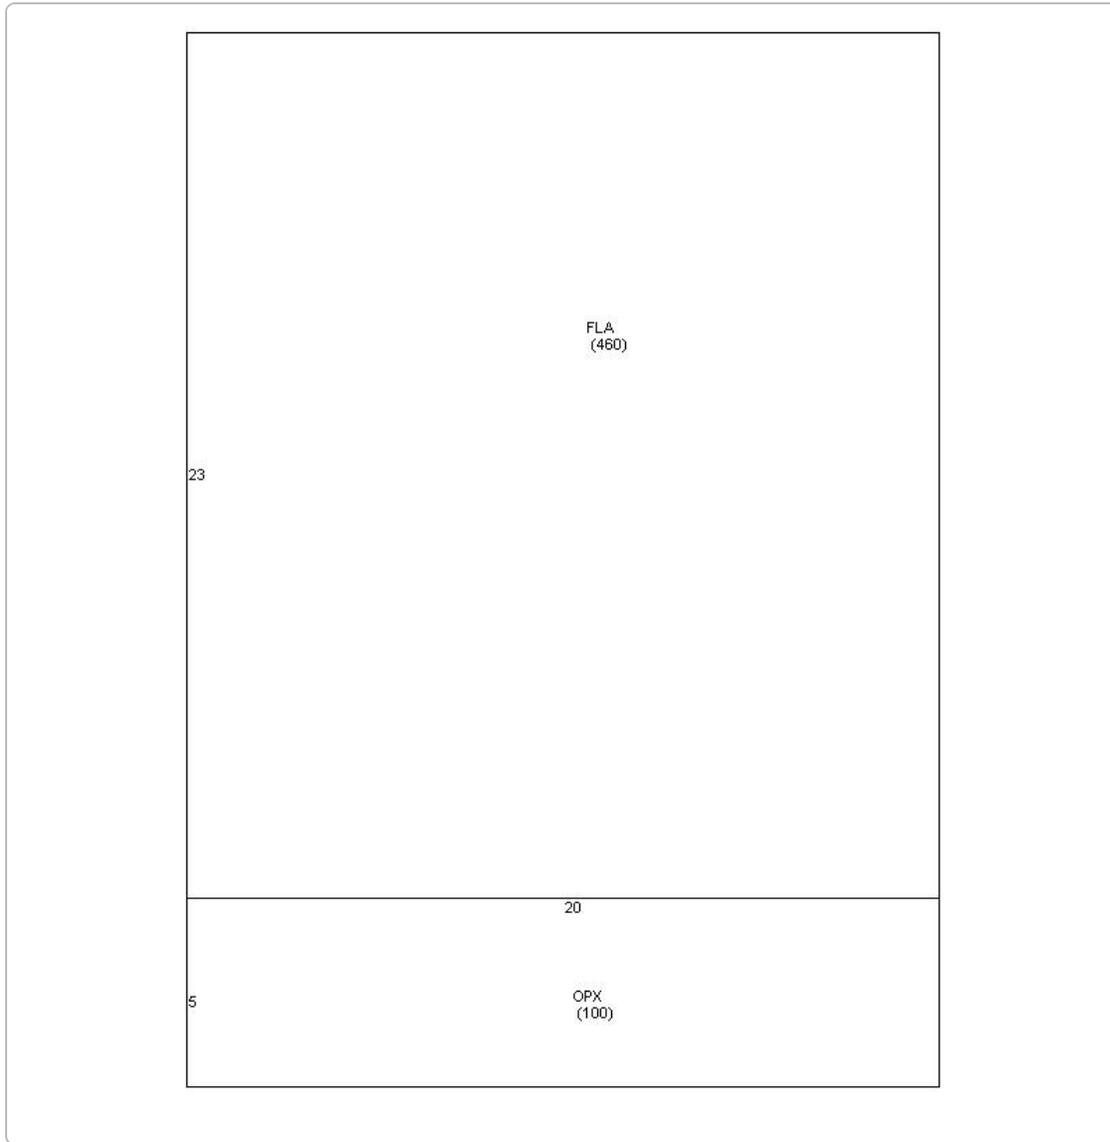

Photos



Map



TRIM Notice

2020 TRIM Notice (PDF)

2020 Notices Only

No data available for the following modules: Commercial Buildings, Mobile Home Buildings, Exemptions.

The Monroe County Property Appraiser's office maintains data on property within the County solely for the purpose of fulfilling its responsibility to secure a just valuation for ad valorem tax purposes of all property within the County. The Monroe County Property Appraiser's office cannot guarantee its accuracy for any other purpose. Likewise, data provided regarding one tax year may not be applicable in prior or subsequent years. By requesting such data, you hereby understand and agree that the [User Privacy Policy](#) and [GDPR Privacy Notice](#)



Last Data Upload: [2/19/2021, 3:42:42 AM](#)

[Version 2.3.107](#)