



# KEY WEST FIRE DEPT.

KEY WEST, FL.

Quote No: 84669

IAVA-INITIAL ATTACK  
FORD F550 4 DOOR 4X4 CHASSIS



THIS DRAWING IS FOR REFERENCE PURPOSES. ALL DIMENSIONS ARE SUBJECT TO MINOR VARIATIONS DUE TO MANUFACTURING PROCESSES.

This print is the property of Emergency One, Inc. and is loaned to you subject to return on demand, unless otherwise agreed to in writing by Emergency One, Inc. Its contents are confidential and must not be copied or submitted to third parties for use or examination.

1000 GPM HALE MG PUMP  
300 GALLON WATER

HOSE LOAD:  
NFPA CAPACITY

COMPT.	OPENING		INTERIOR DIMENSION		
L1/R1	17W	48H	19.5W	56H	21.5D
L2/R2	38W	32H	40W	32H	21.5D
L3/R3	29W	44H	31W	52H	21.5D
B1	42W	19H	44W	27H	27D

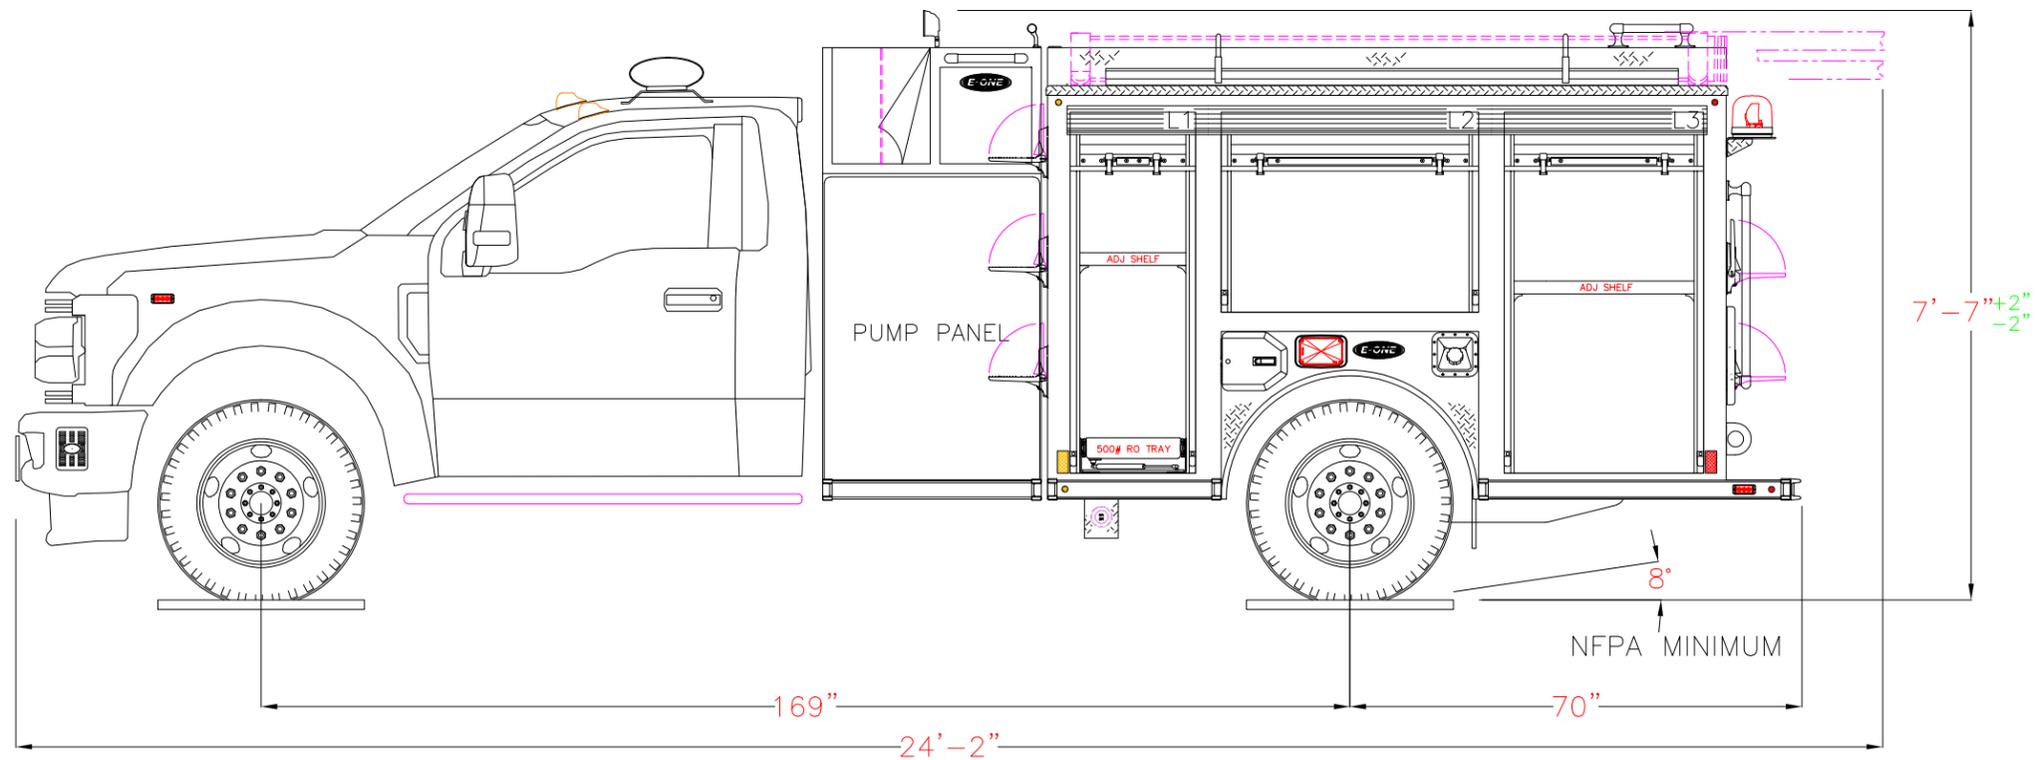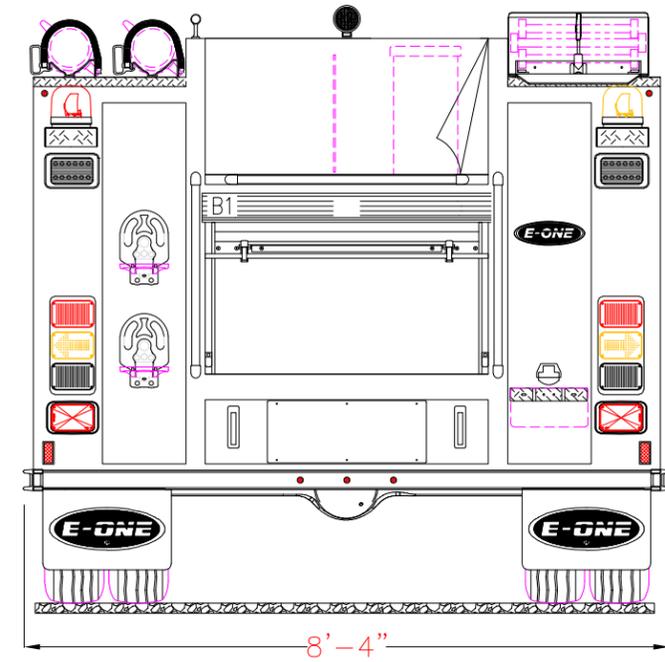

JRN	A	INITIAL RELEASE	01-25-2018	JRN
DRAWN BY	REV	DESCRIPTION	DATE	APPROVED
APPROVAL REVISIONS				SHEET 1 OF 2



# KEY WEST FIRE DEPT.



KEY WEST, FL.

Quote No: 84669

IAVA-INITIAL ATTACK  
FORD F550 4 DOOR 4X4 CHASSIS

THIS DRAWING IS FOR REFERENCE PURPOSES. ALL DIMENSIONS ARE SUBJECT TO MINOR VARIATIONS DUE TO MANUFACTURING PROCESSES.

This print is the property of Emergency One, Inc. and is loaned to you subject to return on demand, unless otherwise agreed to in writing by Emergency One, Inc. Its contents are confidential and must not be copied or submitted to third parties for use or examination.

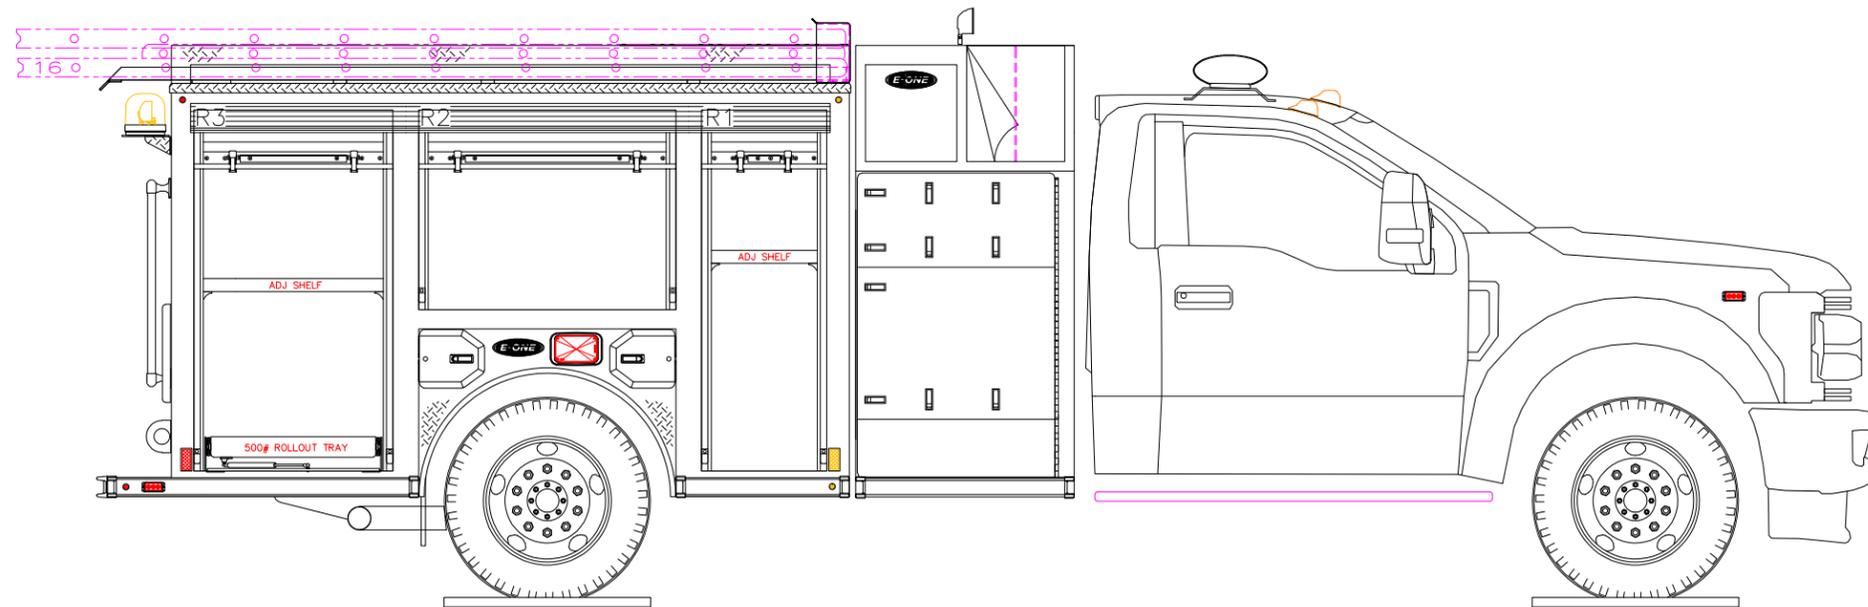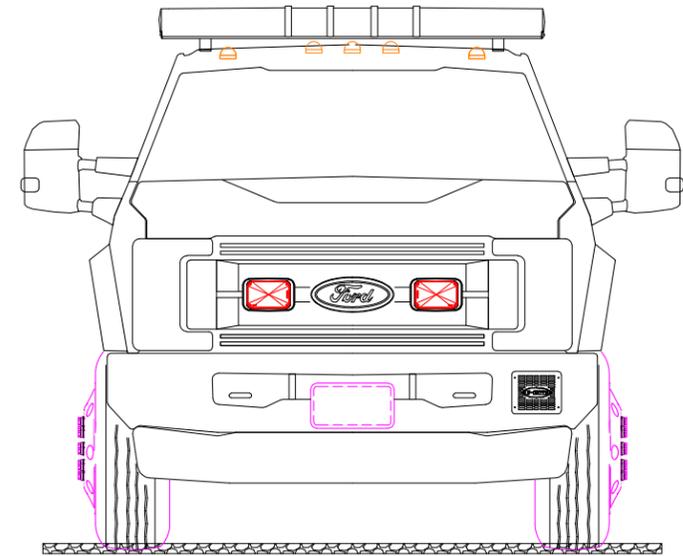

JRN	A	INITIAL RELEASE	01-25-2018	JRN
DRAWN BY	REV	DESCRIPTION	DATE	APPROVED
		APPROVAL REVISIONS		SHEET 2 OF 2